



XD/XL series PLC
User manual [Instruction]

XD/XL series PLC
User manual [Instruction]

1 Preface

2 Programming summary

3 Soft component functions

4 Basic program instructions

5 Applied instructions

6 High speed counter

7 Pulse output

8 Communication functions

9 PID functions

10 C function block

11 Sequences BLOCK

12 Special function instructions

13 Applications

14 Q&A

15 Appendixes

- Basic explanation

Thank you for purchasing Xinje XD/XL series PLC.

This manual mainly introduces XD/XL series PLC instructions.

Please read this manual carefully before using and wire after understanding the content.

About software and programming instructions, please refer to related manuals.

Please hand this manual over to operation users.

- Notices for users

Only experienced operator can wire the plc. If any problem, please contact our technical department.

The listed examples are used to help users to understand, so it may not act.

Please conform that PLC specifications and principles are suitable when connect PLC to other products. Please conform safety of PLC and machines by yourself when use the PLC. Machines may be damaged by PLC errors.

- Responsibility declaration

The manual content has been checked carefully, however, mistakes may happen.

We often check the manual and will correct the problems in subsequent version.

Welcome to offer advices to us.

Excuse us that we will not inform you if manual is changed.

- Contact information

If you have any problem about products, please contact the agent or Xinje company.

Tel: 0086 510-85134136 85123803

Fax: 0086 510-85111290

Address: Building 7 fourth floor, No.100, Dicui Rd, Wuxi, China.

Code : 214072

Catalog

1 PROGRAMMING SUMMARY	10
1-1. PLC FEATURES.....	10
1-2. PROGRAMMING LANGUAGE	11
1-2-1. <i>Type</i>	11
1-2-2. <i>Alternation</i>	12
1-3. <i>Programming mode</i>	12
2 SOFT COMPONENT FUNCTION	13
2-1. SUMMARY OF THE SOFT COMPONENTS.....	13
2-2. STRUCTURE OF SOFT COMPONENTS	17
2-2-1. <i>Structure of Memory</i>	17
2-2-2. <i>Structure of Bit Soft Components</i>	18
2-3. SOFT COMPONENTS LIST.....	19
2-3-1. <i>Soft Components List</i>	19
2-4. INPUT/OUTPUT RELAYS (X, Y).....	36
2-5. AUXILIARY RELAY (M, HM, SM)	38
2-6. STATUS RELAY (S, HS).....	40
2-7. TIMER (T, HT)	40
2-8. COUNTER (C, HC).....	44
2-9. DATA REGISTER (D, HD)	49
2-9-1. <i>Word consist of bits</i>	53
2-9-2. <i>Offset application</i>	53
2-10. FLASH REGISTER (FD, SFD, FS)	54
2-11. CONSTANT	56
2-12. PROGRAMMING PRINCIPLE	57
3 BASIC PROGRAM INSTRUCTIONS	60
3-1. BASIC INSTRUCTIONS LIST	60
3-2. [LD] , [LDI] , [OUT]	62
3-3. [AND] , [ANI].....	63
3-4. [OR] , [ORI].....	64
3-5. [LDP] , [LDF] , [ANDP] , [ANDF] , [ORP] , [ORF].....	65
3-6. [LDD] , [LDDI] , [ANDD] , [ANDDI] , [ORD] , [ORDI] , [OUTD].....	66
3-7. [ORB]	67
3-8. [ANB].....	68
3-9. [MCS] , [MCR]	69
3-10. [ALT].....	70
3-11. [PLS] , [PLF]	71
3-12. [SET], [RST].....	72
3-13. 【CNT】【CNT_D】【DCNT】【DCNT_D】【RST】 FOR THE COUNTERS.....	73
3-14. [TMR], [TMR-A] FOR TIMERS	75
3-15. [END]	76

3-16. [GROUP] , [GROUPE]	77
3-17. PROGRAMMING NOTES	77
4 APPLIED INSTRUCTIONS	79
4-1. APPLIED INSTRUCTIONS LIST	79
4-2. READING METHOD OF APPLIED INSTRUCTIONS	83
4-3. PROGRAM FLOW INSTRUCTIONS	85
4-3-1. <i>Condition Jump [CJ]</i>	85
4-3-2. <i>Call subroutine [CALL] and Subroutine return [SRET]</i>	86
4-3-3. <i>Flow [SET], [ST], [STL], [STLE]</i>	88
4-3-4. <i>[FOR] and [NEXT]</i>	94
4-3-5. <i>[FEND] and [END]</i>	96
4-4. DATA COMPARE FUNCTION.....	97
4-4-1. <i>LD Compare [LD]</i>	98
4-4-2. <i>Serial Compare [AND]</i>	99
4-4-3. <i>Parallel Compare [OR]</i>	100
4-5. DATA MOVE INSTRUCTIONS.....	103
4-5-1. <i>Data Compare [CMP]</i>	103
4-5-2. <i>Data zone compare [ZCP]</i>	104
4-5-3. <i>MOV [MOV]</i>	105
4-5-4. <i>Data block Move [BMOV]</i>	108
4-5-5. <i>Data block Move [PMOV]</i>	109
4-5-6. <i>Fill Move [FMOV]</i>	110
4-5-7. <i>Floating move [EMOV]</i>	112
4-5-8. <i>FlashROM Write [FWRT]</i>	113
4-5-9. <i>Zone set [MSET]</i>	114
4-5-10. <i>Zone reset [ZRST]</i>	115
4-5-11. <i>Swap the high and low byte [SWAP]</i>	116
4-5-12. <i>Exchange [XCH]</i>	117
4-6. DATA OPERATION INSTRUCTIONS.....	119
4-6-1 <i>Addition [ADD]</i>	119
4-6-2. <i>Subtraction [SUB]</i>	121
4-6-3. <i>Multiplication [MUL]</i>	123
4-6-4. <i>Division [DIV]</i>	124
4-6-5. <i>Increment [INC] & Decrement [DEC]</i>	126
4-6-6. <i>Mean [MEAN]</i>	127
4-6-7. <i>Logic AND [WAND], Logic OR [WOR], Logic Exclusive OR [WXOR]</i>	128
4-6-8. <i>Logic converse [CML]</i>	130
4-6-9. <i>Negative [NEG]</i>	131
4-7. SHIFT INSTRUCTIONS.....	132
4-7-1. <i>Arithmetic shift left [SHL], Arithmetic shift right [SHR]</i>	132
4-7-2. <i>Logic shift left [LSL], Logic shift right [LSR]</i>	134
4-7-3. <i>Rotation shift left [ROL], Rotation shift right [ROR]</i>	136
4-7-4. <i>Bit shift left [SFTL]</i>	137
4-7-5. <i>Bit shift right [SFTR]</i>	139

4-7-6. Word shift left [WSFL]	140
4-7-7. Word shift right [WSFR]	141
4-8. DATA CONVERT	142
4-8-1. Single word integer converts to double word integer [WTD]	142
4-8-2. 16 bits integer converts to float point [FLT]	143
4-8-3. Float point converts to integer [INT]	145
4-8-4. BCD convert to binary [BIN]	146
4-8-5. Binary convert to BCD [BCD]	147
4-8-6. Hex converts to ASCII [ASCII]	148
4-8-7. ASCII convert to Hex.[HEX]	150
4-8-8. Coding [DECO]	151
4-8-9. High bit coding [ENCO]	153
4-8-10. Low bit coding [ENCOL]	155
4-8-11. Binary to Gray code [GRY]	158
4-8-12. Gray code to binary [GBIN]	159
4-9. FLOATING NUMBER OPERATION	160
4-9-1. Floating Compare [ECMP]	160
4-9-2. Floating Zone Compare [EZCP]	162
4-9-3. Floating Addition [EADD]	163
4-9-4. Floating Subtraction [ESUB]	164
4-9-5. Floating Multiplication [EMUL]	166
4-9-6. Floating Division [EDIV]	168
4-9-7. Float Square Root [ESQR]	169
4-9-8. Sine [SIN]	170
4-9-9. Cosine [COS]	171
4-9-10. TAN [TAN]	172
4-9-11. ASIN [ASIN]	174
4-9-12. ACOS [ACOS]	175
4-9-13. ATAN [ATAN]	176
4-10. RTC INSTRUCTIONS	177
4-10-1. Read the clock data [TRD]	177
4-10-2. Write Clock Data [TWR]	178
4-10-3. Clock compare [TCMP]	179
5 HIGH SPEED COUNTER (HSC)	182
5-1. FUNCTIONS SUMMARY	182
5-2. HSC MODE	183
5-3. HSC RANGE	184
5-4. HSC INPUT WIRING	185
5-5. HSC PORTS ASSIGNMENT	185
5-6. AB PHASE COUNTING FREQUENCY DOUBLING SETTING	189
5-7. HSC INSTRUCTION	190
5-7-1. Single phase HSC [CNT]	190
5-7-2. AB phase HSC [CNT_AB]	191
5-7-3. HSC reset [RST]	192

5-7-4. Read HSC value [DMOV]	192
5-7-5. Write HSC value [DMOV].....	193
5-7-6. The difference between HSC and normal counter	194
5-8. HSC EXAMPLE.....	195
5-7. HSC INTERRUPTION	197
5-7-1. Function overview and panel configuration	197
5-9-2. Single phase 100-segment HSC [CNT]	199
5-9-3. AB phase 100-segment HSC [CNT_AB]	200
5-9-4. Interruption flag of HSC	201
5-9-5. Setting value meaning in absolute or relative mode	202
5-9-6. HSC interruption cycle mode	205
5-9-7. CAM function of high speed counter interruption	206
5-9-8. Interruption using notes and parameter address	207
5-9-9. Application of HSC interruption	209
6 COMMUNICATION FUNCTION.....	215
6-1. SUMMARY	215
6-1-1. COM port.....	215
6-1-2. Communication parameters	223
6-2. MODBUS COMMUNICATION.....	223
6-2-1. Function overview	223
6-2-2. Changing of Modbus instruction	224
6-2-3. Modbus communication address	225
6-2-4. Modbus data format.....	232
6-2-5. Communication Instructions.....	238
6-2-6. Modbus serial port configuration.....	249
6-2-7. Modbus Communication application	253
6-2-8. Application	254
6-3. FREE COMMUNICATION	257
6-3-1. Free communication mode	257
6-3-2. Serial port configuration	258
6-3-3. Suitable occasion	260
6-3-4. Free communication instruction	260
6-3-5. Free communication example	264
6-4. COMMUNICATION FLAG AND REGISTER	270
6-5. READ WRITE SERIAL PORT PARAMETERS	273
6-5-1. Read serial port parameters [CFGCR]	273
6-5-2. Write serial port parameters [CFGCW]	274
6-5-3. Serial port parameter name and setting	275
7 PID CONTROL FUNCTION	277
7-1. PID INTRODUCTION	277
7-2. INSTRUCTION FORM	277
7-3. PARAMETERS SETTING	279
7-3-1. Register and their functions	281

7-3-2. <i>Parameters Description</i>	286
7-4. AUTO TUNE MODE	287
7-5. ADVANCED MODE	290
7-6. APPLICATION OUTLINES	291
7-7. APPLICATION	292
8 C LANGUAGE FUNCTION BLOCK	297
8-1. SUMMARY	297
8-2. INSTRUCTION FORMAT	297
8-3. OPERATION STEPS	298
8-4. IMPORT AND EXPORT THE FUNCTIONS	301
8-5. EDIT THE FUNC BLOCKS	303
8-6. PROGRAM EXAMPLE	304
8-7. APPLICATION NOTES	307
8-8. FUNCTION TABLE	308
9 SEQUENCE BLOCK	310
9-1. CONCEPT OF THE BLOCK	311
9-2. CALL THE BLOCK	312
9-2-1. <i>Add the BLOCK</i>	312
9-2-2. <i>Move the BLOCK</i>	314
9-2-3. <i>Delete the BLOCK</i>	315
9-2-4. <i>Modify the BLOCK</i>	316
9-3. EDIT THE INSTRUCTION OF THE BLOCK	317
9-3-1. <i>Command item</i>	317
9-3-2. <i>Pulse Item</i>	319
9-3-3. <i>Wait Item</i>	319
9-3-4. <i>Module Read and Write (FROM/TO) instruction</i>	320
9-4. RUNNING FORM OF THE BLOCK	321
9-5. BLOCK INSTRUCTION EDITING RULES	324
9-6. BLOCK RELATED INSTRUCTIONS	325
9-6-1. <i>Instruction explanation</i>	325
9-6-2. <i>The timing sequence of the instructions</i>	327
9-7. BLOCK FLAG BIT AND REGISTER	331
10 SPECIAL FUNCTION INSTRUCTIONS	332
10-1. PULSE WIDTH MODULATION [PWM]	332
10-2. FREQUENCY MEASUREMENT [FRQM]	335
10-3. PRECISE TIMING [STR]	339
10-4. INTERRUPTION [EI], [DI], [IRET]	345
10-4-1. <i>External Interruption</i>	346
10-4-2. TIMING INTERRUPTION	351
11 COMMON QUESTIONS AND ANSWERS	354
APPENDIX SPECIAL SOFT COMPONENTS	372

APPENDIX 1. SPECIAL AUXILIARY RELAY	372
APPENDIX 2. SPECIAL DATA REGISTER	378
APPENDIX 3. SPECIAL FLASH REGISTER	386
APPENDIX 4. PLC RESOURCE CONFLICT TABLE	389
APPENDIX 5. PLC FUNCTION CONFIGURATION LIST	390

1 Programming Summary

XD/XL series PLC accept the signal and execute the program in the controller, to fulfill the requirements of the users. This chapter introduces the PLC features, two kinds of programming language and etc.

1-1. PLC Features

Programming Language

XD/XL series PLC support two kinds of program language, instruction and ladder chart, the two kinds of language can convert to each other.

Security of the Program

To avoid the stolen or wrong modifying of user program, we encrypt the program. When uploading the encrypted program, it will check in the form of password. This can protect the user copyright; meanwhile, it limits the downloading, to avoid change program by mistake.

XD/XL series added new register FS. (For different XD/XL models, please check the Data monitor in XDPpro software for FS register range, common range is FS0~FS47). FS value can be modified but cannot be read through Modbus instruction. FS cannot be compared to register but only constant in XDPpro software. The value cannot be read. FS is used to protect the user's copyright. The register D, HD... can replace by FS.

Program comments

When the user program is too long, the comments of program and soft components are necessary in order to change the program easily later.

Offset Function

Add offset appendix (like X3[D100], M10[D100], D0[D100]) after coils, data registers can make indirect addressing. For example, when D100=9, X3[D100] =X[3+9]=X14; M10[D100]=M19, D0[D100]=D9

Rich Basic Functions

XD/XL series PLC has enough basic instructions including basic sequential control, data moving and comparing, arithmetic operation, logic control, data loop and shift etc. XD/XL series PLC also support interruption, high speed pulse, frequency testing, precise time, PID control and so on.

C Language Function Block

XD/XL series PLC support C language; users can call the C program in ladder chart. This function improves the programming efficiency.

Stop PLC when reboot

XD/XL series PLC support “Stop PLC when reboot” function. When there is a serious problem during PLC running, this method can stop all output immediately. Besides, if the COM port parameters are changed by mistake, this function can help PLC connect to the PC.

Communication Function

XD/XL series PLC has many communication modes, such as Modbus-RTU, Modbus-ASCII.

When the COM port parameters are changed, the new parameters will be valid immediately without restarting the PLC.

Wait time can be added before Modbus instructions.

1-2. Programming Language

1-2-1. Type

XD/XL series PLC support two types of programming language:

Instruction


Make the program with instructions directly, such as “LD”, “AND”, “OUT” etc. This is the basic input form of the programs, but it’s hard to read and understand;

E.g.: step instruction operand

0	LD	X000
1	OR	Y005
2	ANI	X002
3	OUT	Y005


Make sequential control graph with sequential control signal and soft components. This method is called “Ladder chart”. This method uses coils and contactors to represent sequential circuit. The ladder chart is easy to understand and can be used to monitor the PLC status online.

E.g.:



1-2-2. Alternation


The two kinds of programming language can be transformed to each other.



1-3. Programming mode

Direct Input

The two kinds of programming language can be input directly in the editing window. The ladder chart window has hint function which improves the programming efficiency greatly.



Instruction Configuration

Some instruction is complicated to use, like pulse output, PID etc. XDPPro software has the configuration window for these special instructions. User just needs to input parameters in the configuration window without remembering complicated instructions. The following window is multi section pulse output.

multi section pulse output

Data start address: D0	user params address: D100	System params: K1	Output: Y0
Mode: relative	Start execute section count: 0	Pulse Config	

... Add Delete Upwards Downwards

frequency	pulse count	wait condition	wait register	jump register

used space: Read From PLC Write To PLC OK Cancel

For the details of instruction configuration, please refer to XD/XL series PLC user manual 【software part】 .

~~2 Soft Component Function~~

In chapter 1, we briefly introduce the programming language. However, the most important element in a program is the operands. These elements include the relays and registers. In this chapter, we will describe the functions and using methods of these relays and registers.

2-1. Summary of the Soft Components

There are many relays, timers and counters inside PLC. They all have countless NO (Normally ON) and NC (Normally Closed) contactors. Connect these contactors with the coils will make a sequential control circuit. Next we will introduce these soft components.

Input Relay (X)

- The functions of input relays

The input relays are used to receive the external ON/OFF signal, the sign is **X**.

- Address Assignment Principle
 - In each basic unit, X address is in the form of octal, such as X0~X7, X10~X17 ...
 - The extension module address: module 1 starts from X10000, module 2 starts from X10100... XD1/XD2/XL1 cannot support extension module. Up to 10 extension modules can be connected to the XD3/XL3 main unit. XD5/XDM/XDC/XD5E/XDME/XL5/XL5E/XLME can connect 16 extension modules.
 - Extension BD board: BD 1 starts from X20000; The 24-32 points PLC can connect one extended BD board and the 48-60 points PLC can connect two extended BD boards. (16-point PLC does not support extended BD board, XL series does not

support extended BD board.)

- The address number of the left extended ED module, starting from X30000 according to octal system, XD/XL series PLC supports a left extended I/O ED module.

- Using notes

The digital filter is used in the input filter of the input relay. Users can change the filter parameters by setting the special register SFD0, default value is 10ms, modification range: 0 ~ 1000ms.

There are enough input relays in the PLC. The input relay whose address is more than input points can be seemed to auxiliary relay.

Output Relay (Y)

- Function of the output relays

Output relays are the interface to drive the external loads, the sign is **Y**;

- Address Assignment Principle

In each basic unit, Y address is in the form of octal, such as Y0~Y7, Y10~Y17 ...

The extension module address: module 1 starts from Y10000, module 2 starts from Y10100...

XD1/XD2/XL1 does not support extension modules, XD3/XL3 can accept 10 extension modules, XD5/XDM/XDC/XD5E/XDME/XL5/XL5E/XLME can accept 16 extension modules.

Expanding the address number of BD board, starting from X20000 according to octal system, 24-32 points PLC can extend one BD board, 48-60 points PLC can extend two BD boards. (16-point PLC does not support extended BD board, XL series does not support extended BD board.)

The address number of the left extended ED module, starting from Y30000 according to octal system, XD/XL series PLC supports a left extended input and output ED module.

Using notes

There are enough output relays in the PLC. The output relay whose address is more than output points can be seemed to auxiliary relay.

Auxiliary Relays (M, HM)

- Function of Auxiliary Relays

Auxiliary relays is internal relays of PLC, the sign is M and HM;

- Address assignment principle

In basic units, assign the auxiliary address in decimal form

- Using notes

This type of relays are different from the input/output relays, they can't drive external load and receive external signal, but only be used in the program;

Retentive relays can keep its ON/OFF status when PLC power OFF;

Status Relays (S, HS)

- Function of status relays

Used as relays in Ladder, the sign is S, HS.

- Address assignment principle

In basic units, assign the address in decimal form.

- Using notes

If it is not used as operation number, they can be used as auxiliary relays, programming as normal contactors/coils. Besides, they can be used as signal alarms, for external diagnose.

Timer (T, HT)

- Function of the timers

Timers are used to accumulate the time pulse like 1ms, 10ms, 100ms etc. when reach the set value, the output contactors acts, represent sign is T and HT.

- Address assignment principle

In basic units, assign the timer address in decimal form. Please refer to chapter 2-2 for details.

- Time pulse

There are three timer pulses: 1ms, 10ms, and 100ms. For example, 10ms means accumulate 10ms pulses.

- Accumulation/not accumulation

The timer has two modes: accumulation timer means even the timer drive coil is OFF, the timer will still keep the current value; while the not accumulation timer means when the accumulation value reaches the set value, the output acts, the accumulation value reset to 0.

Counter (C, HC)

According to different application purposes, the counters contain different types:

- For internal counting (for general using/power off retentive usage)

16 bits counter: for increment count, the count range is 1~32,767

32 bits counter: for increment count, the count range is 1~2,147,483,647

These counters are for PLC internal signal. The response speed is one scan cycle or longer.

- For High Speed Counting (Power-off retentive)

32 bits counter: the count range is -2,147,483,648~ +2,147,483,647

(Single phase increment count, AB phase count). For special input terminals.

The high speed counter will not be affected by PLC scanning period. For increment mode, it can count max 80KHz pulses; for AB phase mode, it can count max 50KHz pulses.

- Address assignment principle

In basic units, assign the timer address in decimal form.

Data Register (D, HD)

- Function of Data Registers

Data Registers are used to store data, the sign is D and HD.

- Address assignment principle

The data registers in XD/XL series PLC are 16 bits (the highest bit is sign bit), combine two data registers together is for 32 bits (the highest bit is sign bit) data processing.

- Using notes

Same to other soft components, data registers also have common type and power-off retentive type.

FlashROM Register (FD)

- Function of FlashROM registers

FlashROM registers are used to store data, the sign is FD.

- Address assignment principle

In basic units, FlashROM registers address is in form of decimal;

- Using notes

Even the battery powered off, this area can remember the data. So this area can store important parameters. FlashROM can be written for about 1,000,000 times, and it takes time when writing. Frequently writing can cause permanent damage for FD.

Special secret Register (FS)

- The Function of Secret Register

A part of the FlashROM register is used to store data in soft components, which are represented by the symbol FS. The values in the FS register can be written but can not be read, so they can be used to protect the intellectual property rights of users.

- Address Allocation Principle

In the basic unit, FS registers are addressed in decimal numbers.

- Since the number of FS registers of different types of PLC may be different, please refer to the "PLC Initial Settings" shown in the online PLC software, generally FS0-FS47.
- Attention Points in Use

The storage area can remember data even if the battery is powered down, so it can be used to store important process parameters. FS can be written about 1,000,000 times, and it takes more time to write each time. Frequent writing will cause permanent damage to FS, so it is not recommended that users write frequently. When using MOV instruction to transmit data to FS, the rising edge is valid.

- The value of the soft element can be set arbitrarily in the FS register, but the value of the register can not be read (always returned to 0); and it can not be compared with the register in the PLC software, only with the constant, so the actual value of the register can not be read.

Constant (B) (K) (H)

B means Binary, K represents Decimal, H represents Hexadecimal. They are used to set timers and counters value, or operands of application instructions. For example hex FF will be HFF.

2-2. Structure of Soft Components

2-2-1. Structure of Memory

In XD/XL series PLC, there are many registers. Besides D, HD, FlashROM registers, we can also combine bit to register.

Data Register D, HD

For common use, 16 bits


For common use, 32 bits (combine two continuous 16-bits registers)

For power off retentive use, cannot modify the retentive range

For special use, occupied by the system, can't be used to common instruction parameters

For offset use (indirect assignment)

Form: Dn[Dm], HDn[Dm], Xn[Dm], Yn[Dm], Mn[Dm], etc.



When D0=0, D100=D10, Y0 is ON.

When M2 turns from OFF to ON, D0=5, then D100=D15, Y5 is ON.

Therein, D10[D0]=D[10+D0], Y0[D0]=Y[0+D0].

The word offset combined by bit: DXn[Dm] represents DX[n+Dm].

The soft components with offset, the offset can represent by soft component D, HD.


Timer T, HT/Counter C, HC

For common usage, 16 bits, represent the current value of timer/counter;

For common usage, 32 bits, (combine two continuous 16 bits registers)

To represent them, just use the letter+address method, such as T10, C11, HT10, HC11.

E.g.



In the above example, MOV T11 D0, T11 represents word register;
LD T11, T11 represents bit register.

FlashROM Register FD

For power off retentive usage, 16 bits

For power off retentive usage, 32 bits, (combine two continuous 16 bits registers)

For special usage, occupied by the system, can't be used as common instruction parameters

Register combined by bits

For common usage, 16 bits, (combine 16 bits)


The soft components which can be combined to words are: X, Y, M, S, T, C, HM, HS, HT, HC.

Format: add "D" in front of soft components, like DM10, represents a 16-bits register from M10~M25

Get 16 bits beginning from DXn, cannot beyond the soft components range;

The word combined by bits cannot do bit addressing;

E.g.:



When M0 changes from OFF to ON, the value in the word which is combined by Y0~Y17 equals to 21, i.e. Y0, Y2, Y4 become ON.

Before M1 activates, if D0=0, DX2[D0] represents a word combined by X2~X21.

If M1 changes from OFF to ON, D0=3, then DX2[D0] represents a word combined by X5~X24.

2-2-2. Structure of Bit Soft Components

Bit soft components include X, Y, M, S, T, C, HM, HS, HT, HC. Besides, the bit of the register also can be used as bit soft component.

Relay

Input Relay X, octal form

Output Relay Y, octal form

Auxiliary Relay M, HM, S, HS; decimal form

Auxiliary Relay T, HT, C, HC, decimal form. The represent method is same to registers, so we need to judge if it's word register or bit register according to the instruction.

The Bit of register


Composed by bit of register, support register D

Represent method: Dn.m ($0 \leq m \leq 15$): for example D10.2 means the second bit of D10

The represent method of bit with offset: Dn[Dm].x

Bit of register can't compose to word soft component again;

E.g.:



D0.4 means when the fourth bit of D0 is 1, set Y0 ON.

D5[D1].4 means bit addressing with offset, if D1=5, then D5[D1] means the fourth bit of D10

2-3. Soft Components List

2-3-1. Soft Components List

XD1 series PLC soft components list:

	Name	Range		Points	
		16 I/O	32 I/O	16	32
X	Input points	X0~X7	X0~X17	8	16
Y	Output points	Y0~Y7	Y0~Y17	8	16
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11100 ~ X11177 (#10 expansion module)		640	
Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11100 ~ Y11177 (#10 expansion module)		640	

X	Input points ※4	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)	128
Y	Output points ※4	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)	128
X	Input points ※5	X30000 ~ X30077 (#1 expansion ED)	64
Y	Output points ※5	Y30000 ~ Y30077 (#1 expansion ED)	64
M	Internal relay	M0~M7999	8000
HM		HM0~HM959※1	960
SM		Special purpose SM0~SM2047※2	2048
S	Flow	S0~S1023	1024
HS		HS0~HS127※1	128
T	Timer	T0~T575	576
HT		HT0~HT95※1	96
ET		Precise timer ET0~ET31	32
C	Counter	C0~C575	576
HC		HC0~HC95※1	96
HSC		High speed counter HSC0~HSC31	32
D	Data register	D0~D7999	8000
HD		HD0~HD999※1	1000
SD		Special purpose SD0~SD2047	2048
HSD		Special purpose HSD0~HSD499※2	500
FD	FlashROM	FD0~FD5119	5120
SFD	register	Special purpose SFD0~SFD1999※2	2000
FS	Special register	secret FS0~FS47	48
ID※6	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID10900 ~ ID10999 (#10 expansion module)	1000
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
	Main body	QD0~QD99	100

QD※ 7	Expansion module	QD10000 ~ QD10099 (#1 expansion module) QD10900 ~ QD10999 (#10 expansion module)	1000
	expansion BD	QD20000 ~ QD20099 (#1 expansion BD) QD20100 ~ QD20199 (#2 expansion BD)	200
	expansion ED	QD30000 ~ QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM31	32

XD2 series PLC soft components list:

	Name	Range					Points				
		16 I/O	24 I/O	32 I/O	48 I/O	60 I/O	16	24	32	48	60
X	Input points	X0~X7	X0~X15	X0~X21	X0~X33	X0~X43	38	14	18	28	36
Y	Output points	Y0~Y7	Y0~Y11	Y0~Y15	Y0~Y23	Y0~Y27	8	10	14	20	24
X	Input points※3	X10000 ~ X10077 (#1 expansion module) X11100 ~ X11177 (#10 expansion module)					640				
Y	Output points※3	Y10000 ~ Y10077 (#1 expansion module) Y11100 ~ Y11177 (#10 expansion module)					640				
X	Input points ※4	X20000~X20077 (#1 expansion BD) X20100~X20177 (#2 expansion BD)					128				
Y	Output points ※4	Y20000~Y20077 (#1 expansion BD) Y20100~Y20177 (#2 expansion BD)					128				
X	Input points※5	X30000~X30077 (#1 expansion ED)					64				
Y	Output points※5	Y30000~Y30077 (#1 expansion ED)					64				
M	Internal relay	M0~M7999					8000				
HM		HM0~HM959※1					960				
SM		Special purpose SM0~SM2047※2					2048				
S	Flow	S0~S1023					1024				
HS		HS0~HS127※1					128				
T	Timer	T0~T575					576				
HT		HT0~HT95※1					96				
ET		Precise timer ET0~ET31					32				
C	Counter	C0~C575					576				
HC		HC0~HC95※1					96				
HSC		High speed counter HSC0~HSC31					32				
D	Data register	D0~D7999					8000				

HD		HD0~HD999 ^{※1}	1000
SD		Special purpose SD0~SD2047	2048
HSD		Special purpose HSD0~HSD499 ^{※2}	500
FD	FlashROM	FD0~FD5119	5120
SFD	register	Special purpose SFD0~SFD1999 ^{※2}	2000
FS	Special secret register	FS0~FS47	48
ID ^{※6}	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID10900 ~ ID10999 (#10 expansion module)	1000
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD ^{※7}	Main body	QD0~QD99	100
	Expansion module	QD10000 ~ QD10099 (#1 expansion module) QD10900 ~ QD10999 (#10 expansion module)	1000
	expansion BD	QD20000 ~ QD20099 (#1 expansion BD) QD20100 ~ QD20199 (#2 expansion BD)	200
	expansion ED	QD30000 ~ QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM31	32

XD3 series PLC soft components list:

	Name	Range					Points				
		16 I/O	24 I/O	32 I/O	48 I/O	60 I/O	16	24	32	48	60
X	Input points	X0~X7	X0~X15	X0~X21	X0~X33	X0~X43	8	14	18	28	36
Y	Output points	Y0~Y7	Y0~Y11	Y0~Y15	Y0~Y23	Y0~Y27	8	10	14	20	24
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11100 ~ X11177 (#10 expansion module)					640				

Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11100 ~ Y11177 (#10 expansion module)	640
X	Input points ^{※4}	X20000~X20077 (#1 expansion BD) X20100~X20177 (#2 expansion BD)	128
Y	Output points ^{※4}	Y20000~Y20077 (#1 expansion BD) Y20100~Y20177 (#2 expansion BD)	128
X	Input points ^{※5}	X30000~X30077 (#1 expansion ED)	64
Y	Output points ^{※5}	Y30000~Y30077 (#1 expansion ED)	64
M	Internal relay	M0~M7999	8000
HM		HM0~HM959 ^{※1}	960
SM		special purpose SM0~SM2047 ^{※2}	2048
S	Flow	S0~S1023	1024
HS		HS0~HS127 ^{※1}	128
T	Timer	T0~T575	576
HT		HT0~HT95 ^{※1}	96
ET		precise timer ET0~ET31	32
C	Counter	C0~C575	576
HC		HC0~HC95 ^{※1}	96
HSC		high speed counter HSC0~HSC31	32
D	Data register	D0~D7999	8000
HD		HD0~HD999 ^{※1}	1000
SD		special purpose SD0~SD2047	2048
HSD		special purpose HSD0~HSD499 ^{※2}	500
FD	FlashROM register	FD0~FD5119	5120
SFD		special purpose SFD0~SFD1999 ^{※2}	2000
FS	Special secret register	FS0~FS47	48
ID ^{※6}	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID10900 ~ ID10999 (#10 expansion module)	1000
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1expansion ED)	100
QD ^{※7}	Main body	QD0~QD99	100
	Expansion module	QD10000 ~ QD10099 (#1 expansion module) QD10900~QD10999 (#10 expansion module)	1000

	expansion BD	QD20000 ~ QD20099 (#1 expansion BD) QD20100 ~ QD20199 (#2 expansion BD)	200
	expansion ED	QD30000 ~ QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM31	32

XD5 series PLC soft components list:

	Name	Range				Points			
		24 I/O	32 I/O	48 I/O	60 I/O	24	32	48	60
X	Input points	X0~X15	X0~X21	X0~X33	X0~X43	14	18	28	36
Y	Output points	Y0~Y11	Y0~Y15	Y0~Y23	Y0~Y27	10	14	20	24
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11700 ~ X11777 (#16 expansion module)				1024			
Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11700 ~ Y11777 (#16 expansion module)				1024			
X	Input points ^{※4}	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)				192			
Y	Output points ^{※4}	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)				192			
X	Input points ^{※5}	X30000 ~ X30077 (#1 expansion ED)				64			
Y	Output points ^{※5}	Y30000 ~ Y30077 (#1 expansion ED)				64			
M	Internal relay	M0~M69999				70000			
HM		HM0~HM11999 ^{※1}				12000			
SM		special purpose SM0~SM4999 ^{※2}				5000			
S	Flow	S0~S7999				8000			
HS		HS0~HS999 ^{※1}				1000			
T	Timer	T0~T4999				5000			
HT		HT0~HT1999 ^{※1}				2000			
ET		precise timer ET0~ET39				40			
C	Counter	C0~C4999				5000			
HC		HC0~HC1999 ^{※1}				2000			
HSC		high speed counter HSC0~HSC39				40			

D	Data register	D0~D69999 (firmware V3.5.3 and up)	70000
		D0~D59999 (firmware V3.5.2 and down)	60000
		HD0~HD24999 ^{*1}	25000
		special purpose SD0~SD4999	5000
HD		special purpose HSD0~HSD1023 ^{*2}	1024
SD			
HSD			
FD	FlashROM	FD0~FD8191	8192
SFD	Register	special purpose SFD0~SFD5999 ^{*2}	6000
FS	Special secret register	FS0~FS47	48
ID ^{*6}	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID11500 ~ ID11599 (#16 expansion module)	1600
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD ^{*7}	Main body	QD0~QD99	100
	Expansion module	QD10000~QD10099 (#1 expansion module) QD11500 ~ QD11599 (#16 expansion module)	1600
	expansion BD	QD20000~QD20099 (#1 expansion BD) QD20100~QD20199 (#2 expansion BD)	200
	expansion ED	QD30000~QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM127	128

XDM series PLC soft components list:

	Name	Range			Points		
		24 I/O	32 I/O	60 I/O	24	32	60
X	Input points	X0~X15	X0~X21	X0~X43	14	18	36
Y	Output points	Y0~Y11	Y0~Y15	Y0~Y27	10	14	24
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11700 ~ X11777 (#16 expansion module)			1024		
Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11700 ~ Y11777 (#16 expansion module)			1024		
X	Input points ^{※4}	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)			128		
Y	Output points ^{※4}	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)			128		
X	Input points ^{※5}	X30000 ~ X30077 (#1 expansion ED)			64		
Y	Output points ^{※5}	Y30000 ~ Y30077 (#1 expansion ED)			64		
M	Internal relay	M0~M69999			70000		
HM		HM0~HM11999 ^{※1}			12000		
SM		special purpose SM0~SM4999 ^{※2}			5000		
S	Flow	S0~S7999			8000		
HS		HS0~HS999 ^{※1}			1000		
T	Timer	T0~T4999			5000		
HT		HT0~HT1999 ^{※1}			2000		
ET		precise timer ET0~ET39			40		
C		C0~C4999			5000		
HC	Counter	HC0~HC1999 ^{※1}			2000		
HSC		high speed counter HSC0~HSC39			40		
D	Data register	D0~D69999			70000		
HD		HD0~HD24999 ^{※1}			25000		
SD		special purpose SD0~SD4999			5000		
HSD		special purpose HSD0~HSD1023 ^{※2}			1024		
FD	FlashROM	FD0~FD8191			8192		
SFD	register	special purpose SFD0~SFD5999 ^{※2}			6000		
FS	Special register	FS0~FS47			48		
ID ^{※6}	Main body	ID0~ID99			100		

	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID11500 ~ ID11599 (#16 expansion module)	1600
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD ※ 7	Main body	QD0~QD99	100
	Expansion module	QD10000~QD10099 (#1 expansion module) QD11500 ~ QD11599 (#16 expansion module)	1600
	expansion BD	QD20000~QD20099 (#1 expansion BD) QD20100~QD20199 (#2 expansion BD)	200
	expansion ED	QD30000~QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM127	128

XDC series PLC soft components list:

	Name	Range				Points			
		24 I/O	32 I/O	48 I/O	60 I/O	24	32	48	60
X	Input points	X0~X15	X0~X21	X0~X33	X0~X43	14	18	28	36
Y	Output points	Y0~Y11	Y0~Y15	Y0~Y23	Y0~Y27	10	14	20	24
X	Input points※3	X10000 ~ X10077 (#1 expansion module) X11700 ~ X11777 (#16 expansion module)				1024			
Y	Output points※3	Y10000 ~ Y10077 (#1 expansion module) Y11700 ~ Y11777 (#16 expansion module)				1024			
X	Input points ※4	X20000~X20077 (#1 expansion BD) X20100~X20177 (#2 expansion BD)				128			
Y	Output points ※4	Y20000~Y20077 (#1 expansion BD) Y20100~Y20177 (#2 expansion BD)				128			
X	Input points※5	X30000~X30077 (#1 expansion ED)				64			

Y	Output points ^{※5}	Y30000~Y30077 (#1 expansion ED)	64
M	Internal relay	M0~M69999	70000
HM		HM0~HM11999 ^{※1}	12000
SM		special purpose SM0~SM4999 ^{※2}	5000
S		S0~S7999	8000
HS	Flow	HS0~HS999 ^{※1}	1000
T	Timer	T0~T4999	5000
HT		HT0~HT1999 ^{※1}	2000
ET		precise timer ET0~ET39	40
C	Counter	C0~C4999	5000
HC		HC0~HC1999 ^{※1}	2000
HSC		high speed counter HSC0~HSC39	40
D	Data register	D0~D69999	70000
HD		HD0~HD24999 ^{※1}	25000
SD		special purpose SD0~SD4999	5000
HSD		special purpose HSD0~HSD1023 ^{※2}	1024
FD	FlashROM	FD0~FD8191	8192
SFD	register	special purpose SFD0~SFD5999 ^{※2}	6000
FS	Special secret register	FS0~FS47	48
ID ^{※6}	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID11500 ~ ID11599 (#16 expansion module)	1600
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD ^{※7}	Main body	QD0~QD99	100
	Expansion module	QD10000 ~ QD10099 (#1 expansion module) QD11500 ~ QD11599 (#16 expansion module)	1600
	expansion BD	QD20000 ~ QD20099 (#1 expansion BD) QD20100 ~ QD20199 (#2 expansion BD)	200
	expansion ED	QD30000 ~ QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM127	128

XD5E series PLC soft components list:

	Name	Range		Points	
		30 I/O	60 I/O	30	60
X	Input points	X0~X17	X0~X43	16	36
Y	Output points	Y0~Y15	Y0~Y27	14	24
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11700 ~ X11777 (#16 expansion module)		1024	
Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11700 ~ Y11777 (#16 expansion module)		1024	
X	Input points ^{※4}	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)		128	
Y	Output points ^{※4}	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)		128	
X	Input points ^{※5}	X30000 ~ X30077 (#1 expansion ED)		64	
Y	Output points ^{※5}	Y30000 ~ Y30077 (#1 expansion ED)		64	
M	Internal relay	M0~M69999		70000	
HM		HM0~HM1999 ^{※1}		12000	
SM		special purpose SM0~SM4999 ^{※2}		5000	
S	Flow	S0~S7999		8000	
HS		HS0~HS999 ^{※1}		1000	
T	Timer	T0~T4999		5000	
HT		HT0~HT1999 ^{※1}		2000	
ET		precise timer ET0~ET39		40	
C	Counter	C0~C4999		5000	
HC		HC0~HC1999 ^{※1}		2000	
HSC		high speed counter HSC0~HSC39		40	
D	Data register	D0~D69999		70000	
HD		HD0~HD24999 ^{※1}		25000	
SD		special purpose SD0~SD4999		5000	

HSD		special purpose HSD0~HSD1023 ^{※2}	1024
FD	FlashROM	FD0~FD8191	8192
SFD	register	special purpose SFD0~SFD5999 ^{※2}	6000
FS	Special secret register	FS0~FS47	48
ID ^{※6}	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID11500 ~ ID11599 (#16 expansion module)	1600
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD ^{※7}	Main body	QD0~QD99	100
	Expansion module	QD10000~QD10099 (#1 expansion module) QD11500 ~ QD11599 (#16 expansion module)	1600
	expansion BD	QD20000~QD20099 (#1 expansion BD) QD20100~QD20199 (#2 expansion BD)	200
	expansion ED	QD30000~QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM127	128

XDME series PLC soft components list:

	Name	Range	Points
		60 I/O	60
X	Input points	X0~X43	36
Y	Output points	Y0~Y27	24
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11700 ~ X11777 (#16 expansion module)	1024

Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11700 ~ Y11777 (#16 expansion module)	1024
X	Input points ^{※4}	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)	128
Y	Output points ^{※4}	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)	128
X	Input points ^{※5}	X30000 ~ X30077 (#1 expansion ED)	64
Y	Output points ^{※5}	Y30000 ~ Y30077 (#1 expansion ED)	64
M	Internal relay	M0~M69999	70000
HM		HM0~HM11999 ^{※1}	12000
SM		special purpose SM0~SM4999 ^{※2}	5000
S	Flow	S0~S7999	8000
HS		HS0~HS999 ^{※1}	1000
T	Timer	T0~T4999	5000
HT		HT0~HT1999 ^{※1}	2000
ET		precise timer ET0~ET39	40
C	Counter	C0~C4999	5000
HC		HC0~HC1999 ^{※1}	2000
HSC		high speed counter HSC0~HSC39	40
D	Data register	D0~D69999	70000
HD		HD0~HD24999 ^{※1}	25000
SD		special purpose SD0~SD4999	5000
HSD		special purpose HSD0~HSD1023 ^{※2}	1024
FD	FlashROM register	FD0~FD8191	8192
SFD		special purpose SFD0~SFD5999 ^{※2}	6000
FS	Special secret register	FS0~FS47	48
ID ^{※6}	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID11500 ~ ID11599 (#16 expansion module)	1600
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100

QD ※ 7	Main body	QD0~QD99	100
	Expansion module	QD10000~QD10099 (#1 expansion module) QD11500 ~ QD11599 (#16 expansion module)	1600
	expansion BD	QD20000~QD20099 (#1 expansion BD) QD20100~QD20199 (#2 expansion BD)	200
	expansion ED	QD30000~QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM127	128

XL1, XL3 series PLC soft components list:

	Name	Range	Points
		16 I/O	16
X	Input points	X0~X7	8
Y	Output points	Y0~Y7	8
X	Input points※ ³	X10000 ~ X10077 (#1 expansion module) X11100 ~ X11177 (#10 expansion module)	640
Y	Output points※ ³	Y10000 ~ Y10077 (#1 expansion module) Y11100 ~ Y11177 (#10 expansion module)	640
X	Input points※ ⁴	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)	128

Y	Output points※4	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)	128
X	Input points※5	X30000 ~ X30077 (#1 expansion ED)	64
Y	Output points※5	Y30000 ~ Y30077 (#1 expansion ED)	64
M	Internal relay	M0~M7999	8000
HM		HM0~HM959※1	960
SM		special purpose SM0~SM2047※2	2048
S	Flow	S0~S1023	1024
HS		HS0~HS127※1	128
T	Timer	T0~T575	576
HT		HT0~HT95※1	96
ET		precise timer ET0~ET31	32
C	Counter	C0~C575	576
HC		HC0~HC95※1	96
HSC		high speed counter HSC0~HSC31	32
D	Data register	D0~D7999	8000
HD		HD0~HD999※1	1000
SD		special purpose SD0~SD2047	2048
HSD		special purpose HSD0~HSD499※2	500
FD	FlashROM register	FD0~FD5119	5120
SFD		special purpose SFD0~SFD1999※2	2000
FS	Special secret register	FS0~FS47	48
ID※6	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID10900 ~ ID10999 (#10 expansion module)	1000
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD※7	Main body	QD0~QD99	100
	Expansion module	QD10000~QD10099 (#1 expansion module) QD10900 ~ QD10999 (#10 expansion module)	1000

	expansion BD	QD20000~QD20099 (#1 expansion BD) QD20100~QD20199 (#2 expansion BD)	200
	expansion ED	QD30000~QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM31	32

XL5, XL5E, XLME series PLC soft components list:

	Name	Range	Points
		32 I/O	32
X	Input points	X0~X17	16
Y	Output points	Y0~Y17	16
X	Input points ^{※3}	X10000 ~ X10077 (#1 expansion module) X11700 ~ X11777 (#16 expansion module)	1024
Y	Output points ^{※3}	Y10000 ~ Y10077 (#1 expansion module) Y11700 ~ Y11777 (#16 expansion module)	1024
X	Input points ^{※4}	X20000 ~ X20077 (#1 expansion BD) X20100 ~ X20177 (#2 expansion BD)	192
Y	Output points ^{※4}	Y20000 ~ Y20077 (#1 expansion BD) Y20100 ~ Y20177 (#2 expansion BD)	192
X	Input points ^{※5}	X30000 ~ X30077 (#1 expansion ED)	64
Y	Output points ^{※5}	Y30000 ~ Y30077 (#1 expansion ED)	64
M	Internal relay	M0~M69999	70000
HM		HM0~HM11999 ^{※1}	12000
SM		special purpose SM0~SM4999 ^{※2}	5000
S	Flow	S0~S7999	8000
HS		HS0~HS999 ^{※1}	1000
T	Timer	T0~T4999	5000
HT		HT0~HT1999 ^{※1}	2000
ET		precise timer ET0~ET39	40

C		C0~C4999	5000
HC	Counter	HC0~HC1999※1	2000
HSC		high speed counter HSC0~HSC39	40
D		D0~D69999	70000
HD	Data register	HD0~HD24999※1	25000
SD		special purpose SD0~SD4999	5000
HSD		special purpose HSD0~HSD1023※2	1024
FD	FlashROM	FD0~FD8191	8192
SFD	register	special purpose SFD0~SFD5999※2	6000
FS	Special secret register	FS0~FS47	48
ID※6	Main body	ID0~ID99	100
	Expansion module	ID10000 ~ ID10099 (#1 expansion module) ID11500 ~ ID11599 (#16 expansion module)	1600
	expansion BD	ID20000 ~ ID20099 (#1 expansion BD) ID20100 ~ ID20199 (#2 expansion BD)	200
	expansion ED	ID30000 ~ ID30099 (#1 expansion ED)	100
QD※7	Main body	QD0~QD99	100
	Expansion module	QD10000~QD10099 (#1 expansion module) QD11500 ~ QD11599 (#16 expansion module)	1600
	expansion BD	QD20000~QD20099 (#1 expansion BD) QD20100~QD20199 (#2 expansion BD)	200
	expansion ED	QD30000~QD30099 (#1 expansion ED)	100
SEM	Special coil of Sequence block instruction WAIT	SEM0~SEM127	128

※1: 【】 Memory area is the default power outage holding area (Note: XD/XL series PLC power outage holding area can not be modified).

※2: Special use (non-power-down maintenance) refers to registers for special use occupied by the system, which can not be used for other purposes. For details, refer to the relevant sections of the List of Special Soft Components in the appendix of this manual.

※3: I/O address assignment (octal) of the extended module, which can be used as intermediate relay when the extension module is not connected. (XL1/XD1/XD2 does

not support extension modules, XD3/XL3 can expand up to 10 at the same time, XD5/XDM/XDC/XD5E/XDME/XL5/XL5E/XLME can expand up to 16 at the same time)

※4: Extended BD I/O address allocation (octal), can be used as intermediate relay when not connected to BD. (24/32/30 points can be extended up to 1, 48/60 points can be extended up to 2, 16 points do not support extended BD, XL series does not support extended BD)

※5: Extended ED I/O address allocation (octal), can be used as intermediate relay when not connected to ED. (XD/XL series can extend up to one ED module)

※6: Analog input soft component address, can be used as auxiliary register when not connected to extended equipment.

※7: Analog output soft component address, can be used as auxiliary registers when not connected to extended devices.

※8: The range of soft components mentioned above is the valid range of PLC in X-NET communication mode. In MODBUS communication mode, some relays can not read and write. The specific usable range is shown in chapter 6-2-3.

2-4. Input/output relays (X, Y)

Number List

XD/XL series PLC input/output are all in octal form, each series numbers are listed below:

Series	Name	Range		Points	
		16 I/O	32 I/O	16	32
XD1	X	X0~X7	X0~X17	8	16
	Y	Y0~Y7	Y0~Y17	8	16

Series	Name	Range					Points				
		16 I/O	24 I/O	32 I/O	48 I/O	60 I/O	16	24	32	48	60
XD2	X	X0~X7	X0~X15	X0~X21	X0~X33	X0~X43	8	14	18	28	36
XD3											
XD5	Y	Y0~Y7	Y0~Y11	Y0~Y15	Y0~Y23	Y0~Y27	8	10	14	20	24

Series	Name	Range			Points		
		24 I/O	32 I/O	60 I/O	24	32	60
XDM	X	X0~X15	X0~X21	X0~X43	14	18	36
	Y	Y0~Y11	Y0~Y15	Y0~Y27	10	14	24


Series	Name	Range				Points			
		24 I/O	32 I/O	48 I/O	60 I/O	24	32	48	60
XDC	X	X0~X15	X0~X21	X0~X33	X0~X43	14	18	28	36
	Y	Y0~Y11	Y0~Y15	Y0~Y23	Y0~Y27	10	14	20	24

Series	Name	Range		Points	
		30 I/O	60 I/O	30	60
XD5E	X	X0~X17	X0~X43	16	36
	Y	Y0~Y15	Y0~Y27	14	24

Series	Name	Range	Points
		60 I/O	60
XDME	X	X0~X43	36
	Y	Y0~Y27	24

Series	Name	Range	Points
		16 I/O	16
XL1	X	X0~X7	8
XL3	Y	Y0~Y7	8

Series	Name	Range	Points
		32 I/O	32
XL5	X	X0~X17	16
XL5E			
XLME	Y	Y0~Y17	16

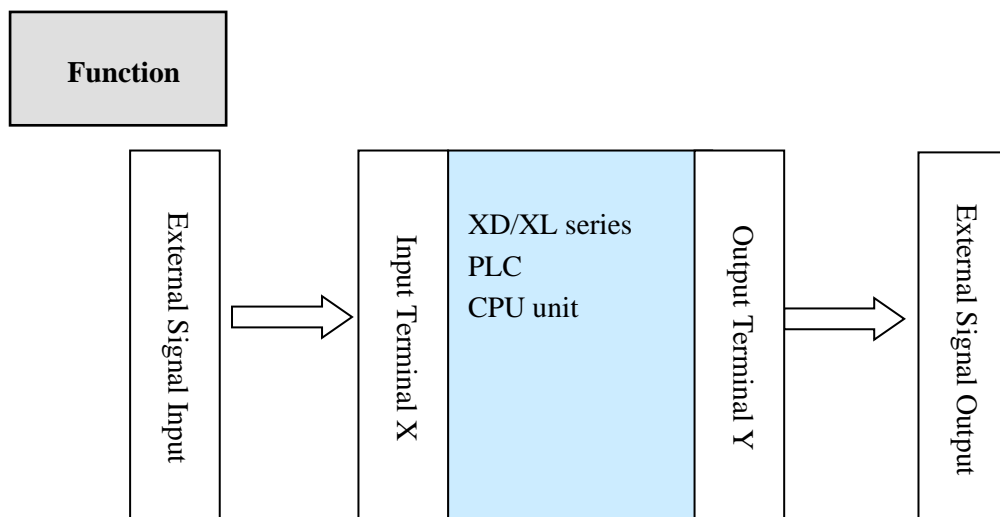

Input Relay X

PLC input terminals are used to receive the external signal. The input relays are optocouplers to connect PLC and input terminals.


The input relays which are not connected with external devices can be seen as fast internal relays.

Output Relay Y

PLC output terminals can be used to send signals to external loads. Inside the PLC, the output relay's external output contactors (including relay contactors, transistor contactors) connect with output terminals.

The output relays which are not connected with external devices can be seen as fast internal relays.

Execution Order



Input processing

Before the PLC executes the program, it reads every input terminal's ON/OFF status into the image area.

When the program is running, even if the input changes, the content in the input image area will not change until the next scanning period comes.

Output processing

After running all the instructions, it transfers the ON/OFF status of the output Y image area to the output lock memory area. This will be the actual output of the PLC.

The output contactors will delay the action according to the output soft component's response.

2-5. Auxiliary Relay (M, HM, SM)

Number List

The auxiliary relays in XD/XL series PLC are all in decimal form, please see the following table:

Series	Name	Range		
		Normal	Power-off holding	Special
XD1	M	M0~M7999	HM0-HM959	SM0~SM2047
XD2		M0~M7999	HM0-HM959	SM0~SM2047
XD3		M0~M7999	HM0-HM959	SM0~SM2047
XD5		M0~M69999	HM0-HM11999	SM0~SM4999
XDM		M0~M69999	HM0-HM11999	SM0~SM4999
XDC		M0~M69999	HM0-HM11999	SM0~SM4999
XD5E		M0~M69999	HM0-HM11999	SM0~SM4999
XDME		M0~M69999	HM0-HM11999	SM0~SM4999
XL1		M0~M7999	HM0-HM959	SM0~SM2047
XL3		M0~M7999	HM0-HM959	SM0~SM2047
XL5		M0~M69999	HM0-HM11999	SM0~SM4999
XL5E		M0~M69999	HM0-HM11999	SM0~SM4999
XLME		M0~M69999	HM0-HM11999	SM0~SM4999

In PLC, auxiliary relays are used frequently. This type of relay's coil is same to the output relay. They are driven by soft components in PLC;

Auxiliary relays M and HM have countless normally ON/OFF contactors. They can be used freely, but this type of contactors can't drive the external loads.

- For common use

This type of auxiliary relays can be used only as normal auxiliary relays. I.e. if power supply suddenly shut down during the running, the relays will be off.

Common usage relays can't be used for power off retentive, but the zone can be modified;

- For Power Off Retentive Use

The auxiliary relays for power off retentive usage, even the PLC is OFF, they can keep the ON/OFF status.

Power off retentive zone cannot be modified;

Power off retentive relays are usually used to memory the status before stop the power, then when power the PLC on again, the status can run again;

For Special Usage

Special relays are some relays which are defined with special meanings or functions, start from SM0.

There are two functions for special relays, first is used to drive the coil, the other type is for special running.

E.g.: SM2 is the initial pulse, activates only at the moment of start

SM34 is "all output disabled"

Special auxiliary relays can't be used as normal relay M;

Note: The range of soft components mentioned above is the valid range of PLC in the X-NET communication mode. In the MODBUS communication mode, some relays can not read and write. The specific usable range is shown in chapter 6-2-3.

2-6. Status Relay (S, HS)

Address List

Status relays addresses of XD/XL series PLC are in form of decimal, the address are shown below:

Series	Name	Range	
		Normal	Power-off holding
XD1	S	S0~S1023	HS0~HS127
XD2		S0~S1023	HS0~HS127
XD3		S0~S1023	HS0~HS127
XD5		S0~S7999	HS0~HS999
XDM		S0~S7999	HS0~HS999
XDC		S0~S7999	HS0~HS999
XD5E		S0~S7999	HS0~HS999
XDME		S0~S7999	HS0~HS999
XL1		S0~S1023	HS0~HS127
XL3		S0~S1023	HS0~HS127
XL5		S0~S7999	HS0~HS999
XL5E		S0~S7999	HS0~HS999
XLME		S0~S7999	HS0~HS999

Function

Status relays S and HS are very import in ladder program; they are used together with instruction “STL” in the flow. The flow can make the program clear and easy to modify.

- For common use

After shut off the PLC power, S relays will be OFF

- For Power Off Retentive Use

HS relays can keep the ON/OFF status even PLC power is off

The status relays also have countless “normally ON/OFF” contactors. So users can use them freely in the program.

Note: The range of soft components mentioned above is the valid range of PLC in the X-NET communication mode. In the MODBUS communication mode, some relays can not read and write. The specific usable range is shown in chapter 6-2-3.

2-7. Timer (T, HT)

Address List


The timer addresses of XD/XL series PLC are in the form of decimal; please see the following table:

Series	Name	Range		
		Normal	Power-off holding	Precise timer
XD1	T HT ET	T0~T575	HT0~HT95	ET0~ET31
XD2		T0~T575	HT0~HT95	ET0~ET31
XD3		T0~T575	HT0~HT95	ET0~ET31
XD5		T0~T4999	HT0~HT1999	ET0~ET39
XDM		T0~T4999	HT0~HT1999	ET0~ET39
XDC		T0~T4999	HT0~HT1999	ET0~ET39
XD5E		T0~T4999	HT0~HT1999	ET0~ET39
XDME		T0~T4999	HT0~HT1999	ET0~ET39
XL1		T0~T575	HT0~HT95	ET0~ET31
XL3		T0~T575	HT0~HT95	ET0~ET31
XL5		T0~T4999	HT0~HT1999	ET0~ET39
XL5E		T0~T4999	HT0~HT1999	ET0~ET39
XLME		T0~T4999	HT0~HT1999	ET0~ET39

Function


The timers accumulate the 1ms, 10ms, 100ms pulse, the output contactor activates when the accumulation reaches the set value;

TMR instruction is for common timers. The set value can be constant (K) or data register (D).

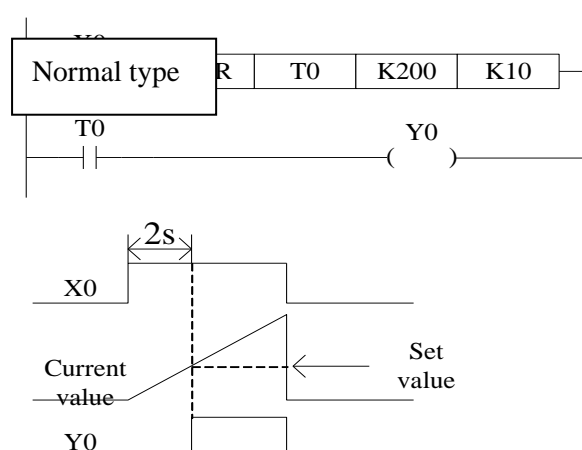

If X0 is ON, then T0 accumulates 10ms pulse based on the current value; when the accumulation value reaches the set value K200, the timer output activates. I.e. the output activates 2s later. If X0 is OFF, the timer resets, the output resets;

Accumulation type

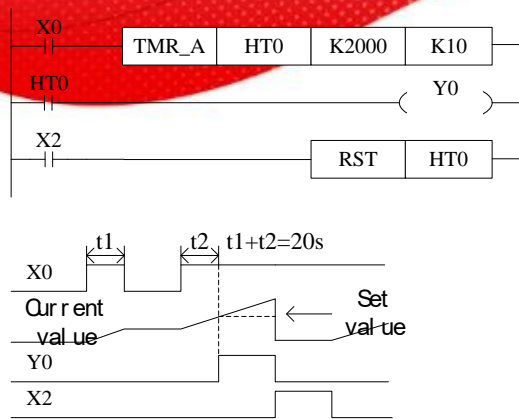


If X0 is ON, HT0 accumulates the 10ms pulse based on the current value. When the accumulation value reaches the set value K2000, the timer output activates.

If X0 is suddenly OFF during timer working, the timer value will be retentive. Then X0 is ON again, the timer will continue working.

When X2 is ON, the timer and output will be reset.

Appoint the set value

1. Instruction format



(Not accumulation)

(Accumulation)

Reset the timer and output:




S1: timer (T0, HT10)

S2: set time (such as K100)


S3: time unit (K1—1ms, K10—10ms, K100—100ms)

Power-off not retentive, not accumulation

(1) Time unit is 1ms, set time is K100, the real time is $1\text{ms} \times 100 = 0.1\text{s}$



Set value is constant K




set value is register D

(2) Time unit is 10ms, set time is K10, the real time is $10\text{ms} \times 10 = 0.1\text{s}$



Set value is constant K




set value is register D

(3) Time unit is 100ms, set time is K1, the real time is $100\text{ms} \times 1 = 0.1\text{s}$




Set value is constant K




set value is register D

Power-off retentive, accumulation

(1) Time unit is 1ms, set time is K100, the real time is $1\text{ms} \times 100 = 0.1\text{s}$




Set value is constant K




set value is register D

(2) Time unit is 10ms, set time is K10, the real time is $10\text{ms} \times 10 = 0.1\text{s}$




Set value is constant K




set value is register D

(3) Time unit is 100ms, set time is K1, the real time is $100\text{ms} \times 1 = 0.1\text{s}$



Set value is constant K



set value is register D

Notes

(1) The timer has cumulative, non-cumulative, 1ms, 10ms and 100ms, so it can be distinguished by instructions; that is to say, the same timer can be used as either cumulative or non-cumulative, and its time base unit is also specified by instructions as 1ms, 10ms or 100ms.


(2) The third parameter of instruction can only be based on K1, K10 and K100. Please do not write other values or registers besides these three parameters. Otherwise, although the program can be written into the programming software and downloaded to the PLC, the timing instruction will not be executed.

(3) The setting range of constant K and the actual setting value of timer are shown in the following table:

Timer	K range	Actual value
1ms timer	1~32,767	0.001~32.767s
10ms timer		0.01~327.67s
100ms timer		0.1~3276.7s

Time value


The time value is stored in register TD. The working mode of timer T0~T575 and HT0~HT95 are 16-bits linear increasing. The time range is from 0 to 32767. When the time value in TD reaches 32767, the timer will stop timing and keep the status.



The two instructions are the same. In the first instruction, T0 is seemed to TD0.


Application

Output delay



X0 is ON, output Y0. X0 changes from ON to OFF, delay 2s then cut off Y0.

Twinkle



X0 is ON, Y0 begin to twinkle. T1 is Y0-OFF time; T2 is Y0-ON time.

Note: The range of soft components mentioned above is the valid range of PLC in the X-NET communication mode. In the MODBUS communication mode, some relays can not read and write. The specific usable range is shown in chapter 6-2-3.

2-8. Counter (C, HC)

Number list

The counter addresses of XD/XL series PLC are in decimal; please see the following table for details:

Series	Name	Range		
		Normal	Power-off holding	High speed counter
XD1	C HC HSC	C0~C575	HC0~HC95	HSC0~HSC31
XD2		C0~C575	HC0~HC95	HSC0~HSC31
XD3		C0~C575	HC0~HC95	HSC0~HSC31
XD5		C0~C4999	HC0~HC1999	HSC0~HSC39
XDM		C0~C4999	HC0~HC1999	HSC0~HSC39
XDC		C0~C4999	HC0~HC1999	HSC0~HSC39
XD5E		C0~C4999	HC0~HC1999	HSC0~HSC39
XDME		C0~C4999	HC0~HC1999	HSC0~HSC39
XL1		C0~C575	HC0~HC95	HSC0~HSC31
XL3		C0~C575	HC0~HC95	HSC0~HSC31
XL5		C0~C4999	HC0~HC1999	HSC0~HSC39
XL5E		C0~C4999	HC0~HC1999	HSC0~HSC39
XLME		C0~C4999	HC0~HC1999	HSC0~HSC39

The counter range:

Counter type	Explanation
16/32 bits up/down counter	C0~C575 HC0~HC95 (32-bits counter occupies two registers, the counter address must be even number)
High speed counter	HSC0~HSC30 (HSC0,HSC2...HSC30) (each counter occupies two registers, the counter address must be even number)

- 1: Please refer to chapter 5 for details of high speed counter.
- 2: XD/XL series counters can be 16 or 32 bits count up/down mode. The mode is appointed by the instruction. Which means the same counter can be used as 16-bit or 32-bit. The increment/subtraction counting mode is also specified by the instruction mode.

Counter features

Item	16-bit counter	32-bit counter
Count direction	Count down/up	Count up/down
Set value	0~32,767	-2,147,483,648~+2,147,483,647
Set value type	Constant K or register	Constant K or a couple of registers
Count value	The value will not change when reaching the max or min value	The value will not change when reaching the max or min value
Output	Keep the state for count up	Reset for count down
Reset	Run RST instruction, the counter and output will be reset	


Present count value register	16-bit	32-bit
------------------------------	--------	--------

Function

The soft component will appoint the type of counter: common counter or power-off retentive counter.

16-bit common counter and power-off retentive counter

The set value range of 16-bit count-up counter is K1~K32,767 (decimal). K0 and K1 have the same function. They mean the counter output will act at the first counting. If the PLC power supply is cut off, common counter value will be reset. The power-off retentive counter value will be kept.




The counter C0 increases one when the X11 drives once. When C0 value reaches 10, the output acts. Then X11 drives again, C0 will continue increase one.

If X10 is ON, the C0 and output will be reset.


The counter set value can be constant K or register. For example, if D10 is 123, the set value is equal to K123.

32-bit common counter and power-off retentive counter

The set value range of 32-bit count-up/down counter is K+2,147,483,648~K-2,147,483,647 (decimal). The count direction is set through instruction.



Common count up counter



power-off retentive

count down counter

If X3 is ON, the counter and output will be reset.

For power-off retentive counter, the present counter value, output state will be kept after power supply is off.


32-bit counter can be seemed to 32-bit register.

Counter set value


The set value contains two conditions: 16-bit and 32-bit. The counter types include **common counter (C)** and **power-off retentive counter (HC)**.

Count instruction:

16-bit counter:



32-bit counter:



Reset instruction:

16-bit counter:



32-bit counter:




S1: counter (such as C0, HC10)

S2: counter set value (such as K100)


The counter is different from XC series. They don't have 16-bit and 32-bit type. The type is set through instruction.

16-bit counter (common, count up)

《set value is constant K》




《set value is register 》




16-bit counter (power-off retentive, count up)

《set value is constant K》



《set value is register 》



16-bit counter (common, count down)

《set value is constant K》




16-bit counter (power-off retentive, count down)


《set value is constant K》



《set value is register 》



《set value is register 》




32-bit counter (common, count up)

《set value is constant K》



《set value is register 》




32-bit counter (power-off retentive, count up)

《set value is constant K》



《set value is register 》




32-bit counter (common, count down)

《set value is constant K》



《set value is register 》




32-bit counter (power-off retentive, count down)

《set value is constant K》



《set value is register 》



Note: The setting range and actual setting value of constant K are shown in the following table:


Counter	K setting range	Actual setting range
16-bit counter	1~32,767	1~32,767
32-bit counter	1~2,147,483,647	1~2,147,483,647

Count value


The counter counting mode is 16-bit linear incremental mode (0~K32,767). When the counter's count value CD reaches the maximum value K32,767, the counter will stop counting and the state of the counter will remain unchanged.

The counter counting mode is a 16-bit linear decreasing mode (-32768-0). When the counter counting value CD decreases to the minimum value K-32,768 will stop counting and the state of the counter remains unchanged.


The counter counting mode is 32-bit linear increase/decrease mode (-2,147,483,648~+2,147,483,647). When the counter counting value increases to the maximum value K2,147,483,647, it will become K-2,147,483,648. When the counter counting value decreases to the minimum value K-2,147,483,648 will become K2,147,483,647, the ON/OFF state of the counter will also change with the change of the count value.



The above two instructions are equivalent. In the left instruction, C0 is processed as a register, while in the right instruction, CD0 is a data register corresponding to the timer C0. CD and C are one-to-one correspondences.



The highest frequency that this instruction can count is related to the selection of filter parameters and the scanning period of PLC. A high-speed counter is recommended when the input frequency exceeds 25Hz. High-number counter must use HSC0-HSC30 and corresponding hardware wiring.



High-speed counter, when SM0 is on, HSC0 counts the pulse signal of input terminal X0. High-speed counter is not affected by the response lag time of input filter and cycle scan time. Therefore, higher frequency input pulses can be processed. Refer to the details in chapter 5.

Note: The range of soft components mentioned above is the valid range of PLC in the X-NET communication mode. In the MODBUS communication mode, some relays can not read and write. The specific usable range is shown in chapter 6-2-3.

2-9. Data register (D, HD)

Address list

The data register of XD/XL series PLC is in decimal format. Please see the following table:

Series	Name	Range			
		Normal	Power-off holding	Special	Special power-off holding
XD1	D	D0~D7999	HD0~HD999	SD0~SD2047	HSD0~HSD499
XD2		D0~D7999	HD0~HD999	SD0~SD2047	HSD0~HSD499
XD3		D0~D7999	HD0~HD999	SD0~SD2047	HSD0~HSD499
XD5		D0~D59999 Or D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XDM		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XDC		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XD5E		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XDME		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XL1		D0~D7999	HD0~HD999	SD0~SD2047	HSD0~HSD499
XL3		D0~D7999	HD0~HD999	SD0~SD2047	HSD0~HSD499
XL5		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XL5E		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023
XLME		D0~D69999	HD0~HD24999	SD0~SD4999	HSD0~HSD1023

Note: For XD5 firmware version V3.5.3 and above, data register D ranges from D0 to D69999; XD5 firmware version of V3.5.2 and below, and data register D ranges from D0 to D59999.


Structure

Data register is used to store data; it includes 16 bits(the highest bit is sign bit) and 32 bits. (32 bits contains two registers, the highest bit is sign bit)

16 bits

16-bits register range is -32,768 ~ +32,767

Read and write the register data through instruction or other device such as HMI.




Sign bit

0: positive 1: negative

32 bits

32 bits value is consisted of two continuous registers. The range is -2147483648 ~ 2147483647. For example: (D1 D0) D1 is high 16 bits, D0 is low 16 bits.

For 32 bits register, if the low 16-bits are appointed, such as D0, then D1 will be the high 16 bits automatically. The address of low 16-bits register must be even number.



Function

- Normal type

When write a new value in the register, the former value will be covered.

When PLC changes from RUN to STOP or STOP to RUN, the value in the register will be cleared.

- Retentive type

When PLC changes from RUN to STOP or power off, the value in the register will be retained.

The retentive register range cannot be changed.

- Special type

Special register is used to set special data, or occupied by the system.

Some special registers are initialized when PLC is power on.

Please refer to the appendix for the special register address and function.


- Used as offset (indirect appoint)

Data register can be used as offset of soft element.

Format : Dn[Dm], Xn[Dm], Yn[Dm], Mn[Dm].

Word offset: DXn[Dm] means DX[n+Dm].

The offset value only can be set as D register.




When D0=0, D100=D10, Y0 is ON;
 When M2 is from OFF→ON, D0=5, D100=D15, Y5 is ON.
 $D10[D0]=D[10+D0]$, $Y0[D0]=Y[0+D0]$.

Example

Data register D can deal with many kinds of data.


Data storage



When M0 is ON, write 100 into D0.(16 bits value)


When M1 is ON, write 41100 into D11,D10 (32bits value)

Data transfer




When M0 is ON, transfer the value of D10 to D0

Read the timer and counter



When M0 is ON, move the value of C10 to D0.

As the set value of timer and counter



When X0 is ON, T10 starts to work, T0 will set ON when D0 value is equal to timer value, time unit is D2.

X1 is ON, HC0 starts to work, HC0 will set ON when D4 value is equal to counter value.


Note: The range of soft component:

X-NET communication mode. In the MODBUS communication mode, some relays can not read and write. The specific usable range is shown in chapter 6-2-3.

2-9-1. Word consist of bits

One of the coils from X0 to X17 is ON, Y0 will be ON.

Programming method one:



Programming method two: (application of word consists of bits)




2-9-2. Offset application

Application 1:


When M0 is ON, the output from Y1 to Y7 will be ON one by one. D0 is offset address.

If there are many output points, M can replace Y.

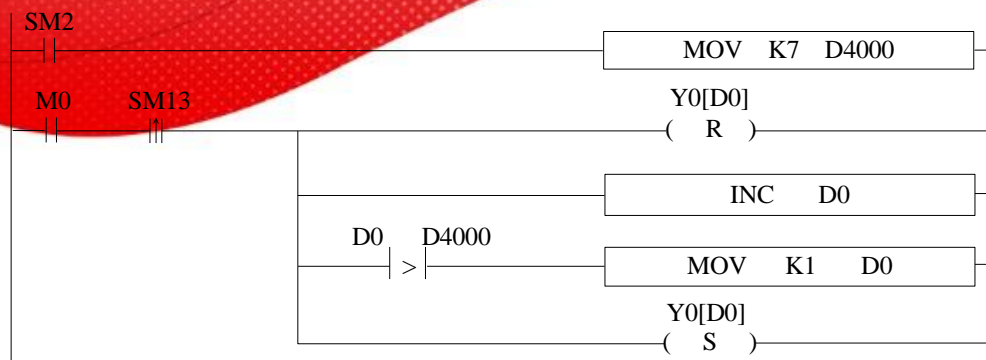

Application 2:

When M0 is ON, read the ID10000 value every second and store in the register starting from D4000 (amounts is 50 registers). D0 is offset address.

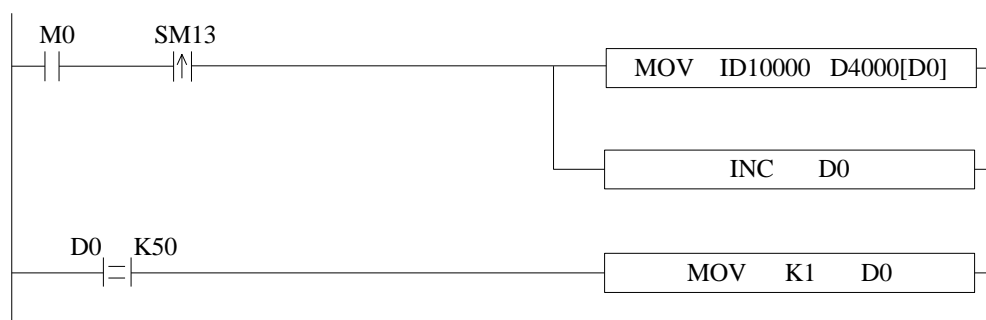

2-10. Flash register (FD, SFD, FS)

The FLASH registers of XD/XL series PLC are all addressed in decimal system. The serial numbers are shown in the corresponding table.

Series	Name	Range		
		FLASH user data register	FLASH system data register	Password read protection FLASH register
XD1	FD SFD FS	FD0~FD5119	SFD0~SFD1999	FS0~FS47
XD2		FD0~FD5119	SFD0~SFD1999	FS0~FS47
XD3		FD0~FD5119	SFD0~SFD1999	FS0~FS47
XD5		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XDM		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XDC		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XD5E		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XDM E		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XL1		FD0~FD5119	SFD0~SFD1999	FS0~FS47
XL3		FD0~FD5119	SFD0~SFD1999	FS0~FS47
XL5		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XL5E		FD0~FD8191	SFD0~SFD5999	FS0~FS47
XLME		FD0~FD8191	SFD0~SFD5999	FS0~FS47

Function

- FLASH User Data Register (FD)

Used to store important data of users, can be maintained when the power is off.

This storage area can remember data even if the battery is powered down, so it can be used to store important process parameters.

- FLASH System Data Register (SFD)

Used to store system parameters and be able to maintain the data when power off.

The storage area is a system parameter block, and users can not modify it at will.

- Password Read Protection FLASH Register (FS)

A part of the FlashROM register is used to store data soft components, which are represented by the symbol FS. The values in the FS register can be written but can not be read, so they can be used to protect the intellectual property rights of users.

The value of the soft element can be set arbitrarily in the FS register, but the value of the register can not be read (always returned to 0); and it can not be compared with the register in the host computer software, only with the constant, so the actual value of the register can not be read.

This storage area can remember data even if the battery is powered down, so it can be used to store important process parameters.

Note:

(1) When using MOV instruction to transmit data to FD, SFD and FS, only the rising edge is valid, even if the driving condition is normally open/closed coil, the instruction is executed only once.

(2) Flash registers can be written about 1,000,000 times, and each write is erased for the whole Flash registers, which is time-consuming. Frequent writing will cause permanent damage to Flash registers, so it is not recommended that users write frequently. Do not use oscillating coil (e.g. SM11) as driving condition.

(3) When data is transmitted to the same Flash register several times, if the value in the source register does not change from the previous transmission, the transmission instruction will not be executed even if the driving condition is established again. For example, if the value in D0 is transmitted to FD100, the value in D0 is 300 when the transmission instruction is executed for the first time; if the driving condition is established for the second time, the transmission instruction is not executed if the value in D0 is still 300.

(4) In order to prevent the interference of burr signal when transmitting data to Flash registers, it is not recommended to use coils such as SM0 and SM2 as direct driving conditions. It is suggested that the transmission instructions be executed after the PLC power-on for a period of time.

2-11. Constant

Data process

XD/XL series PLC has the following 5 number systems.

- DEC: DECIMAL NUMBER

The preset number of counter and timer (constant K)

The number of Auxiliary relay M, HM; timer T, HT; counter C, HC; state S, HS; register D, HD.

Set as the operand value and action of applied instruction (constant K)

- HEX: HEXADECIMAL NUMBER

Set as the operand value and action of applied instruction (constant H)

- BIN: BINARY NUMBER

Inside the PLC, all the numbers will be processed in binary. But when monitoring on the device, all the binary will be transformed into HEX or DEC.

- OCT: OCTAL NUMBER

XD/XL series PLC I/O relays are in octal. Such as [X0-7, X10-17,....X70-77].

- BCD: BINARY CODE DECIMAL

BCD uses 4 bits binary number to represent decimal number 0-9. BCD can be used in 7 segments LED and BCD output digital switch

- Other numbers (float number)

XD/XL series PLC can calculate high precision float numbers. It is calculated in binary numbers, and display in decimal numbers.

Display

PLC program should use K, H to process values. K means decimal numbers, H means hex numbers. Please note the PLC input/output relay use octal address.

- Constant K

K is used to display decimal numbers. K10 means decimal number 10. It is used to set timer and counter value, operand value of applied instruction.

- Constant H

H is used to display hex numbers. HA means decimal number 10. It is used to set operand value of applied instruction.

- Constant B

B is used to display binary numbers. B10 means decimal number 2. It is used to set operand value of applied instruction.

2-12. Programming principle

Sign P and I

P is the program sign for condition and subprogram jump.

I is the program sign for interruption (external interruption, timer interruption, high speed counter interruption, precise time interruption...).

P and I addresses are in decimal. Please refer to the following table:

Series	Sign	Address
XD, XL	P	P0~P9999


Model	Name	Range			
		External interruption			Timer interruption
		Input terminal	Rising interruption	Falling interruption	
XD1-16	I	X2	I0000	I0001	There are 20 timer interruptions. From I40** to I59**. “**” means the time of timer interruption, the unit is ms.
XD2-16		X3	I0100	I0101	
XD3-16		X4	I0200	I0201	
XD5-16		X5	I0300	I0301	
XL1-16		X6	I0400	I0401	
XL3-16		X7	I0500	I0501	

Model	Name	Range			
		External interruption			Timer interruption
		Input terminal	Rising interruption	Falling interruption	
XD1-32	I	X2	I0000	I0001	There are 20 timer interruptions. From I40** to I59**. “**” means the time of timer interruption, the unit is ms.
XD2-24/32/48/60		X3	I0100	I0101	
XD3-24/32/48/60		X4	I0200	I0201	
XD5-24/32/48/60		X5	I0300	I0301	
XDM		X6	I0400	I0401	
XDC		X7	I0500	I0501	
XD5E		X10	I0600	I0601	
XDME		X11	I0700	I0701	
XL5		X12	I0800	I0801	
XL5E		X13	I0900	I0901	
XLME					

Sign P


P is usually used in flow; it is used together with CJ (condition jump), CALL (call subprogram), etc.

Condition Jump CJ

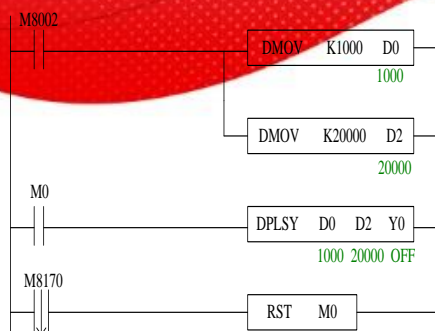

If coil X0 is ON, jump to the program after P1;
If the coil X0 is not ON, do not execute jump action, but run the original program;

Call the subprogram (CALL)

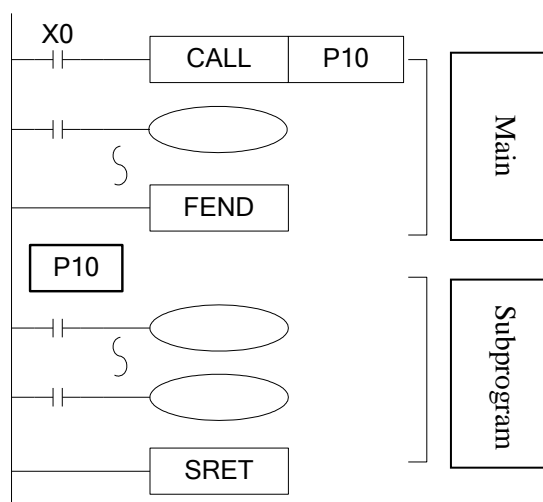

If X0 is ON, jump to the subprogram
If the coil is not ON, run the original program;
After executing the subprogram, return to the main program;

The subprogram will start from Pn and finish with SRET. CALL Pn is used to call the subprogram. n is a integer in the range of 0 to 9999.

Sign I

Tag I is usually used in interruption, including external interruption, time interruption etc. It often works together with IRET (interruption return), EI (enable interruption), DI (disable interruption);

- External interruption

Accept the input signal from the special input terminals, not affected by the scan cycle. Activate the input signal, execute the interruption subroutine.

With external interruption, PLC can dispose the signal shorter than scan cycle; So it can be used as essential priority disposal in sequence control, or used in short time pulse control.

- Time interruption

Execute the interruption subroutine at each specified interruption loop time. Use this interruption in the control which is different from PLC's operation cycle;

- Action sequence of input/output relays and response delay

Input

Before PLC executing the program, read all the input terminal's ON/OFF status to the image area. In the process of executing the program, even the input changed, the content in the input image area will not change. However, in the next scan cycle, the changes will be read.

Output


Once all the instructions end, transfers the ON/OFF status of output Y image area to the output lock memory area. This will be the actual output of the PLC. The output contactors will act according to the device's response delay time.

When use batch input/output mode, the drive time and operation cycle of input filter and output device will also show response delay.

- Not accept narrow input pulse signal

PLC's input ON/OFF time should be longer than its loop time. If consider input filter's response delay 10ms, loop time is 10ms, then ON/OFF time needs 20 ms separately. So, up to $1,000/(20+20)=25\text{Hz}$ input pulse can't be processed. But, this condition could be improved when use PLC's special function and applied instructions (such as high speed count, input interruption, input filter adjustment).

- Dual output (Dual coils) action

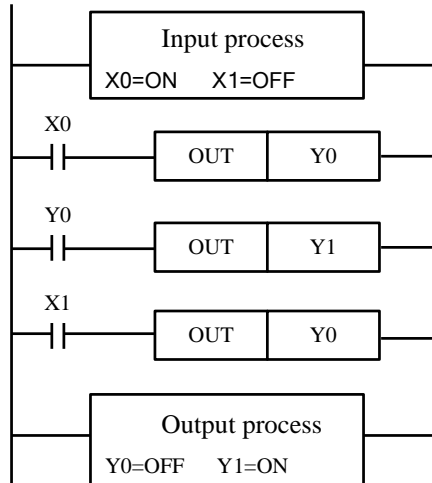

As shown in the left map, please consider the case of using the same coil Y0 at many positions:

E.g. X0=ON, X1=OFF

The first Y0: X0 is ON, its image area is ON, output Y1 is also ON.

The second Y0: as input X1 is OFF, the image area is OFF.

So, the actual output is: Y0=OFF, Y1= ON.















When executing dual output (use dual coil), the after one is act in priority.

3 Basic Program Instructions







This chapter introduces the basic instructions and their functions.

3-1. Basic Instructions List

XD, XL series support all the basic instructions:




Mnemonic	Function	Format and Device	Chapter
LD	Initial logical operation contact type NO (normally open)		3-2
LDD	Read the status from the contact directly		3-6
LDI	Initial logical operation contact type NC (normally closed)		3-2
LDDI	Read the normally closed contact directly		3-6
LDP	Initial logical operation- Rising edge pulse		3-5
LDF	Initial logical operation- Falling /trailing edge pulse		3-5
AND	Serial connection of NO (normally open) contacts		3-3
ANDD	Read the status from the contact directly		3-6
ANI	Serial connection of NC (normally closed) contacts		3-3
ANDDI	Read the normally closed contact directly		3-6
ANDP	Serial connection of rising edge pulse		3-5
ANDF	Serial connection of falling/trailing edge pulse		3-5
OR	Parallel connection of NO (normally open) contacts		3-4
ORD	Read the status from the contact directly		3-6

ORI	Parallel connection of NC (normally closed) contacts		3-4
ORDI	Read the normally closed contact directly		3-6
ORP	Parallel connection of rising edge pulse		3-5
ORF	Parallel connection of falling/trailing edge pulse		3-5
ANB	Serial connection of multiply parallel circuits		3-8
ORB	Parallel connection of multiply parallel circuits		3-7
OUT	Final logic operation type coil drive		3-2
OUTD	Output to the contact directly		3-6
SET	Set a bit device permanently ON		3-12
RST	Reset a bit device permanently OFF		3-12
CNT	16-bit non-power-off retentive incremental count		3-13
CNT_D	16-bit power-off retentive decremented count		3-13
DCNT	32-bit non-power-off retentive incremental count		3-13
DCNT_D	32-bit power-off retentive decremented count		3-13
PLS	Turn on a scan cycle when rising edge		3-11
PLF	Turn on a scan cycle when falling edge		3-11
MCS	Connect the public serial contacts		3-9
MCR	Clear the public serial contacts		3-9

ALT	The status of the assigned device is inverted on every operation of the instruction		3-10
TMR	Non-power-off holding timer		3-14
TMR_A	Power-off holding timer		3-14
END	Force the current program scan to end		3-15
GROUP	Group		3-15
GROUPE	Group End		3-16

3-2. [LD] , [LDI] , [OUT]

Mnemonic and Function

Mnemonic	Function	Format and Operands
LD (positive)	Initial logic operation contact type NO (Normally Open)	 <p>Operands: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m</p>
LDI (negative)	Initial logic operation contact type NC (Normally Closed)	 <p>Devices: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m</p>
OUT (OUT)	Final logic operation type drive coil	 <p>Operands: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m</p>


Statement

- Connect the LD and LDI instructions directly to the left bus bar. It can work with

ANB and be used at the branch start.

- OUT instruction can drive the output relays, auxiliary relays, status, timers, and counters. But this instruction can't be used for the input relays



Program



```
LD    X0
OUT   Y100
LDI   X1
OUT   M1203
TMR   T0      K10 K100
LD    T0
OUT   Y1
```

3-3. [AND] , [ANI]


Mnemonic and Function

Mnemonic	Function	Format and Operands
AND (and)	Normal open contactor in series	 Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m
ANI (and reverse)	Normal close contactor in series	 Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m

Statements

- Use AND and ANI to connect the contactors in series. There is no limit for contactors in series. They can be used for many times.
- Use OUT instruction through other coil is called "follow-on" output (For an example see the program below: OUT M2 and OUT Y3). Follow-on output can repeat as long as the output order is correct. There's no limit for the serial connected contactors and follow-on output times.



Program



```
LD    X2
AND   M1
OUT   Y2
LD    Y2
ANI   X3
OUT   M2
AND   T1
OUT   Y3
```

3-4. [OR] , [ORI]


Mnemonic and Function

Mnemonic	Function	Format and Operands
OR (OR)	Parallel connection of NO (Normally Open) contactors	 Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m
ORI (OR reverse)	Parallel connection of NC (Normally Closed) contactors	 Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m

Statements

- Use the OR and ORI instructions for parallel connection of contactors. To connect a block that contains more than one contactor connected in series to another circuit block in parallel, use ORB instruction, which will be described later;
- OR and ORI start from the instruction step, parallel connect with the LD and LDI instruction step introduced before. There is no limit for the parallel connect times.

Program




```

LD      X5
OR      X6
OR      M11
OUT     Y6
LDI     Y6
AND     M4
OR      M12
ANI     X7
OR      M13
OUT     M100

```





Relationship with ANB





The parallel connection with OR, ORI instructions should connect with LD, LDI instructions in principle. But behind the ANB instruction, it's still ok to add a LD or LDI instruction.

3-5. [LDP] , [LDF] , [ANDP] , [ANDF] , [ORP] , [ORF]

Mnemonic and Function

Mnemonic	Function	Format and Operands
LDP (Load Pulse)	Initial logical operation- Rising edge pulse	 X, Y, M, HM, SM, S, HS, T, HT, C, HC, Dn.m
LDF (Load Falling pulse)	Initial logical operation Falling/trailing edge pulse	 X, Y, M, HM, SM, S, HS, T, HT, C, HC, Dn.m
ANDP (AND Pulse)	Serial connection of Rising edge pulse	 X, Y, M, HM, SM, S, HS, T, HT, C, HC, Dn.m
ANDF	Serial connection of Falling/trailing edge pulse	


(AND Falling pulse)		X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m
ORP (OR Pulse)	Parallel connection of Rising edge pulse	 X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m
ORF (OR Falling pulse)	Parallel connection of Falling/trailing edge pulse	 X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn.m

Statements

LDP, ANDP, ORP will be ON for one scanning period when the signal rising pulse is coming (OFF→ON)

LDF, ANDF, ORF will be ON for one scanning period when the signal falling pulse is coming (ON→OFF)

Program






```





LDP    X5
ORP    X6
OUT    M13
LD     M8000
ANDP   X7
OUT    M15

```

3-6. [LDD] , [LDDI] , [ANDD] , [ANDDI] , [ORD] , [ORDI] , [OUTD]

Mnemonic and Function

Mnemonic	Function	Format and Operands
LDD	Read the status from the contact directly	 Devices: X
LDDI	Read the normally closed contact directly	 Devices: X
ANDD	Read the status from the contact directly	 Devices: X


ANDDI	Read the normally closed contact directly	 Devices: X
ORD	Read the status from the contact directly	 Devices: X
ORDI	Read the normally closed contact directly	 Devices: X
OUTD	Output to the contact directly	 Devices: Y

Statement

The function of LDD, ANDD, ORD instructions are similar to LD, AND, OR; LDDI, ANDDI, ORDI instructions are similar to LDI, ANDI, ORI; but if the operand is X, the LDD, ANDD, ORD commands read the signal from the terminals directly.


OUTD and OUT are output instructions. OUTD will output immediately when the condition is satisfied, needn't wait for the next scan cycle.

Program



3-7. [ORB]

Mnemonic and Function

Mnemonic	Function	Format and Devices
ORB (OR Block)	Parallel connect the serial circuits	 Devices: none


Statements

Two or more contactors is called "serial block". If parallel connect the serial block, use LD, LDI at the branch start point, use ORB at the branch end point;

As the ANB instruction, an ORB instruction is an independent instruction which is not associated with any soft component.

There are no limits for parallel circuits' quantity when using ORB for every circuit.

Program



Recommended good programming method:


```
LD    X0
AND   X1
LD    X2
AND   X3
ORB
LD    X4
AND   X5
ORB
OUT   Y10
```

Non-preferred programming method:

```
LD    X0
AND   X1
LD    X2
AND   X3
LD    X4
AND   X5
ORB
ORB
OUT   Y10
```

3-8. [ANB]

Mnemonic and Function


Mnemonic	Function	Format and Devices
ANB (And Block)	Serial connection of parallel circuits	 Devices: none

Statements

Use ANB to serial connects two parallel circuits. Use LD, LDI at the brach start point; use ANB at the branch end point.

There are no limits for ANB instruction using times.

Program



```
LD    X0
OR    X1
LD    X2
AND   X3
LDI   X4
AND   X5
ORB
OR    X6
ANB
OR    X7
OUT   Y20
```

3-9. [MCS] , [MCR]

Mnemonic and Function

Mnemonic	Function	Format and Devices
MCS (Master control)	The start of new bus line	<p>Devices: None</p>
MCR (Master control Reset)	Reset the bus line	<p>Devices: None</p>


Statements

- After the execution of an MCS instruction, the bus line (LD, LDI) moves to a point after the MCS instruction. An MCR instruction resets this to the original bus line.
- MCS, MCR instructions should use in pair.

- The bus line can be nesting. Use MCS, MCR instructions between MCS, MCR instructions. The nesting level increase with the using of MCS instruction. The max nesting level is ten. When executing MCR instruction, go back to the last level of bus line.
- When use flow program, bus line management could only be used in the same flow. When the flow ends, it must go back to the main bus line.


Note: The MCS and MCR instructions can not be written directly in the ladder diagram of XD/XL series PLC programming software. They can be constructed by horizontal and vertical lines.

Program

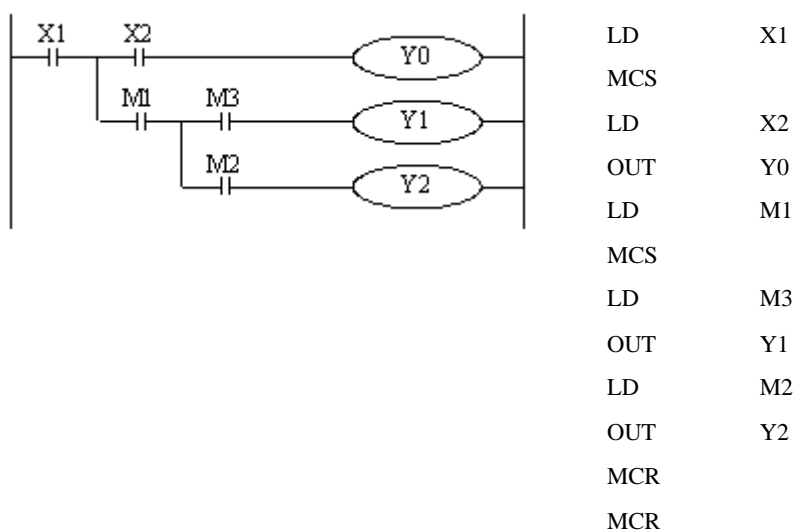

3-10. [ALT]


Mnemonic and Function

Mnemonic	Function	Format and Devices
ALT (Alternate)	Alternate the coil	 <p>Coil: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m</p>

Statements

The status of the coil is reversed after using ALT (ON changes to OFF, OFF changes to ON).



Program



```
LDP    M100
ALT    M0
LD     M0
OUT    Y0
LDI    M0
OUT    Y1
```

3-11. [PLS] , [PLF]

Mnemonic and Function


Mnemonic	Function	Format and Devices
PLS (Rising Pulse)	Turn on a scan cycle when Rising edge	 <p>Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m</p>
PLF (Falling Pulse)	Turn on a scan cycle when Falling edge	 <p>Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m</p>

Statements

For using PLS instruction: soft component Y and M will act during one scanning period after the drive is ON.

For using PLF instruction: soft component Y and M will act during one scanning period after the drive is OFF.

Program



```


LD    X0
PLS   M0
LD    M0
SET   Y0

```

```



LD    X1
PLF   M1
LD    M1
RST   Y0

```



3-12. [SET], [RST]

Mnemonic and Function

Mnemonic	Function	Format and Devices
SET (Set)	Set a bit device permanently ON	 Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m
RST (Reset)	Reset a bit device permanently OFF	 Operand: X,Y,M,HM,SM,S,HS,T,HT,C,HC,Dn. m

Statements

In the following program, Y0 will keep ON even X10 turns OFF after turning ON. Y0 will not ON even X11 turns OFF after turning ON. This is the same to S and M.

SET and RST can be used for many times for the same soft component. Any order is allowed, but the last one is effective.

RST can be used to reset the counter, timer and contactor.

When using SET or RST, it cannot use the same soft component with OUT.


Program

X1	Y0
0	(S)
X1	Y0
1	(R)
X1	M50
2	(S)
X1	M50
3	(R)
X1	S0
4	(S)
X1	S0
5	(R)
X1	TMR T250 K10 K10
6	
X1	T250
7	(R)

```

LD      X10
SET     Y0
LD      X11
RST     Y0
LD      X12
SET     M50
LD      X13
RST     M50
LD      X14
SET     S0
LD      X15
RST     S0
LD      X16
TMR     T250      K10   K10
LD      X17
RST     T250




```




3-13. 【CNT】 【CNT_D】 【DCNT】 【DCNT_D】 【RST】 for the counters

Mnemonic and Function

Mnemonic	Function	Format and devices
CNT Output	16 bits non power-off retentive increase count, the drive of count coil	 Operand: K, D
CNT_D Output	16 bits power-off retentive decrease count, the drive of count coil	 Operand: K, D

DCNT Output	32 bits non power-off retentive increase count, the drive of count coil	 Operand: K, D
DCNT_D Output	32 bits power-off retentive decrease count, the drive of count coil	 Operand: K, D
RST Reset	Reset the output coil, clear the current count value	 Operand: C, HC, HSC


Internal counter programming



C0 increase counts the X11 OFF to ON times. When C0 reaches K10, C0 will become OFF to ON. When X11 becomes OFF to ON, the C0 current value will keep increasing, and the C0 coil will still be ON. When X10 is ON, reset the C0 coil.

Power-off retentive counter will keep the current value and counter coil status when the power is off.







High speed counter programming




Increase count the OFF to ON times of M0. When the count value reaches set value (value of K or D), the count coil will be ON. When M1 is ON, the count coil of HSC0 reset, the current value becomes 0.

3-14. [TMR], [TMR-A] for timers

Mnemonic and Function

Mnemonic	Function	Format and devices
TMR output	Non power-off retentive 100ms timer, the drive of coil	 operand: K, D
TMR output	Non power-off retentive 10ms timer, the drive of coil	 operand: K, D
TMR output	Non power-off retentive 1ms timer, the drive of coil	 operand: K, D
TMR_A output	Power-off retentive 100ms timer, the drive of coil	 operand: K, D
TMR_A output	Power-off retentive 10ms timer, the drive of coil	 operand: K, D
TMR_A output	Power-off retentive 1ms timer, the drive of coil	 operand: C, HC, HSC

Internal timer programming




When M0 is ON, T0 starts to timing. When T0 reaches K10, T0 coil is ON. Then T0 continues timing. When M1 is ON, reset the T0.


Power-off retentive timer will keep the current value and counter coil status when the power is off.

3-15. [END]

Mnemonic and Function

Mnemonic	Function	Format and Devices: None
END (END)	Force the current program scan to end	 Devices: None

Statements



PLC repeatedly carries on input disposal, program executing and output disposal. If we write END instruction at the end of the program, then the instructions behind END instruction won't be executed. If there's no END instruction in the program, the PLC executes the end step and then repeats executing the program from step 0.

When debug, insert END in each program segment to check out each program's action. Then, after confirm the correction of preceding block's action, delete END instruction. Besides, the first execution of RUN begins with END instruction.

When executing END instruction, refresh monitor timer. (Check if scan cycle is a long timer.)

3-16. [GROUP] , [GROUPE]

Mnemonic and Function


Mnemonic	Function	Format and Device
GROUP	GROUP	<div>GROUP</div> Devices: None
GROUPE	GROUP END	<div>GROUPE</div> Devices: None

Statements

GROUP and GROUPE should used in pairs.

GROUP and GROUPE don't have practical meaning; they are used to optimize the program structure. So, add or delete these instructions doesn't affect the program's running;

The using method of GROUP and GROUPE is similar with flow instructions; enter GROUP instruction at the beginning of group part; enter GROUPE instruction at the end of group part.



Generally, GROUP and GROUPE instruction can be programmed according to the group's function. Meantime, the programmed instructions can be FOLDED or UNFOLDED. To a redundant project, these two instructions are quite useful.

3-17. Programming notes

Contactors structure and steps

Even in the sequential control circuit with the same function, it's also available to simplify the program and shorten the program steps according to the contactors' structure. General programming principle is: (a) write the circuit with many serial contacts on the top; (b) write the circuit with many parallel contactors in the left.

Program's executing sequence


Handle the sequential control program by 【From top to bottom】 and 【From left to right】

Sequential control instructions also encode following this procedure.

Dual output dual coil's activation and the solution

If carry on coil's dual output (dual coil) in the sequential control program, then the last action is prior.

Dual output (dual coil) doesn't go against the input rule. But as the preceding action is very complicate, please modify the program as in the following example.

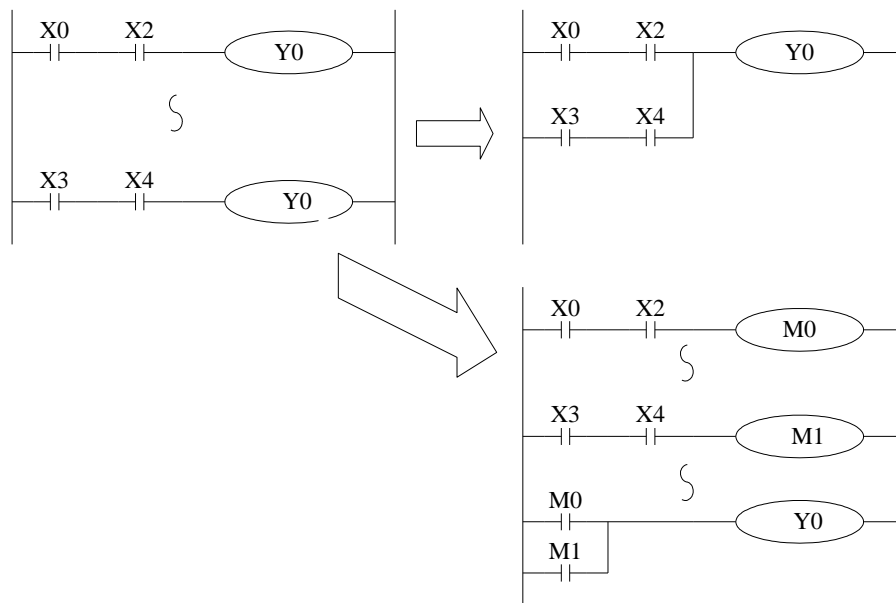












































There are other methods. E.g. jump instructions or flow instructions.



























4 Applied Instructions

In this chapter, we describe applied instruction's function of XD, XL series PLC.

4-1. Applied Instructions List

Mnemonic	Function	Ladder chart	Chapter
Program Flow			
CJ	Condition jump		4-3-1
CALL	Call subroutine		4-3-2
SRET	Subroutine return		4-3-2
STL	Flow start		4-3-3
STLE	Flow end		4-3-3
SET	Open the assigned flow, close the current flow		4-3-3
ST	Open the assigned flow, not close the current flow		4-3-3
FOR	Start a FOR-NEXT loop		4-3-4
NEXT	End of a FOR-NEXT loop		4-3-4
FEND	Main program END		4-3-5
END	Program END		4-3-5
Data Compare			
LD=	LD activates if (S1) = (S2)		4-4-1
LD>	LD activates if (S1) > (S2)		4-4-1
LD<	LD activates if (S1) < (S2)		4-4-1
LD<>	LD activates if (S1) ≠(S2)		4-4-1
LD≤	LD activates if (S1) ≤ (S2)		4-4-1
LD≥	LD activates if (S1) ≥ (S2)		4-4-1

AND=	AND activates if (S1) = (S2)		4-4-2
AND>	AND activates if (S1) > (S2)		4-4-2
AND<	AND activates if (S1) < (S2)		4-4-2
AND<>	AND activates if (S1) ≠ (S2)		4-4-2
AND<=	AND activates if (S1) ≤ (S2)		4-4-2
AND>=	AND activates if (S1) ≥ (S2)		4-4-2
OR=	OR activates if (S1) = (S2)		4-4-3
OR>	OR activates if (S1) > (S2)		4-4-3
OR<	OR activates if (S1) < (S2)		4-4-3
OR<>	OR activates if (S1) ≠ (S2)		4-4-3
OR<=	OR activates if (S1) ≤ (S2)		4-4-3
OR>=	OR activates if (S1) ≥ (S2)		4-4-3
Data Move			
CMP	Compare the data		4-5-1
ZCP	Compare the data in certain area		4-5-2
MOV	Move		4-5-3
BMOV	Block move		4-5-4
PMOV	Transfer the Data block		4-5-5
FMOV	Multi-points repeat move		4-5-6
EMOV	Float number move		4-5-7
FWRT	Flash ROM written		4-5-8
MSET	Zone set		4-5-9
ZRST	Zone reset		4-5-10
SWAP	Swap the high and low byte		4-5-11
XCH	Exchange two values		4-5-12
Data Operation			
ADD	Addition		4-6-1
SUB	Subtraction		4-6-2

MUL	Multiplication		4-6-3
DIV	Division		4-6-4
INC	Increment		4-6-5
DEC	Decrement		4-6-5
MEAN	Mean		4-6-6
WAND	Word And		4-6-7
WOR	Word OR		4-6-7
WXOR	Word eXclusive OR		4-6-7
CML	Compliment		4-6-8
NEG	Negative		4-6-9
Data Shift			
SHL	Arithmetic Shift Left		4-7-1
SHR	Arithmetic Shift Right		4-7-1
LSL	Logic shift left		4-7-2
LSR	Logic shift right		4-7-2
ROL	Rotation shift left		4-7-3
ROR	Rotation shift right		4-7-3
SFTL	Bit shift left		4-7-4
SFTR	Bit shift right		4-7-5
WSFL	Word shift left		4-7-6
WSFR	Word shift right		4-7-7
Data Convert			
WTD	Single word integer converts to double word integer		4-8-1
FLT	16 bits integer converts to float point		4-8-2
DFLT	32 bits integer converts to float point		4-8-2
FLTD	64 bits integer converts to float point		4-8-2
INT	Float point converts to integer		4-8-3
BIN	BCD converts to binary		4-8-4

BCD	Binary converts to BCD		4-8-5
ASCI	Hex. converts to ASCII		4-8-6
HEX	ASCII converts to Hex.		4-8-7
DECO	Coding		4-8-8
ENCO	High bit coding		4-8-9
ENCOL	Low bit coding		4-8-10
GRY	Binary to Gray code		4-8-11
GBIN	Gray code to binary		4-8-12
Float Point Operation			
ECMP	Float compare		4-9-1
EZCP	Float Zone compare		4-9-2
EADD	Float Add		4-9-3
ESUB	Float Subtract		4-9-4
EMUL	Float Multiplication		4-9-5
EDIV	Float division		4-9-6
ESQR	Float Square Root		4-9-7
SIN	Sine		4-9-8
COS	Cosine		4-9-9
TAN	Tangent		4-9-10
ASIN	Float Sine		4-9-11
ACOS	Float Cosine		4-9-12
ATAN	Float Tangent		4-9-13
Clock Operation			
TRD	Read RTC data		4-10-1
TWR	Write RTC data		4-10-2

4-2. Reading Method of Applied Instructions

In this manual, the applied instructions are described in the following manner.

Summary

ADDITION [ADD]			
16 bits	ADD	32 bits	DADD
Execution condition	Normally ON/OFF, Rising/Falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

Operands

Operands	Function	Data Type
S1	Specify the data or register address	16 bits/32 bits, BIN
S2	Specify the data or register address	16 bits/32 bits, BIN
D	Specify the register to store the sum result	16 bits/32 bits, BIN

Suitable Soft Components

Word	Operand	System							Constant	Module		
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	●	●	●	●	●	●	●	●	●		
	S2	●	●	●	●	●	●	●	●	●		
	D	●	●	●	●		●	●	●			


*Note: D includes D, HD. TD includes TD, HTD. CD includes CD, HCD, HSCD, HSD.

DM


includes DM, DHM. DS includes DS, DHS. M includes M, HM, SM. S includes S and HS. T includes T and HT. C includes C and HC.

Description

<16 bits instruction>



<32 bits instruction>



Two source data make binary addition and the result data store in object address. The highest bit of each data is positive (0) and negative (1) sign bit. These data will make addition operation through algebra. Such as $5 + (-8) = -3$. If the result of a calculations is "0", the "0" flag acts. If the result exceeds 323,767(16 bits operation) or 2,147,483,648 (32 bits operation), the carry flag acts. (refer to the next page). If the result exceeds -323,768 (16 bits operation) or -2,147,483,648 (32 bits operation), the borrow flag acts (Refer to the next page). When carry on 32 bits operation, low 16 bits of 32-bit register are assigned, the register address close to the low 16 bits register will be assigned to high 16 bits of 32-bit register. Even number is recommended for the low 16 bits register address. The source and object can be same register address. In the above example, when X0 is ON, the addition operation will be excuted in each scanning period.

Related flag

Flag	Name	Function
SM20	Zero	ON: the calculate result is zero OFF: the calculate result is not zero
SM21	Borrow	ON: the calculate result is over 32767(16bits) or 2147483647(32bits) OFF: the calculate result is not over 32767(16bits) or 2147483647(32bits)
SM22	Carry	ON: the calculate result is over 32767(16bits) or 2147483647(32bits) OFF: the calculate result is not over 32767(16bits) or 2147483647(32bits)

Notes

The assignment of the data


The data register of XD, XL series PLC is a single word (16 bit) data register, single word data only occupy one register which is used to single word instruction. The process range is decimal -327,68~327,67, or hex 0000~FFFF.

Single word object instruction D(NUM)



Double words (32 bit) occupy two data registers; the two registers' address is continuous. The process range is: decimal -214,748,364,8~214,748,364,7 or hex 00000000~FFFFFFFF.

Double word object instruction D(NUM+1) D(NUM)



The way to represent 32 bits instruction

Add letter “D” before 16 bits instruction to represent 32 bits instruction.

For example:

ADD D0 D2 D4 16 bits instruction

DADD D10 D12 D14 32 bits instruction

※1: It shows the flag bit following the instruction action.

※2: (S) Source operand which won't change with instruction working

※3: (D) Destinate operand which will change with instruction working

※4: It introduces the instruction's basic action, using way, applied example, extend function, note items and so on.

4-3. Program Flow Instructions

Mnemonic	Instruction's name	Chapter
CJ	Condition Jump	4-3-1
CALL	Call subroutine	4-3-2
SRET	Subroutine return	4-3-2
STL	Flow start	4-3-3
STLE	Flow end	4-3-3
SET	Open the assigned flow, close the current flow (flow jump)	4-3-3
ST	Open the assigned flow, not close the current flow (Open the new flow)	4-3-3
FOR	Start of a FOR-NEXT loop	4-3-4
NEXT	End of a FOR-NEXT loop	4-3-4
FEND	First End	4-3-5
END	Program End	4-3-5

4-3-1. Condition Jump [CJ]

Summary

As the instruction to execute part of the program, CJ shortens the operation cycle and avoids using the dual coil

Condition Jump [CJ]			
16 bits	CJ	32 bits	-
Execution condition	Normally ON/OFF coil	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

Operands


Operand s	Function	Data Type
Pn	Jump to the target (with pointer Nr.) P (P0~P9999)	Pointer's Nr.

Suitable Soft Components

Other	Pointer
	P I
	•

Description

In the below graph, if X0 is ON, jump from the first step to the next step behind P6 tag.
If X0 is OFF, do not execute the jump instruction;

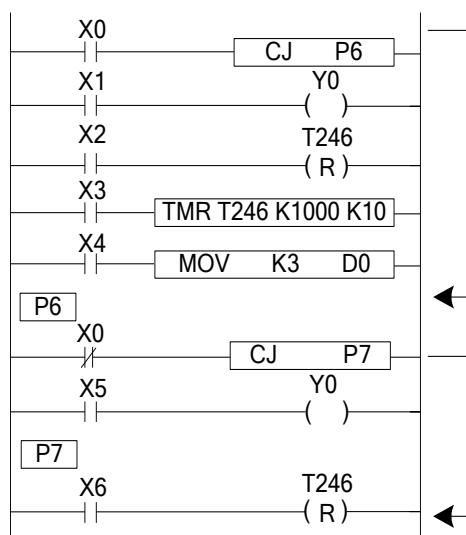

- In the left graph, Y0 becomes to be dual coil output, but when X0=OFF, X1 activates; when X0=ON, X5 activates
- CJ can't jump from one STL to another STL;
- After driving timer T0~T575, HT0~HT795 and HSC0~HSC30, if executes CJ, continue working, the output activates.
- The Tag must match when using CJ instruction.

4-3-2. Call subroutine [CALL] and Subroutine return [SRET]

Summary

Call the programs which need to be executed together, decrease the program's steps;

Subroutine Call [CALL]			
16 bits	CALL	32 bits	-
Execution condition	Normally ON/OFF, Rising/Falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Subroutine Return [SRET]			
16 bits	SRET	32 bits	-

Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-


Operands

Operands	Function	Data Type
Pn	Jump to the target (with pointer No.) P (P0~P9999)	Pointer's No.

Suitable Soft Components

Others	<table border="1"> <tr> <th colspan="2">Pointer</th></tr> <tr> <td>P</td><td>I</td></tr> <tr> <td>•</td><td></td></tr> </table>	Pointer		P	I	•	
Pointer							
P	I						
•							

Description

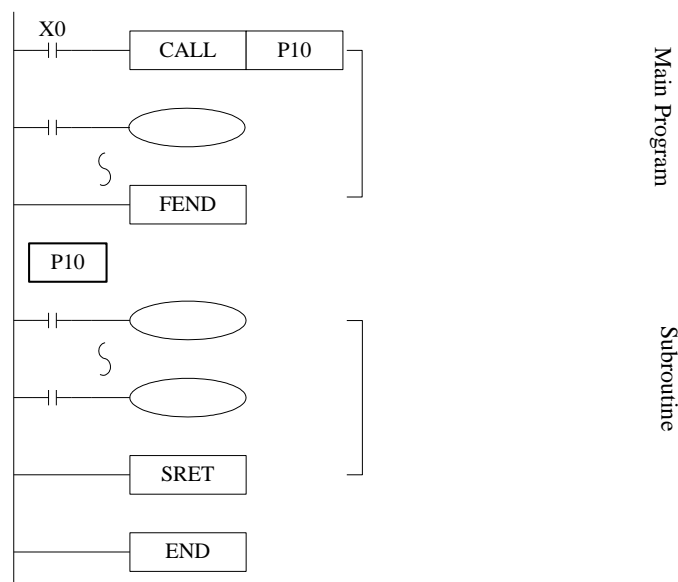

If X0= ON, execute the call instruction and jump to P10. After executing the subroutine, return the original step via SRET instruction.

Program the tag with FEND instruction (will describe this instruction later)


In the subroutine 9 times call is allowed, so totally there can be 10 nestings.

When calling the subprogram, all the timer, OUT, PLS, PLF of the main program will keep the status.

All the OUT, PLS, PLF, timer of subprogram will keep the status when subprogram returning.

Do not write pulse, counter or timer inside the subprogram which cannot be completed in one scan period.

Subprogram executing diagram:



If X0=ON, the program executes as the arrow.

If X0=OFF, the CALL instruction will not work; only the main program works.

The notes to write the subprogram:

Please programming the tag after FEND. Pn is the start of subprogram; SRET is the end of subprogram. CALL Pn is used to call the subprogram. The range of n is 0 to 9999.

The subprogram calling can simplify the programming. If the program will be used in many places, make the program in subprogram and call it.

4-3-3. Flow [SET], [ST], [STL], [STLE]

Summary

Instructions to specify the start, end, open, close of a flow;

Open the specified flow, close the local flow [SET]			
16 bits	SET	32 bits	-

Execution condition	Normally ON/OFF, Rising/Falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Open the specified flow, not close the local flow [ST]			
16 bits	ST	32 bits	-
Execution condition	Normally ON/OFF, Rising/Falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Flow starts [STL]			
16 bits	STL	32 bits	-
Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Flow ends [STLE]			
16 bits	STLE	32 bits	-
Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

operands

Operands	Function	Data Type
Sn	Jump to the target flow S	Flow No.

3.Suitable Soft Components

Bit	Operand	System					
		X	Y	M*	S*	T*	C*
	Sn				●		

*Note: M includes M, HM and SM; S includes S, HS; T includes T and HT; C includes C and HC.

Description

STL and STLE should be used in pairs. STL represents the start of a flow; STLE represents the end of a flow.

Every flow is independent. They cannot be nesting. There is no need to write the flow as the order S0, S1, S2... you can make the order. For example, executing S10, then S5, S0.

After executing of **SET Sxxx** instruction, the flow specified by these instructions is ON. After executing **RST Sxxx** instruction, the specified flow is OFF.


In flow S0, SET S1 close the current flow S0, open flow S1.

In flow S0, ST S2 open the flow S2, but don't close flow S0.

When flow turns from ON to be OFF, reset OUT, PLS, PLF, not accumulate timer etc. in the flow.

ST instruction is usually used when a program needs to run many flows at the same time.


After executing **SET Sxxx** instruction and jump to the next flow, the pulse instructions in the former flow will be closed. (including one-segment, multi-segment, relative or absolute, return to the origin)




Example

Example 1: the flows run in branch then merge in one flow.

Program diagram:





The program explanation:


When SM2 is ON, set ON flow S0. When M0 is ON, set ON flow S10 and S20.

In S10 branch, it runs S10, S11 and S12. Set on M1 means the S10 branch is finished.

In S20 branch, it runs S20, S21 and S22. Set on M2 means the S20 branch is finished.

When both branch S10 and S20 end, set on S30. When S30 end, reset S30.

Example 2: flow nesting. When S0 is running for a while, S1 and S2 start to run; the running status of S1 is kept. When S0 is running for certain time, closes S0 and force close S1 and S2.

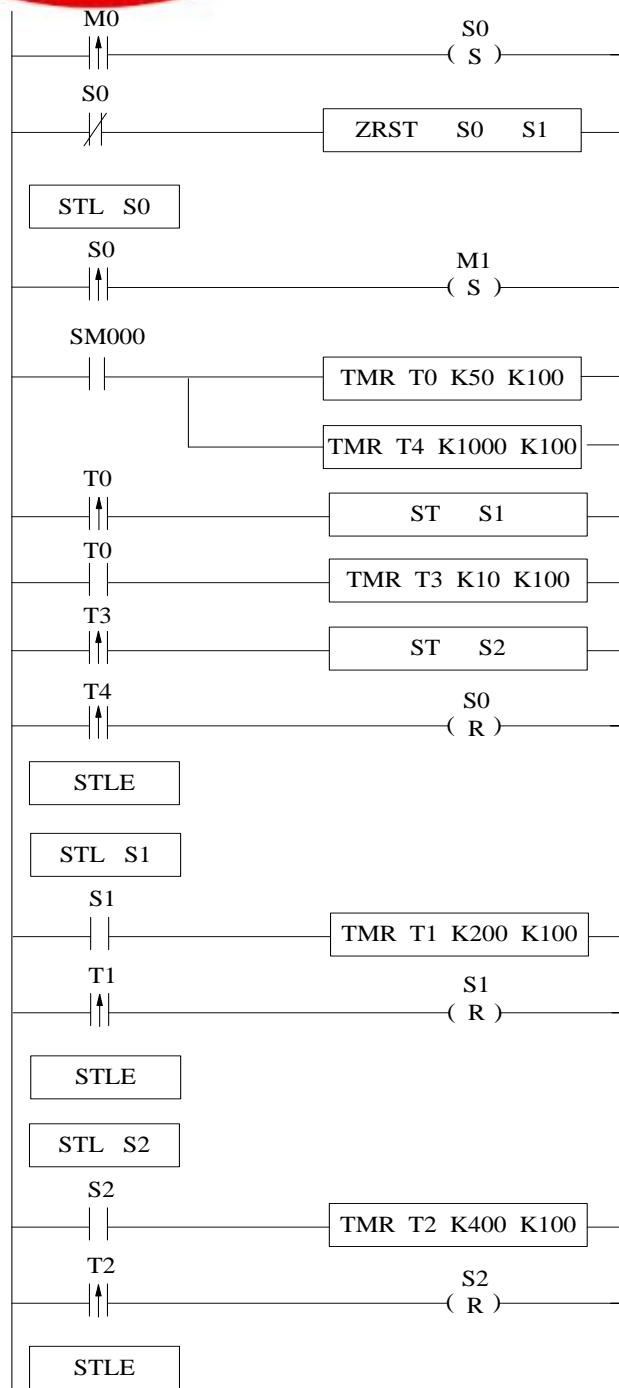

4-3-4. [FOR] and [NEXT]

Summary

Loop execute the program between **FOR** and **NEXT** with the specified times;

Loop starts [FOR]			
16 bits	FOR	32 bits	-
Execution condition	Rising/Falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Loop ends [NEXT]			
16 bits	NEXT	32 bits	-
Execution condition	Normally ON/OFF, Rising/Falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

Operands

Operand	Function	Data Type
S	Program's loop times between FOR and NEXT	16 bits, BIN

Suitable Soft Components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	●								●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

FOR.NEXT instructions must be programmed as a pair. Nesting is allowed, and the nesting level is 8.

The program after NEXT will not be executed unless the program between FOR and NEXT is executed for specified times.


Between FOR and NEXT, LDP, LDF instructions are effective for one time. Every time when M0 turns from OFF to ON, and M1 turns from OFF to ON, [A] loop is executed $5 \times 6 = 30$ times.

Every time if M0 turns from OFF to ON and M3 is ON, [B] loop is executed $5 \times 7 = 35$ times.


If there are many loop times, the scan cycle will be prolonged. Monitor timer error may occur, please note this.

If NEXT is before FOR, or no NEXT, or NEXT is behind FEND, END, or FOR and NEXT number is not equal, an error will occur.

Between FOR~NEXT, CJ nesting is not allowed. FOR~NEXT must be in pairs in one STL.



Example 1: when M0 is ON, the FOR NEXT starts to sort the numbers in the range of D1 to D20 from small to large. D21 is offset value. If there are many sortings in the program, please use C language to save the programming time and scanning time.

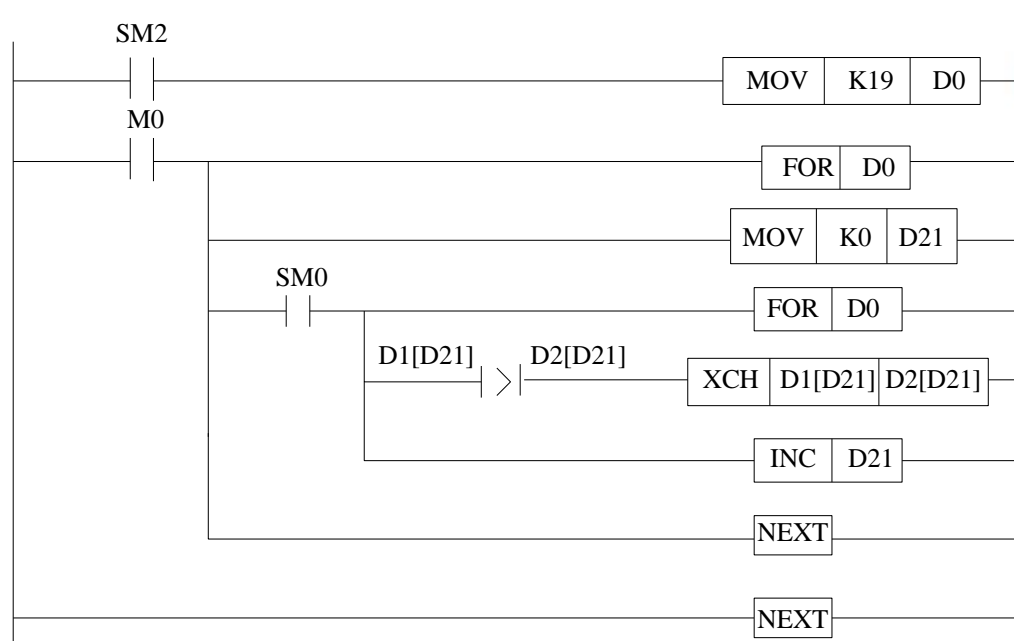

```

LD    SM2           //SM2 is initial ON coil
MOV   K19    D0     //the times of FOR loop
LD    M0           //M0 to trigger the FOR loop
MCS                //
FOR   D0           //Nesting FOR loop, the loop times is D0
MOV   K0    D21     //the offset starts from 0
LD    SM0          //SM0 is always ON coil
      D1[D21] > D2[D21]
      XCH D1[D21] D2[D21]
      INC D21
      NEXT
NEXT
  
```

```

MCS          //
FOR          D0          //nesting FOR loop, the loop times is D0
LD> D1[D21]    D2[D21]    //if the current data is larger than the next, it will be
ON
XCH D1[D21]    D2[D21]    //exchange the two neighbouring data
LD  SM0        //M8000 is always ON coil
INC D21        //increase one for D21
MCR          //
NEXT         //match the second FOR
MCR          //
NEXT         //match the first FOR

```

4-3-5. [FEND] and [END]

Summary

FEND means the main program ends, while END means program ends;

main program ends [FEND]			
Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
program ends [END]			
Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

Operands


Operands	Function	Data Type
None	-	-

Suitable Soft Components

None

Description

Even though [FEND] instruction represents the end of the main program, the function is same to END to process the output/input, monitor the refresh of the timer, return to program step0.



If program the tag of CALL instruction behind FEND instruction, there must be SRET instruction. If the interrupt pointer program behind FEND instruction, there must be IRET instruction.

After executing CALL instruction and before executing SRET instruction, if execute FEND instruction; or execute FEND instruction after executing FOR instruction and before executing NEXT, an error will occur.

In the condition of using many FEND instructions, please make program or subprogram between the last FEND instruction and END instruction.

4-4. Data compare function

Mnemonic	Function	Chapter
LD=	LD activates when (S1)= (S2)	4-4-1
LD>	LD activates when (S1)> (S2)	4-4-1
LD<	LD activates when (S1)< (S2)	4-4-1
LD<>	LD activates when (S1)≠ (S2)	4-4-1
LD≤	LD activates when (S1)≤ (S2)	4-4-1
LD≥	LD activates when (S1)≥ (S2)	4-4-1
AND=	AND activates when (S1)= (S2)	4-4-2
AND>	AND activates when (S1)> (S2)	4-4-2
AND<	AND activates when (S1)< (S2)	4-4-2
AND<>	AND activates when (S1)≠ (S2)	4-4-2
AND≤	AND activates when (S1)≤ (S2)	4-4-2
AND≥	AND activates when (S1)≥ (S2)	4-4-2
OR=	OR activates when (S1)= (S2)	4-4-3
OR>	OR activates when (S1)> (S2)	4-4-3
OR<	OR activates when (S1)< (S2)	4-4-3
OR<>	OR activates when (S1)≠ (S2)	4-4-3

OR<=	OR activates when (S1)≤ (S2)	4-4-3
OR>=	OR activates when (S1)≥ (S2)	4-4-3

4-4-1. LD Compare [LD]

1. Summary

LD is the point compare instruction connected with the generatrix.

LD Compare [LD]			
16 bits	As below	32 bits	As below
Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	Being compared number address	16/32bits, BIN
S2	Comparand address	16/32 bits, BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•	•	•	•	•	•	•	•		
	S2	•	•	•	•	•	•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

16 bits instruction	32 bits instruction	Activate Condition	Not Activate Condition
LD=	DLD=	(S1)=(S2)	(S1) ≠ (S2)
LD>	DLD>	(S1)> (S2)	(S1) ≤ (S2)
LD<	DLD<	(S1)< (S2)	(S1) ≥ (S2)
LD<>	DLD<>	(S1) ≠ (S2)	(S1) = (S2)
LD≤	DLD≤	(S1) ≤ (S2)	(S1) > (S2)
LD≥	DLD≥	(S1) ≥ (S2)	(S1) < (S2)

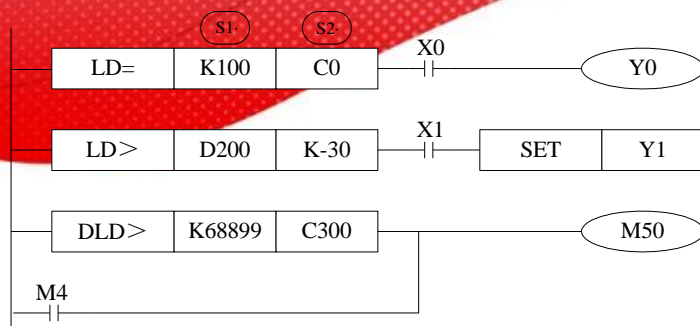

Note Items

When the source data's highest bit (16 bits: b15, 32 bits: b31) is 1, the data is seemed to a negative number.

The comparison of 32 bits counter should use 32 bits instruction. If using 16 bits instruction, the program or operation will be error.

4-4-2. Serial Compare [AND]

Summary

AND: serial connection comparison instruction.

AND Compare [AND]			
16 bits	As Below	32 bits	As Below
Execution condition	Normally ON/OFF coil	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

Operands

Operands	Function	Data Type
S1	Being compared number address	16/32bit, BIN
S2	Comparand address	16/32bit, BIN


suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•	•	•	•	•	•	•	•		
	S2	•	•	•	•	•	•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

16 bits instruction	32 bits instruction	Activate Condition	Not Activate Condition
AND=	DAND=	(S1) = (S2)	(S1) ≠ (S2)
AND>	DAND>	(S1) > (S2)	(S1) ≤ (S2)
AND<	DAND<	(S1) < (S2)	(S1) ≥ (S2)
AND<>	DAND<>	(S1) ≠ (S2)	(S1) = (S2)
AND≤	DAND≤	(S1) ≤ (S2)	(S1) > (S2)
AND≥	DAND≥	(S1) ≥ (S2)	(S1) < (S2)

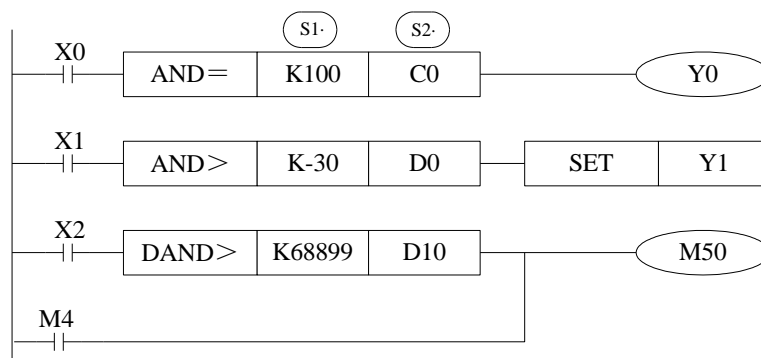

Note Items

When the source data's highest bit (16 bits: b15, 32 bits: b31) is 1, it is seemed to negative number.

The comparison of 32 bits counter should use 32 bits instruction. If using 16 bits instruction, the program or operation will be error.

4-4-3. Parallel Compare [OR]

1. Summary

OR: parallel connection comparison instruction.

Parallel Compare [OR]			
16 bits	As below	32 bits	As below
Execution condition	-	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	Being compared number address	16/32 bit,BIN
S2	Comparand address	16/32 bit,BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•	•	•	•	•	•	•	•		
	S2	•	•	•	•	•	•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

16 bits instruction	32 bits instruction	Activate Condition	Not Activate Condition
OR=	DOR=	(S1) = (S2)	(S1) ≠ (S2)
OR>	DOR>	(S1) > (S2)	(S1) ≤ (S2)
OR<	DOR<	(S1) < (S2)	(S1) ≥ (S2)
OR<>	DOR<>	(S1) ≠ (S2)	(S1) = (S2)
OR≤	DOR≤	(S1) ≤ (S2)	(S1) > (S2)
OR≥	DOR≥	(S1) ≥ (S2)	(S1) < (S2)

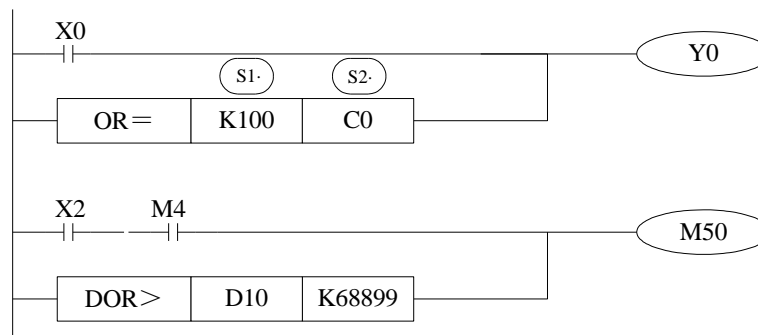


Note Items

When the source data's highest bit (16 bits: b15, 32 bits: b31) is 1, it is seemed to negative number.

The comparison of 32 bits counter should use 32 bits instruction. If using 16 bits instruction, the program or operation will be error.

Example: forbid the outputs when it reaches the certain time. In the below program, when the date is June 30th, 2012, all the outputs will be disabled. The password 1234 is stored in (D4000, D4001). When the password is correct, all the outputs are enabled.

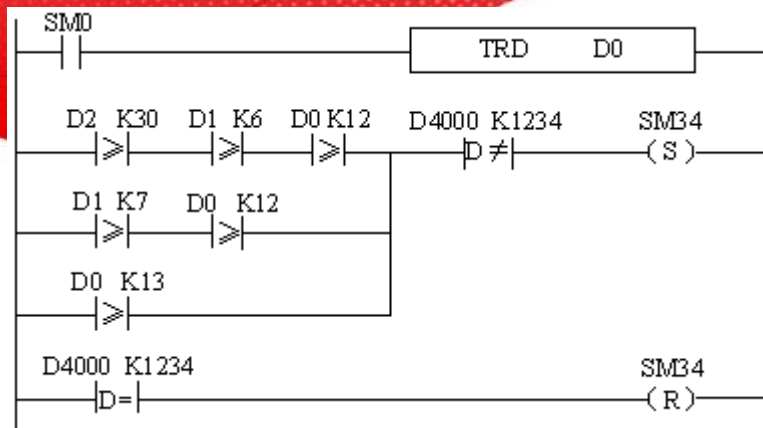

```

LD    SM0                //SM0 is always ON coil
TRD   D0                 //read the RTC (real time clock) value and store in D0~D6
LD>=  D2    K30          //RTC date ≥30
AND>=      D1    K6      //RTC month ≥6
AND>=      D0    K12     //RTC year ≥12
LD>=  D1    K7           //or RTC month ≥ 7
AND>=      D0    K12     //RTC year ≥ 12
ORB                      //or
OR>=  D0    K13          //RTC year ≥ 13
DAND<>    D4000 K1234    //and password ≠1234
SET    SM34              //set ON M34, all the outputs are disabled
DLD=   D4000 K1234      //password=1234, correct password
RST    SM34              //reset M34, all the outputs are enabled

```

4-5. Data Move Instructions

Mnemonic	Function	Chapter
CMP	Data compare	4-5-1
ZCP	Data zone compare	4-5-2
MOV	Move	4-5-3
BMOV	Data block move	4-5-4
PMOV	Data block move (with faster speed)	4-5-5
FMOV	Fill move	4-5-6
EMOV	Float number move	4-5-7
FWRT	FlashROM written	4-5-8
MSET	Zone set	4-5-9
ZRST	Zone reset	4-5-10
SWAP	The high and low byte of the destinated devices are exchanged	4-5-11
XCH	Exchange two data	4-5-12

4-5-1. Data Compare [CMP]

1. Summary

Compare the two data, output the result.

Data compare [CMP]			
16 bits	CMP	32 bits	DCMP
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S1	Specify the data (to be compared) or soft component's address code	16 bit,BIN
S	Specify the comparand's value or soft component's address code	16 bit,BIN
D	Specify the compare result's address code	bit

3. Suitable soft component

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•	•	•	•	•	•	•	•		
	S	•	•	•	•	•	•	•	•	•		
Bit	Operand	System										
		X	Y	M*	S*	T*	C*	Dnm				
	D		•	•	•							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T, HT; C includes C, HC.



Compare data $S1$ and D , show the result in three soft components starting from D , $+1$, $+2$: the three soft components will show the compare result.

4-5-2. Data zone compare [ZCP]

1. Summary

Compare the current data with the data in the zone, output the result.

Data Zone compare [ZCP]			
16 bits	ZCP	32 bits	DZCP
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S1	The low limit of zone	16 bit, BIN
S2	The high limit of zone	16 bit, BIN
S	The current data address	16 bit, BIN
D	The compare result	bit

3. Suitable soft components

	Operand	System								Constant	Module	
		D [*]	FD	TD [*]	CD [*]	DX	DY	DM [*]	DS [*]	K/H	ID	QD
Word	S1	•	•	•	•	•	•	•	•	•		
	S2	•	•	•	•	•	•	•	•	•		
	S	•	•	•	•	•	•	•	•	•		
Bit	Operand	System										
		X	Y	M [*]	S [*]	T [*]	C [*]	Dnm				
	D		•	•	•							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T, HT; C includes C, HC.

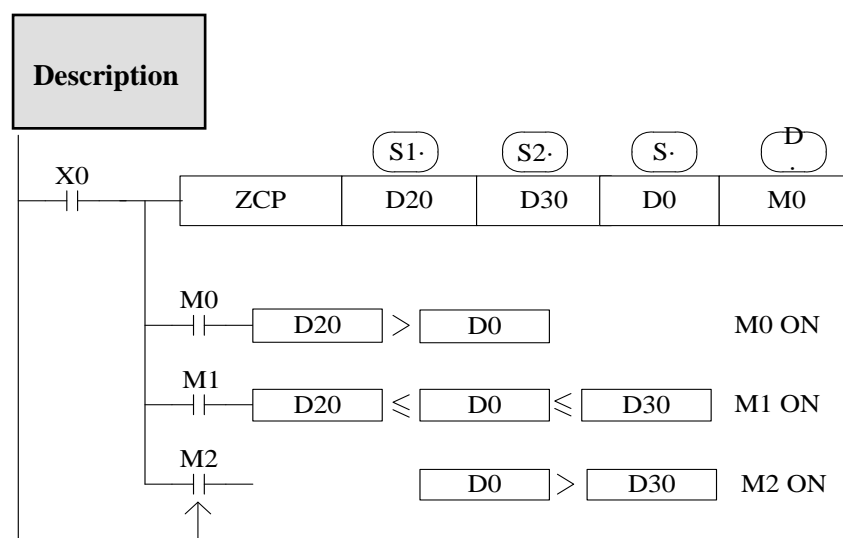

Even X0=OFF stop ZCP instruction, M0~M2 will keep the original status

Compare S₁ with S₂ and S, output the three results starting from D₀, D₀ + 1, D₀ + 2 : store the three results

4-5-3. MOV [MOV]

1. Summary

Move the specified data to the other soft components

MOV [MOV]			
16 bits	MOV	32 bits	DMOV

Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Specify the source data or register's address code	16 bit/32 bit, BIN
D	Specify the target soft component's address code	16 bit/32 bit, BIN

3. Suitable soft component

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•	•	•	•	•	•	•	•	•	
	D	•		•	•		•	•	•			•


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description


Move the source data to the target

When X0 is off, the data will not change

Move K10 to D10




<read the counter or timer current value>



(The current value of T0) → (D20)

The same as counter

<indirect set the timer value>




(K10) (D20)

D20=K10

< Move the 32bits data >

Please use DMOV when the value is 32 bits, such as MUL instruction, high speed counter...



(D1, D0) → (D11, D10)

(the current value of HSC0) → (D21, D20)

4-5-4. Data block Move [BMOV]

1. Summary

Move the data block to other soft component

Data block move [BMOV]			
16 bits	BMOV	32 bits	-
Execution condition	Normally ON/OFF coil, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Specify the source data block or soft component address code	16 bits, BIN; bit
D	Specify the target soft components address code	16 bits, BIN; bit
n	Specify the move data's number	16 bits, BIN;

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•	•	•	•	•	•	•			
	D	•		•	•		•	•	•			
	n	•		•	•	•		•	•	•		
Bit	Operand	System										
		X	Y	M*	S*	T*	C*	Dnm				
	S	•	•	•								
	D	•	•	•								


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


M includes M, HM, SM; S includes S, HS; T includes T and HT; C includes C and HC.

Description


Move the source data block to the target data block. The data quantity is n.

<word move>

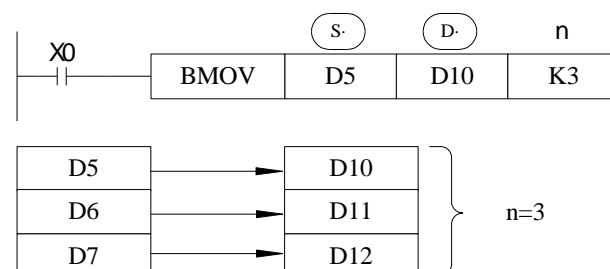

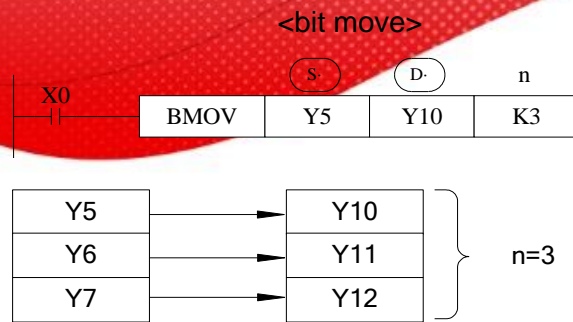

As the following picture, when the data address overlapped, the instruction will do from 1 to 3.

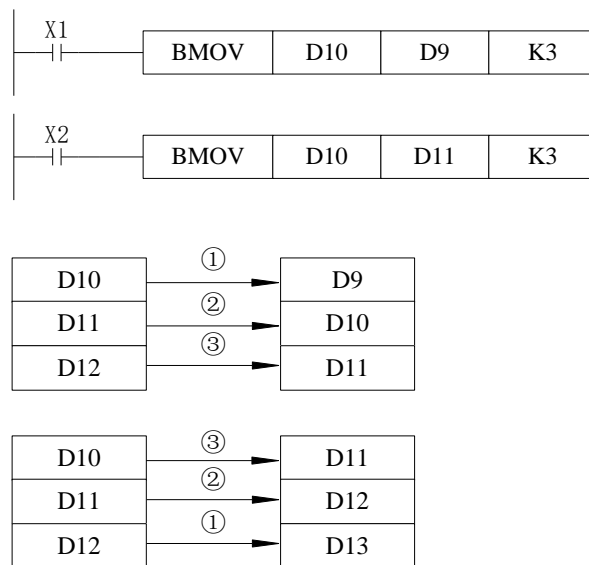

4-5-5. Data block Move [PMOV]

1. Summary

Move the specified data block to the other soft components

Data block mov[PMOV]			
16 bits	PMOV	32 bits	-
Execution condition	Normally ON/OFF coil, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Specify the source data block or soft component address	16 bits, BIN; bit
D	Specify the target soft components address	16 bits, BIN; bit
n	Specify the data quantity	16 bits, BIN;

3. Suitable soft components

Word

Operand	System								Constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S	•	•	•	•	•	•	•	•			
D	•		•	•		•	•	•			
n	•		•	•		•	•	•	•		

Bit


Operand	System						
	X	Y	M*	S*	T*	C	Dnm
S	•	•	•				
D	•	•	•				

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T and HT; C includes C and HC.

Description

Move the source data block to target data block, the data quantity is n

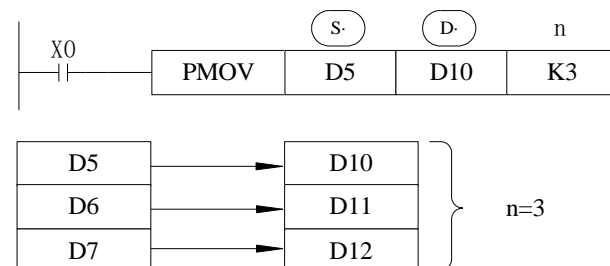

The function of PMOV and BMOV is mostly the same, but the PMOV execution speed is faster.

PMOV finish in one scan cycle, when executing PMOV, close all the interruptions.

Mistake may happen if the source address and target address are overlapped.

4-5-6. Fill Move [FMOV]

1. Summary

Move the specified data to the other soft components

Fill Move [FMOV]			
16 bits	FMOV	32 bits	DFMOV
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Specify the source data or soft component address	16/32 bits, BIN;
D	Specify the target soft components address	16/32 bits, BIN;
n	Specify the move data's number	16/32 bits, BIN;


3. Suitable soft component

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•	•	•	•	•	•	•	•		
	D	•		•	•		•	•	•			
	n	•		•	•		•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

<16 bits instruction>




Move K0 to D0~D9, copy a single data device to a range of destination device

Move the source data to target data, the target data quantity is n


If the set range exceeds the target range, move to the possible range

<32 bits instruction >




Move D0.D1 to D10.D11:D12.D13:D14.D15.

<16 bits Fill Move >



<32 bits Fill move>



4-5-7. Floating move [EMOV]

Summary

Move the float number to target address

Floating move [EMOV]			
16 bits	-	32 bits	EMOV
Execution condition	Normally on/off, edge trigger	Suitable models	XD, XL
Hardware	-	Software	-

Operands

Operand	Function	Type
S	Source soft element address	32 bits, BIN
D	Destination soft element address	32 bits, BIN

Suitable soft element


Word	Operand	System								Constant	Module	
		D [*]	FD	TD [*]	CD [*]	DX	DY	DM [*]	DS [*]	K/H	ID	QD
	S	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

<32 bits instruction>


Binary floating → binary floating



(D1, D0) → (D11, D10)

X0 is ON, send the floating number from (D1, D0) to (D11, D10).

X0 is OFF, the instruction doesn't work



(K500) → (D11, D10)

If constant value K, H is source soft element, they will be converted to floating number.

K500 will be converted to floating value.

4-5-8. FlashROM Write [FWRT]

1. Summary

Write the specified data to FlashRom register.

FlashROM Write [FWRT]			
16 bits	FWRT	32 bits	DFWRT
Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operand	Function	Data Type
S	The data write in the source or save in the soft element	16 bits/32 bits, BIN
D	target soft element	16 bits/32 bits
D1	target soft element start address	16 bits/32 bits

D2	Write in data quantity	16 bits/32 bits, BIN
----	------------------------	----------------------


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•	•	•	•	•	•	•	•		
D			•									
D1			•									
D2		•		•	•	•	•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description

< Written of single word >




Write value from D0 to FD0

<Written of double words>



Write value from D0,D1 to FD0,FD1

<Written of multi-word>



Write value from D0, D1, D2 to FD0, FD1, FD2

※1: FWRT instruction only can write data into FlashRom register. FlashRom can keep the data even the power supply is off. It can store the important technical parameters.

※2: Written of FWRT needs a long time, about 150ms, so frequently write-in is not recommended

※3: The written time of Flashrom is about 1,000,000 times. So we suggest using edge signal (LDP, LDF etc.) to activate the instruction.

※4: Frequently write-in will damage the FlashRom.

4-5-9. Zone set [MSET]

Summary

Set the soft element in certain range

Multi-set [MSET]			
16 bits	MSET	32 bits	-
Execution condition	Normally ON/OFF; falling or rising pulse edge signal	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
D1	Start soft element address	bit
D2	End soft element address	bit

3. Suitable soft components

Bit	Operand	System						
		X	Y	M*	S*	T*	C*	Dnm
D1		•	•	•	•	•	•	
D2		•	•	•	•	•	•	

*Notes: M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Description



Set ON M10~M120

Set the coil from M10 to M120

(D1) (D2) are specified as the same type of soft component and (D2) < (D1) > (D2), will not run Zone set, but set SM409 SD409 = 2

4-5-10. Zone reset [ZRST]

Summary

Reset the soft element in the certain range

Multi-reset [ZRST]			
16 bits	ZRST	32 bits	-
Execution condition	Normally ON/OFF, falling or rising pulse edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
D1	Start address of soft element	Bit, 16 bits, BIN
D2	End address of soft element	Bit, 16 bits, BIN

16 bits	SWAP	32 bits	-
Execution condition	Falling or rising pulse edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S	The address of the soft element	16 bits; BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	●		●	●							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



Exchange the high 8-bit and low 8-bit of 16-bit register.

If this instruction is activated by normal ON/OFF coil, the instruction will be executed in every scanning period when X0 is ON. Falling or rising pulse is recommended to activate the instruction.

4-5-12. Exchange [XCH]

1. Summary

Exchange the data in two soft element

Exchange [XCH]			
16 bits	XCH	32 bits	DXCH
Execution condition	Rising or falling pulse edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
D1	The soft element address	16 bits/32 bits, BIN
D2	The soft element address	16 bits/32 bits, BIN


3. Suitable soft component

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D1	•		•	•		•	•	•			
	D2	•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

<16 bits instruction>




Before (D10) =100 → After (D10) =101
(D11) =101 (D11) =100

The contents of the two destination devices D1 and D2 are swapped,

When X0 is ON, the instruction will be executed in every scanning period. Falling or rising pulse is recommended to activate the instruction.

<32 bits instruction >



32 bits instruction [DXCH] swaps the dword value D10, D11 and D20, D21.

Before (D10) =100	→ after (D10) =200
(D11) =1 (D11D10) =65636	(D11) =10 (D11D10) =655460
(D20) =200	(D20) =100
(D21) =10 (D21D20) =655460	(D21) =1 (D21D20) =65636

4-6. Data Operation Instructions

Mnemonic	Function	Chapter
ADD	Addition	4-6-1
SUB	Subtraction	4-6-2
MUL	Multiplication	4-6-3
DIV	Division	4-6-4
INC	Increment	4-6-5
DEC	Decrement	4-6-5
MEAN	Mean	4-6-6
WAND	Logic Word And	4-6-7
WOR	Logic Word Or	4-6-7
WXOR	Logic Exclusive Or	4-6-7
CML	Compliment	4-6-8
NEG	Negation	4-6-9

4-6-1 Addition [ADD]

1. Summary

Add two numbers and store the result

Add [ADD]			
16 bits	ADD	32 bits	DADD
Execution condition	Normal ON/OFF/falling or rising pulse edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
Three operands		
S1	The add operation data address	16 bit/32 bit, BIN
S2	The add operation data address	16 bit/32bit, BIN
D	The result address	16 bit/32bit, BIN
Two operands		
D	Be Added data and result data address	16 bit/32bit, BIN
S1	Add data address	16 bit/32bit, BIN

3. Suitable soft components


Word

Operand	System								constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
Three operands											
S1	•	•	•	•	•	•	•	•	•		
S2	•	•	•	•	•	•	•	•	•		
D	•		•	•		•	•	•			
Two operands											
D	•										
S1	•	•							•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

< Three operands >




Two source data do binary addition and send the result to target address. Each data's highest bit is the sign bit, 0 stands for positive, 1 stands for negative. All calculations are algebraic processed. $(5 + (-8) = -3)$

If the result of a calculation is "0", the "0" flag acts. If the result exceeds 323767 (16 bits limit) or 2147483647 (32 bits limit), the carry flag acts. (refer to the next page). If the result exceeds -323768 (16 bits limit) or -2147483648 (32 bits limit), the borrow flag acts (refer to the next page).

When doing 32 bits operation, word device's low 16 bits are assigned; the device close to the preceding device's is the high bits. To avoid ID repetition, we recommend you assign device's ID to be even number.

The source and target address can be the same. In the above example, when X0 is ON, the instruction will be executed in every scanning period.

<Two operands>



$$(D10) + (D12) \rightarrow (D10)$$


Two source data do binary addition and send the result to addend data address. Each data's highest bit is the sign bit, 0 stands for positive, 1 stands for negative. All calculations are algebraic processed. $(5 + (-8) = -3)$

If the result of a calculation is "0", the "0" flag acts. If the result exceeds 323767 (16 bits limit) or 2147483647 (32 bits limit), the carry flag acts. (refer to the next page). If

the result exceeds -323768 (16 bits limit) or -2147483648 (32 bits limit), the borrow flag acts (refer to the next page).

When doing 32 bits operation, word device's low 16 bits are assigned; the device close to the preceding device's is the high bits. To avoid ID repetition, we recommend you assign device's ID to be even number.

In the above example, when X0 is ON, the instruction will be executed in every scanning period. The rising or falling pulse edge is recommended to activate the instruction.



The two instructions are the same.

Related flag

Flag meaning

Flag	Name	Function
SM020	Zero	ON: the calculate result is zero OFF: the calculate result is not zero
SM021	Borrow	ON: the calculate result is over -32768(16 bit) or -2147483648(32bit) OFF: the calculate result is less than -32768(16 bit) or -2147483648(32bit)
SM022	Carry	ON: the calculate result is over 32768(16 bit) or 2147483648(32bit) OFF: the calculate result is less than 32768(16 bit) or 2147483648(32bit)

4-6-2. Subtraction [SUB]

1. Summary

Two numbers do subtraction, store the result

Subtraction [SUB]			
16 bits	SUB	32 bits	DSUB
Execution condition	Normally ON/OFF/rising or falling pulse edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

Operands

Operands	Function	Data Type
Three operands		

S1	The sub operation data address	16 bits /32 bits,BIN
S2	The sub operation data address	16 bits /32 bits,BIN
D	The result address	16 bits /32 bits,BIN
Two operands		
D	Be subtracted data and result address	16 bits /32 bits,BIN
S1	Subtract data address	16 bits /32 bits,BIN


Suitable soft component

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	Three operands											
	S1	●	●	●	●	●	●	●	●	●		
	S2	●	●	●	●	●	●	●	●	●		
	D	●		●	●		●	●	●			
	Two operands											
	D	●										
	S1	●	●							●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

<Three operands>




(S1) appoint the soft unit's content, subtract the soft unit's content appointed by (S2) in the format of algebra. The result will be stored in the soft unit appointed by (D) (5-(-8)=13).

The action of each flag, the setting method of 32 bits operation's soft units are both the same with the preceding ADD instruction.

The importance is: in the preceding program, if X0 is ON, SUB operation will be executed every scan cycle.

Refer to chapter 4-6-1 for flag action and functions.

<Two operands>




(S1) appoint the soft unit's content, subtract the soft unit's content appointed by (D) in the format of algebra. The result will be stored in the soft unit appointed by (D) (5-(-8)=13)

The action of each flag, the setting method of 32 bits operation's soft units are both the same with the preceding ADD instruction.

The importance is: in the preceding program, if X0 is ON, SUB operation will be executed every scan cycle. Rising or falling pulse edge is recommended to activate the instruction.

Refer to chapter 4-6-1 for flag action and functions.

The relationship of the flag's action and value's positive/negative is shown below:



4-6-3. Multiplication [MUL]

1. Summary

Multiply two numbers, store the result

Multiplication [MUL]			
16 bits	MUL	32 bits	DMUL
Execution condition	Normally ON/OFF / pulse edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	The multiplication operation data address	16 bits/32bits,BIN
S2	The multiplication operation data address	16 bits/32bits,BIN
D	The result address	16 bits/32bits,BIN


3. Suitable soft component

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S1		•	•	•	•	•	•	•	•	•		
S2		•	•	•	•	•	•	•	•	•		
D		•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

<16 bits Operation>




The contents of the two source devices are multiplied together and the result is stored at the destination device in the format of 32 bits. As the above chart: when (D0)=8, (D2)=9, (D5, D4) =72.

The result's highest bit is the symbol bit: positive (0), negative (1).

In the above example, when X0 is ON, the instruction will be executed in every scanning period.

<32 bits Operation >



When use 32 bits operation, the result is stored :
of 64 bits.

Even use word device, 64 bits results can't be monitored.

Please change to floating value operation for this case.

4-6-4. Division [DIV]

1. Summary

Divide two numbers and store the result

Division [DIV]			
16 bits	DIV	32 bits	DDIV
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	The divide operation data address	16 bits / 32 bits, BIN

S2	The divide operation data address	16 bits /32 bits, BIN
D	The result address	16 bits /32 bits, BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•	•	•	•	•	•	•	•		
	S2	•	•	•	•	•	•	•	•	•		
	D	•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description


<16 bits operation >



Dividend	Divisor	Result	Remainder
BIN	BIN	BIN	BIN
(D0)	÷ (D2)	→ (D4)	--- (D5)
16 bits	16 bits	16 bits	16 bits

(S1) appoints the dividend soft component, (S2) appoints the divisor soft component, and the next address appoint the soft component of the result and the remainder. In the above example, if input X0 is ON, division operation is executed every scan cycle.

<32 bits operation >



Dividend	Divisor	Result	Remainder
BIN	BIN	BIN	BIN
(D1, D0)	÷ (D3, D2)	(D5, D4)	--- (D7, D6)
32 bits	32 bits	32 bits	32 bits

The dividend is composed by the device appointed by D_1 and the next one. The divisor is composed by the device appointed by D_2 and the next one. The result and the remainder are stored in the four sequential devices, the first one is appointed by D_3 . If the value of the divisor is 0, the instruction will be error.

The highest bit of the result and remainder is the symbol bit (positive:0, negative: 1). When any of the dividend or the divisor is negative, then the result will be negative. When the dividend is negative, then the remainder will be negative.

4-6-5. Increment [INC] & Decrement [DEC]

1. Summary

Increase or decrease the number

Increase one [INC]			
16 bits	INC	32 bits	DINC
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Decrease one [DEC]			
16 bits	DEC	32 bits	DDEC
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
D	The increase or decrease data address	16 bits / 32bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D	●		●	●		●	●	●			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

< Increment [INC]>



$$(D0) + 1 \rightarrow (D0)$$

(D-) will increase one when X0 is ON.

For 16 bits operation, when +32767 increase one, it will become -32768; for 32 bits operation, +2147483647 increases one is -2147483647. The flag bit will act.

<Decrement [DEC]>



$$(D0) - 1 \rightarrow (D0)$$

(D-) will decrease one when X1 is ON.

-32767 or -2147483647 decrease one, the result will be +32767 or +2147483647. The flag bit will act.

4-6-6. Mean [MEAN]

1. Summary

Get the mean value of data

Mean [MEAN]			
16 bits	MEAN	32 bits	DMEAN
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S	The source data start address	16 bits, BIN
D	The mean result address	16 bits, BIN
n	The data quantity	16 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D ^{*注}	FD	TD ^{*注}	CD ^{*注}	DX	DY	DM ^{*注}	DS ^{*注}	K/H	ID	QD
	S	●	●	●	●		●	●	●			
	D	●		●	●		●	●	●			
	n									●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



$$\frac{(D0) + (D1) + (D2)}{3} \longrightarrow (D10)$$

Store the mean value of source data (source sum divide by source quantity n). give the remainder .

The n cannot larger than soft component quantity, otherwise there will be error.

4-6-7. Logic AND [WAND], Logic OR[WOR], Logic Exclusive OR [WXOR]

1. Summary

Do logic AND, OR, XOR for data

Logic AND [WAND]			
16 bits	WAND	32 bits	DWAND
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Logic OR[WOR]			
16 bits	WOR	32 bits	DWOR
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Logic Exclusive OR [WXOR]			
16 bits	WXOR	32 bits	DWXOR
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	The operation data address	16bit/32bit,BIN
S2	The operation data address	16bit/32bit,BIN
D	The result address	16bit/32bit,BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•	•	•	•	•	•	•	•		
	S2	•	•	•	•	•	•	•	•	•		
	D	•		•	•		•	•	•			


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description


< Logic AND >




< Logic OR >



< Logic WXOR >




If use this instruction along with CML instruction, XOR executed.



Example 1:

The 16 bits data is composed by X0~X7, and store in D0.




Transform the state of X0, X1, X2, X3 to 8421 code and store in D0.



Example 2:

Combine the low 8 bits of D0 and D2 to a word.



```
LDP  X0
WAND D0  HFF  D10  //X0 rising edge
WAND D2  HFF  D12  //Logic and, take the low 8 bits of D0 and save in D10
SWAP D12  // Logic and, take the low 8 bits of D2 and save in D12
WOR  D10  D12  D20  //swap the low 8 bits and high 8 bits of D12
                        //combine the low 8 bits of D10 and high 8 bits of D12,
                        and save in D20
```

4-6-8. Logic converse [C

1. Summary

Logic converse the data

Converse [CML]			
16 bits	CML	32 bits	DCML
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operand s	Function	Data Type
S	Source data address	16 bits/32 bits, BIN
D	Result address	16 bits/32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•	•	•	•	•	•	•	•		
	D	•		•	•		•	•	•			


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

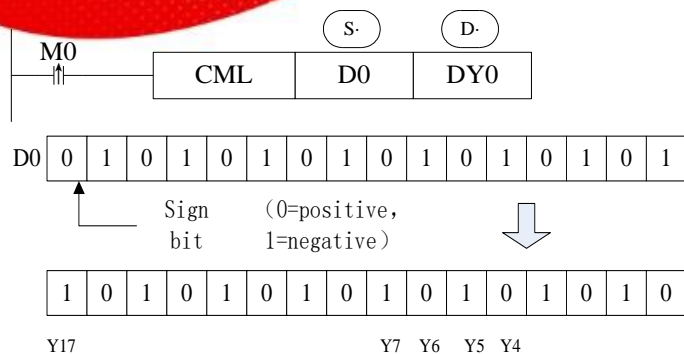

Each data bit in the source device is reversed (1→0, 0→1) and sent to the destination device. If use constant K in the source device, it can be auto convert to be binary. This instruction is fit for PLC logical converse output.

< Read the converse input >



The sequential control instruction in the left could be denoted by the following CML instruction.

4-6-9. Negative [NEG]

1. Summary

Get the negative data

Negative [NEG]			
16 bits	NEG	32 bits	DNEG
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
D	The source data address	16 bits/ 32 bits, BIN

3. Suitable soft components

Word	Operand	System							Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID
	D	●		●	●		●	●	●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description



Converse each bit of source data (1→0, 0→1), then plus one and store the result in the source data address.

For example, the source data D10 is 20, when M0 rising edge is coming, D10 become -20.

The following two instructions are the same.



4-7. Shift Instructions

Mnemonic	Function	Chapter
SHL	Arithmetic shift left	4-7-1
SHR	Arithmetic shift right	4-7-1
LSL	Logic shift left	4-7-2
LSR	Logic shift right	4-7-2
ROL	Rotation left	4-7-3
ROR	Rotation right	4-7-3
SFTL	Bit shift left	4-7-4
SFTR	Bit shift right	4-7-5
WSFL	Word shift left	4-7-6
WSFR	Word shift right	4-7-7

4-7-1. Arithmetic shift left [SHL], Arithmetic shift right [SHR]

1. Summary

Do arithmetic shift left/right for the numbers

Arithmetic shift left [SHL]

16 bits	SHL	32 bits	DSHL
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Arithmetic shift right [SHR]			
16 bits	SHR	32 bits	DSHR
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
D	The source data address	16bit/32bit,BIN
n	Shift left or right times	16bit/32bit,BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D	•		•	•		•	•	•			
	n									•		


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description


After executing SHL once, the lowest bit is filled with 0, the last bit is stored in carry flag.

After executing SHR once, the highest bit is the same; the last bit is stored in carry flag.

< Arithmetic shift left >

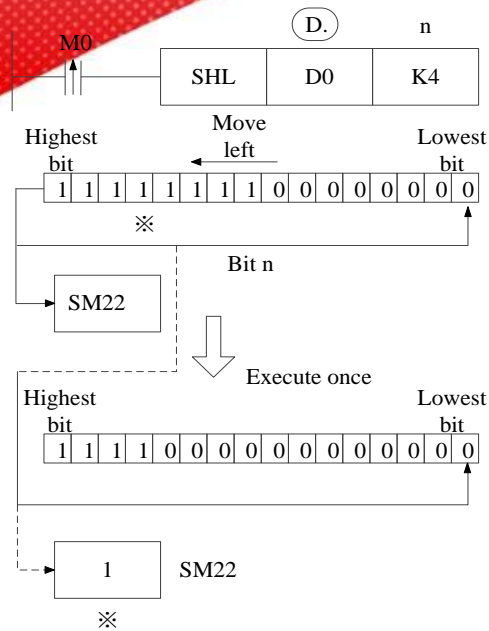

< Arithmetic shift right >

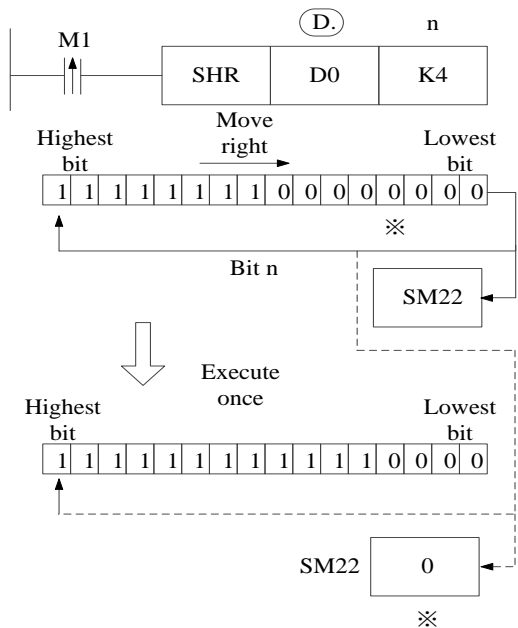

4-7-2. Logic shift left [LSL], Logic shift right [LSR]

1. Summary

Do logic shift right/left for the data

Logic shift left [LSL]			
16 bits	LSL	32 bits	DLSL
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Logic shift right [LSR]			
16 bits	LSR	32 bits	DLSR

Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
D	Source data address	16 bits/32 bits, BIN
n	Arithmetic shift left/right times	16 bits/32bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D	•		•	•		•	•	•			
	n									•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

After executing LSL once, the lowest bit is filled with 0; the last bit is stored in carry flag.



LSL meaning and operation are the same to SHL.

After executing LSR once, the highest bit is filled with 0; the last bit is stored in carry flag.

LSR and SHR are different, LSR add 0 in the highest bit when moving, SHR all bits are moved.

< Logic shift left >

< Logic shift right >

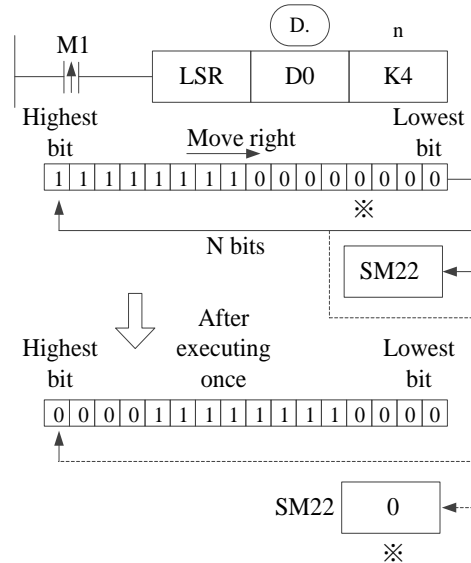

4-7-3. Rotation shift left [ROL], Rotation shift right [ROR]

1. Summary

Cycle shift left or right

Rotation shift left [ROL]			
16 bits	ROL	32 bits	DROL
Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-
Rotation shift right [ROR]			
16 bits	ROR	32 bits	DROR
Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
D	Source data address	16 bits/32 bits, BIN
n	Shift right or left times	16 bits/32 bits, BIN

3. Suitable soft components


Word	Operand	System							Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID
	D	●		●	●		●	●	●		
n									●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description

When X0 changes from OFF to ON, the value will be cycle moved left or right, the last bit is stored in carry flag.

< Cycle shift left >



< Cycle shift right >

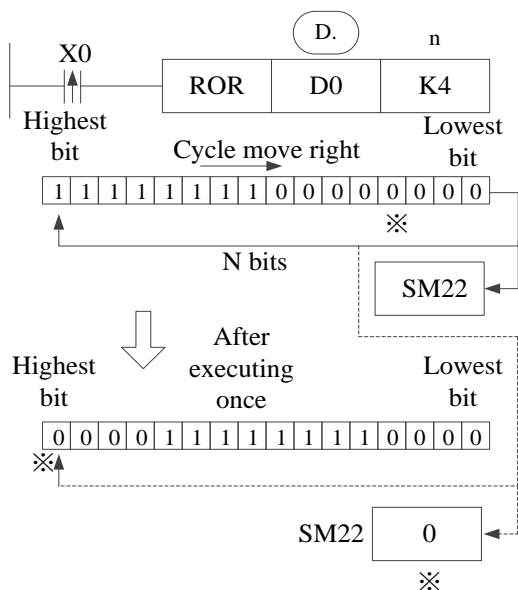

4-7-4. Bit shift left [SFTL]

1. Summary

Bit shift left

Bit shift left [SFTL]			
16 bits	SFTL	32 bits	DSFTL

Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Types
S	Source soft element head address	bit
D	Target soft element head address	bit
n1	Source data quantity	16 bits /32 bits, BIN
n2	Shift left times	16 bits/32 bits, BIN

3. Suitable soft components

Word

Operand	System								Constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
n1	●		●	●	●	●	●	●	●		
n2	●		●	●	●	●	●	●	●		

Bit

Operand	System						
	X	Y	M*	S*	T*	C*	Dnm
S	●	●	●	●	●	●	
D		●	●	●	●	●	

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


M includes M, HM, SM; S includes S, HS; T includes T, HT; C includes C, HC.

Description

Move n2 bits left for the object which contains n1 bits.

When X0 changes from OFF to ON, the instruction will move n2 bits for the object.

For example, if n2 is 1, the object will move 1 bit left when the instruction executes once.

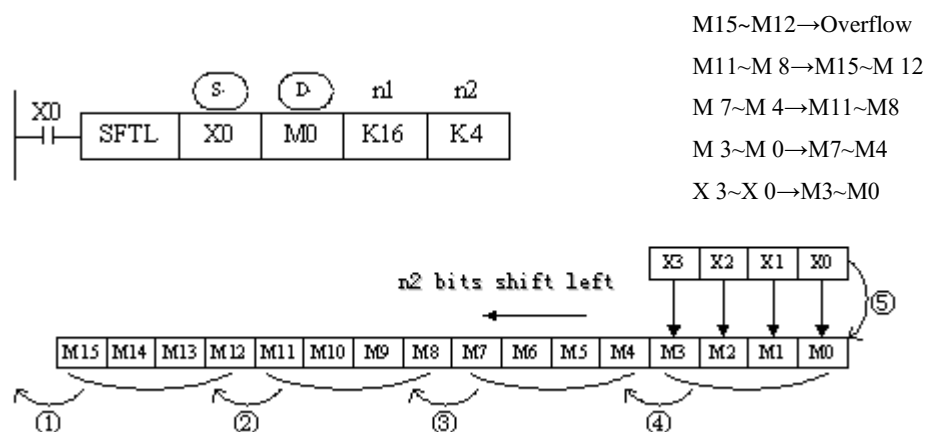

4-7-5. Bit shift right [SFTR]

1. Summary

Bit shift right

Bit shift right [SFTR]			
16 bits	SFTR	32 bits	DSFTR
Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Source soft element head address	bit
D	Target soft element head address	bit
n1	Source data quantity	16 bits/32 bits, BIN
n2	Shift right times	16 bits/32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	n1	•		•	•	•	•	•	•	•		
	n2	•		•	•	•	•	•	•	•		
Bit	Operand	System										
		X	Y	M*	S*	T*	C*	Dnm				
	S	•	•	•	•	•	•					
	D		•	•	•	•	•					

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


M includes M, HM, SM; S includes S, HS; T includes T, HT; C includes C, HC.

Description


Move n2 bits right for the object which contains n1 bits.

When X0 changes from OFF to ON, the instruction will move n2 bits for the object.

For example, if n2 is 1, the object will move 1 bit right when the instruction executes once.



- M 3~M 0→Overflow
- M 7~M 4→M3~M0
- M11~M 8→M7~M4
- M15~M12→M11~M8
- X 3~X 0→M15~M12



4-7-6. Word shift left [WSFL]

1. Summary

Word shift left

Word shift left [WSFL]			
16 bits	WSFL	32 bits	-
Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operand	Function	Data Type
S	Source soft element head address	16 bits, BIN
D	Target soft element head address	16 bits, BIN
n1	Source data quantity	16 bits, BIN
n2	Word shift left times	16 bits, BIN

3. Suitable soft components


Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	●	●	●	●	●	●	●	●			
	D	●		●	●		●	●	●			
	n1	●		●	●		●	●	●	●		
	n2	●		●	●		●	●	●	●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

Move n2 words left for the object which contains n1 words.

When X0 changes from OFF to ON, the instruction will move n2 words for the object.

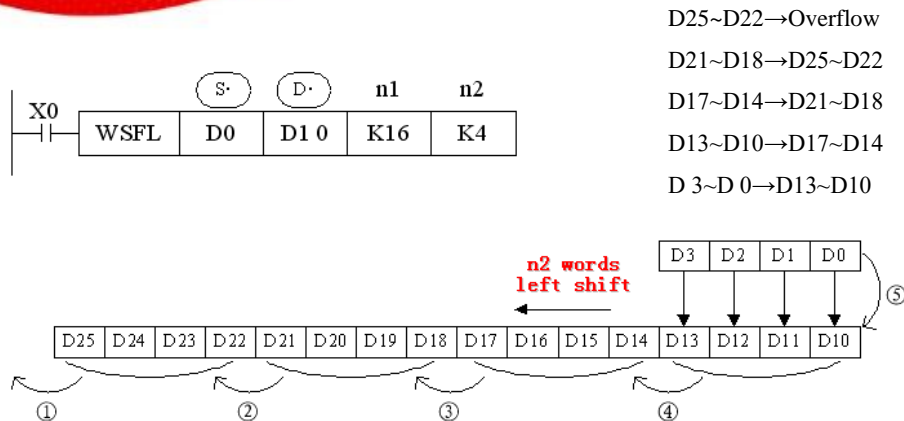

4-7-7. Word shift right [WSFR]

1. Summary

Word shift right

Word shift right [WSFR]			
16 bits	WSFR	32 bits	-
Execution condition	rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Source soft element head address	16 bits, BIN
D	Target soft element head address	16 bits, BIN
n1	Source data quantity	16 bits, BIN
n2	Shift right times	16 bits, BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	HD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•	•	•	•	•	•	•			
	D	•		•	•		•	•	•			
	n1	•		•	•		•	•	•	•		
	n2	•		•	•		•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Move **n2** words right for the object which contains **n1** words.

When X0 changes from OFF to ON, the instruction will move n2 words for the object.



4-8. Data Convert

Mnemonic	Function	Chapter
WTD	Single word integer converts to double word integer	4-8-1
FLT	16 bits integer converts to float point	4-8-2
DFLT	32 bits integer converts to float point	4-8-2
FLTD	64 bits integer converts to float point	4-8-2
INT	Float point converts to integer	4-8-3
BIN	BCD convert to binary	4-8-4
BCD	Binary converts to BCD	4-8-5
ASCI	Hex. converts to ASCII	4-8-6
HEX	ASCII converts to Hex.	4-8-7
DECO	Coding	4-8-8
ENCO	High bit coding	4-8-9
ENCOL	Low bit coding	4-8-10
GRY	Binary converts to gray code	4-8-11
GBIN	Gray code converts to binary	4-8-12

4-8-1. Single word integer converts to double word integer [WTD]

1. Summary

Single word integer converts to double word integer [WTD]			
16 bits	WTD	32 bits	-

Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-


2. Operands

Operands	Function	Data Type
S	Source soft element address	16 bits, BIN
D	Target soft element address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD*	TD*	CD*	DX	DY	DM*	DSV	K/H	ID	QD
S		•	•	•	•	•	•	•	•			
D		•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.



When single word D0 is positive integer, after executing this instruction, the high bit of double word D10 is 0.

When single word D0 is negative integer, after executing this instruction, the high bit of double word D10 is 1.

the high bit 0 and 1 is binary value.

4-8-2. 16 bits integer converts to float point [FLT]

1. Summary

16 bits integer converts to float point [FLT]					
16 bits	FLT	32 bits	DFLT	64 bits	FLTD
Execution condition	Normally ON/OFF, rising/falling edge		Suitable Models	XD, XL	
Hardware requirement	-		Software requirement	-	

2. Operands

Operands	Function	Data Type
S	Source soft element address	16 bits/32 bits/64 bits,BIN
D	Target soft element address	32 bits/64 bits,BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	ED	TD*	CD*	DX	DY	DM*	DS*	K/H	ID
	S	●	●								●	
D		●										

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description

<16 bits>




(D10) → (D13,D12)
BIN integer Binary float point

<32 bits >



(D11,D10) → (D13,D12)
BIN integer Binary float point

<64 bits>



(D13,D12,D11,D10) → (D15,D14)
BIN integer Binary float point

Convert BIN integer to binary floating point. As the constant K, H will auto convert by the floating operation instruction, so this FLT instruction can't be used.

The inverse transformation instruction is INT.

FLTD can change the 64 bits integer to 32 bits floating value.



D0 is integer 20, after executing the instruction, D10 is floating value 20.

Note: Before using floating number operation instructions such as EADD, ESUB, EMUL, EDIV, EMOV and ECMP, make sure that all operation parameters are floating number.

4-8-3. Float point converts to integer [INT]

1. Summary

Floating point converts to integer [INT]			
16 bits	INT	32 bits	DINT
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Source soft element address	16 bits/32 bits, BIN
D	Target soft element address	16 bits/32 bits, BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	●	●									
D		●										

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS; the word combined by bits.

Description

<16 bits>



(D11,D10) → (D20)

Binary Float BIN integer

Give up the data after the decimal dot

<32 bits>

(D11,D10) → (D20,D21)

Binary Float BIN integer

Give up the data after the decimal dot



The binary source number is converted into a BIN integer and stored at the destination device. Abandon the value behind the decimal point.

The inverse instruction is FLT.

When the result is 0, the flag bit is ON.

When converting, less than 1 and abandon it, zero flag is ON.

The result is over below data, the carry flag is ON.

16 bits operation: -32,768~32,767

32 bits operation: -2,147,483,648~2,147,483,647



For example, if D0 is floating value 130.2, after executing INT, D10 value is integer 130.

4-8-4. BCD convert to binary [BIN]

1. Summary

BCD convert to binary [BIN]			
16 bits	BIN	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operand	Function	Data Type
S	Source soft element address	BCD
D	Target soft element address	16 bits/32 bits, BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
		•	•	•	•	•	•	•	•			
	S	•		•	•							
	D	•		•	•							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description

Source (BCD) → destination (BIN)



If source data is not BCD code, SM409 will be ON (Operation error), SD409=4 (error occurs).

As constant K automatically converts to binary, so it's not suitable for this instruction. For example: all the information stored in the clock information register SD13~SD19 of PLC is BCD code, but we are used to using decimal value. The time information can be converted from BCD code information to binary:

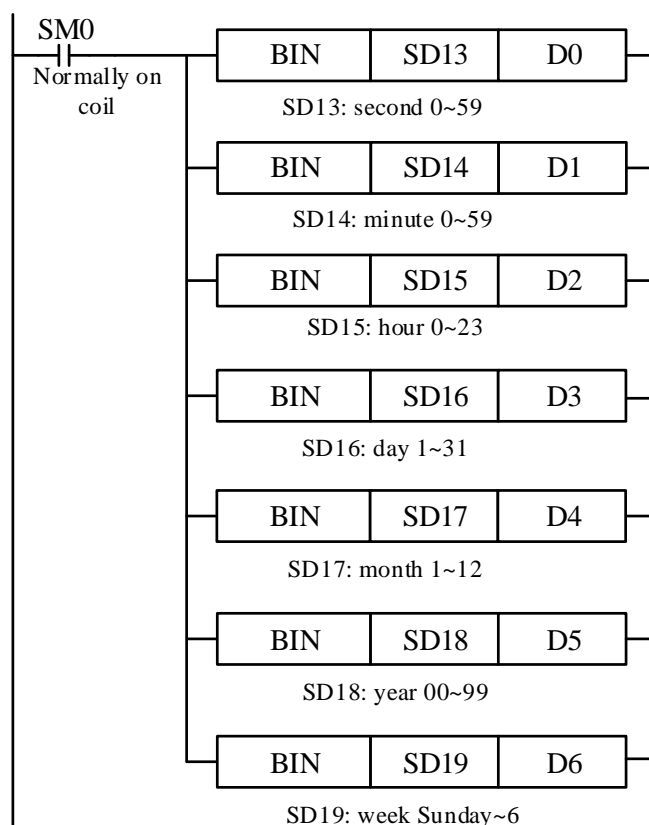

4-8-5. Binary convert to BCD [BCD]

1. Summary

Convert binary data to BCD code

Binary convert to BCD [BCD]			
16 bits	BCD	32 bits	-

Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Source soft element address	16 bits, BIN
D	Target soft element address	BCD code


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•	•	•	•	•	•	•			
D		•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

source (BIN)→destination (BCD)



This instruction can change the binary value to BCD code.

4-8-6. Hex converts to ASCII [ASCII]

1. Summary

Hex. convert to ASCII [ASCII]			
16 bits	ASCII	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S	Source soft element address	2 bits, HEX
D	Target soft element address	ASCII code
n	Transform character quantity	16 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•	•	•	•	•	•	•			
D		•		•	•		•	•	•			
n		•		•	•		•	•	•	•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



Transform the source Hex data to ASCII code, and store in **D200**. The transformation characters are n.

D Will store one ASCII code.

The convert process is this

Assign start device:

(D100)=0ABCH

(D101)=1234H

(D102)=5678H

[0]=30H [1]=31H

[5]=35H [A]=41H

[2]=32H [6]=36H

[B]=42H [3]=33H

[7]=37H [C]=43H

[4]=34H [8]=38H

n D	K1	K2	K3	K4	K5	K6	K7	K8	K9
D200 down	[C]	[B]	[A]	[0]	[4]	[3]	[2]	[1]	[8]
D200 up		[C]	[B]	[A]	[0]	[4]	[3]	[2]	[1]
D201 down			[C]	[B]	[A]	[0]	[4]	[3]	[2]
D201 up				[C]	[B]	[A]	[0]	[4]	[3]
D202 down					[C]	[B]	[A]	[0]	[4]
D202 up						[C]	[B]	[A]	[0]
D203 down							[C]	[B]	[A]
D203 up								[C]	[B]
D204 down									[C]

4-8-7. ASCII convert to Hex.[HEX]

1. Summary

ASCII converts to Hex. [HEX]			
16 bits	HEX	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Date type
S	Source soft element address	ASCII
D	Target soft element address	2 bits, HEX
n	ASCII Character quantity	16 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
		•	•	•	•	•	•	•	•			
	S	•	•	•	•	•	•	•	•			
	D	•		•	•		•	•	•			
	n								•			

*Notes: D includes D, FD, TD includes TD, TFD, CD includes CD, HCD, THCD, HCD, DM includes DM, DHM; DS includes DS, DHS.

Description



Convert the high 8 bits and low 8 bits in source S to HEX data. Move 4 bits every time to destination D . The convert character number is assigned by n.

The convert process is the following:

(S)	ASCII Code	HEX Convert
D200 down	30H	0
D200 up	41H	A
D201 down	42H	B
D201 up	43H	C
D202 down	31H	1
D202 up	32H	2
D203 down	33H	3
D203 up	34H	4
D204 down	35H	5

n (D)	D102	D101	D100
1	Not change to be 00H
2			..0AH
3			.0ABH
4			0ABCH
5		...0H	ABC1H
6		..0AH	BC12H
7		.0ABH	C123H
8		0ABCH	1234H
9		...	ABC1H 2345H

n=k4

D200	0	1	0	0	0	0	0	1	0	0	1	1	0	0	0	0
	41H? [A]								30H? [0]							
D201	0	1	0	0	0	0	1	1	0	1	0	1	0	0	1	0
	43H? [C]								42H? [B]							
D100	0	0	0	0	1	0	1	0	1	0	1	1	1	1	0	0
	0		A		B		C									

4-8-8. Coding [DECO]

Summary

Change any data or bit to 1.

Coding [DECO]			
16 bits	DECO	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	The source data address	16 bits, BIN
D	The decode result head address	16 bits, BIN
n	The decoding soft element bit quantity	16 bits, BIN

3. Suitable soft components


Word	Operand	System								Constant	Module	
		D [*]	FD	TD [*]	CD [*]	DX	DY	DM [*]	DS [*]	K/H	ID	QD
	S	•	•	•	•	•	•	•	•			
	n									•		
Bit	Operand	System										
		X	Y	M [*]	S [*]	T [*]	C [*]	Dnm				
	D	•	•	•	•	•	•					

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T and HT; C includes C and HC.

Description

< When (D-) is bit unit > $n \leq 16$



$N = 3$, so the decoding object is the lower three bits in DX0, which are X2 ~ X0.

$N = 3$, so the decoding results need to be expressed by $2^3 = 8$ bits, which are M17 ~ M10.



When $X2 = 1$, $X1 = 0$, $X0 = 1$, the value it represents is $4 + 1 = 5$, so M15 in the fifth place from M10 changes to 1; when X2 ~ X0 is all zero, the value is 0, so M10 is 1 (M10 is the 0th place).

If $n = 0$, the instruction will not be executed. If n is the value out of $0 \sim 16$, the instruction will not be executed.

When $n = 16$, if the decoding command (D-) is a bit soft component, the number of points is $2^{16} = 65536$.

When the driver input is OFF, the instruction is not executed, and the decoding output of the action is maintained.

< When (D-) is word device > $n \leq 4$



The low n -bit ($n \leq 4$) of the source address is decoded to the target address. When $n \leq 3$, the high 8-bit of the target turns to 0.


If $n = 0$, the instruction will not be executed. If n is out of $0 \sim 4$, the instruction will not be executed.

$N = 3$, so the decoding object in D0 is bit2-bit0, and the maximum value it represents is $4 + 2 + 1 = 7$.

$N = 3$, so in D1, $2^3 = 8$ bits are needed to represent the decoding result, that is, bit7 ~ bit0.

When bit2 and bit1 are both 1 and bit0 are 0, the value is $4+2=6$, so bit6 in D1 is ON.

< **D** is word soft component > $n \leq 4$



The low n-bit ($n \leq 4$) of the source address is decoded to the target address. When $n \leq 3$, the high 8-bit of the target turns to 0.

If $n = 0$, the instruction will not be executed. If n is out of $0 \sim 4$, the instruction will not be executed.

N = 4, so the object of decoding in D0 is bit3 ~ bit0, which represents the maximum value of $8 + 4 + 2 + 1 = 15$.

N = 4, so in D1, $2^4 = 16$ bits are needed to represent the decoding result, that is, bit15 ~ bit0.

When bit3, bit1 and bit0 are all 1 and bit2 is 0, the numerical value is $8+2+1=11$, so bit11 in D1 is ON.

4-8-9. High bit coding [ENCO]

1. Summary

Find the highest bit which is 1.

High bit coding [ENCO]			
16 bits	ENCO	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Coding data address	16 bits, BIN
D	Coding result address	16 bits, BIN
n	The bit quantity of coding result	16 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•	•	•	•	•	•				
D		•		•	•		•	•	•			
n									•			


Bit	Operand	System						
		X	Y	M*	S*	T*	C*	Dnm
S		•	•	•	•	•	•	

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T and HT; C includes C and HC.

Description

< When (S) is bit device > $n \leq 16$



Ignore the 1 of M11

If the number of bits in the source address is 1, the low side is ignored, and if the source address is 0, the instruction will not be executed.


When the driving condition is OFF, the instruction is not executed and the coding output is unchanged.


When $n = 16$, if the encoding instruction is a bit element, its point number is $2^{16} = 65536$.

$N = 3$, the encoded object has $2^3 = 8$ bits, which are M17 ~ M10, and the encoding results are stored in the lower three bits of D10, which are bit2 ~ bit0.

M13 and M11 are both 1. Ignoring M11, M13 is coded, bit2-bit0 represent 3, while bit0 and bit1 are 1.

< When (S) is word device $n \leq 4$





If multiple bits in the source address is 1, the low side is ignored, and if the source address is 0, the instruction will not be executed.


When the driver input is OFF, the instruction is not executed and the coding output is unchanged.

When $n \leq 3$, the high 8 bits in D0 are neglected.

When $n=3$, the encoding object has $2^3 = 8$ bits, that is, bit7 ~ bit0 in D0. The encoding result is stored in the lower 3 bits in D1, that is, bit2 ~ bit0.

When bit5 and bit2 in D0 are both 1, bit2 is ignored, and bit5 is coded, bit2-bit0 represent 5, bit2 and bit0 are 1.

< (S) is word soft component > $n \leq 4$



If the number of bits in the source address is 1, the low side is ignored, and if the source address is 0, the instruction will not be executed.

When the driver input is OFF, the instruction is not executed and the coding output is unchanged.

$N = 4$, the encoded object has $2^4 = 16$ bits, that is, bit15 ~ bit0 in D0. The encoding result is stored in the lower 4 bits in D1, that is, bit3 ~ bit0.

The highest bit of 1 in D0 is bit14, ignoring all low bits 1, and encoding bit14, bit3-bit0 represent 14, bit3, bit2 and bit1 are 1.

4-8-10. Low bit coding [ENCOL]

1. Summary

Find the position where the low bit is ON.

Low bit coding [ENCOL]			
16 bits	ENCOL	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Soft element address need coding	16bit,BIN
D	Soft element address to save coding result	16bit,BIN
n	The bit quantity of coding result	16bit,BIN

3. Suitable soft components

Word	Operand	System							Constant K/H	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	ID	QD
S		•	•	•	•	•	•	•	•		
D		•		•	•		•	•	•		
n									•		



Bit	Operand	System						
		X	Y	M*	S*	T*	C*	Dnm
S		•	•	•	•	•	•	

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T and HT; C includes C and HC.

Description

<if (S) is bit device > n≤16



Ignore the 1 of M16

If the number of bits in the source address is 1, the high bit side is ignored, and if the source address is 0, the instruction will not be executed.



When the driving condition is OFF, the instruction is not executed and the coding output is unchanged.

When $n = 16$, if the (S) of encoding instruction is a bit element, its point is $2^{16} = 65536$.

$N = 3$, the encoded object has $2^3 = 8$ bits, which are $M17 \sim M10$, and the encoding results are stored in the lower three bits of $D10$, which are bit2 ~ bit0.

$M12$ and $M16$ are both 1. Ignoring $M16$, $M12$ is coded, bit2-bit0 represent 2, while bit1 is 1.

< if (S) is word device > $n \leq 4$



If multiple bits in the source address is 1, the high bit side is ignored, and if the source address is 0, the instruction will not be executed.


When the driver input is OFF, the instruction is not executed and the coding output is unchanged.


When $n \leq 3$, the high 8 bits in $D0$ are neglected.

The encoding object has $2^3 = 8$ bits, that is, bit7 ~ bit0 in $D0$. The encoding result is stored in the lower 3 bits in $D1$, that is, bit2 ~ bit0.

When bit7 and bit4 in $D0$ are both 1, bit7 is ignored and bit4 is coded. Bit 2 is 1 when bit2-bit0 is expressed as 4.

< (S) is word soft component > $n \leq 4$





If multiple bits in the source address is 1, the high bit side is ignored, and if the source address is 0, the instruction will not be executed.

When the driver input is OFF, the instruction is not executed and the coding output is unchanged.

$N = 4$, the encoded object has $2^4 = 16$ bits, that is, bit15 ~ bit0 in D0. The encoding result is stored in the lower 4 bits in D1, that is, bit3 ~ bit0.

The lowest bit of 1 in D0 is bit5, ignoring all high bits 1, and encoding bit5 with bit3-bit0 as 5, bit2 and bit0 as 1.

4-8-11. Binary to Gray code [GRY]

1. Summary

Transform the binary data to gray code.

Binary to gray [GRY]			
16 bits	GRY	32 bits	DGRY
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Soft element address need coding	16bits/32bits, BIN
D	Soft element address to save coding result	16bits/32bits, BIN



3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
		•	•	•	•	•	•	•	•	•		
	S	•	•	•	•	•	•	•	•	•		
	D	•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

Source (BIN) → target (GRY)



Each bit of D10 will XOR with the bit on its left side. As the related gray code, the left bit will not change (the left bit is 0); the transformation result is stored in D100.

Transform the binary value to gray code.

GRY has 32 bits mode DGRY, which can transform 32 bits gray code.

S Range is 0~32,767 (16 bits instruction); 0~2,147,483,647 (32 bits instruction).

4-8-12. Gray code to binary [GBIN]

1. Summary

Transform the gray code to binary data.

Gray code to binary [GBIN]			
16 bits	GBIN	32 bits	DGBIN
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	Soft element address need coding	16bits/32bits, BIN
D	Soft element address to save coding result	16bits/32bits, BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•	•	•	•	•	•	•	•		
	D	•		•	•		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description

Source (GRY) → target (BIN)

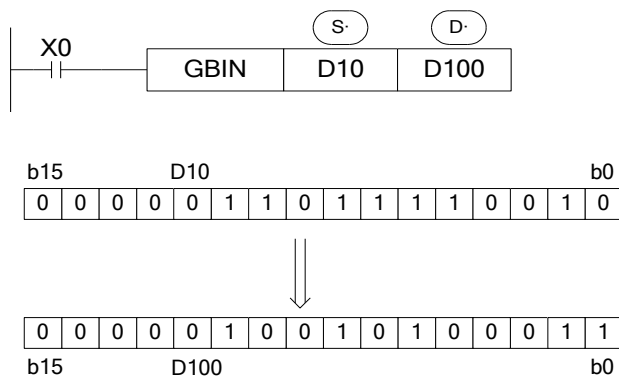

From the left second bit of D10, XOR each bit with the value after decoding, as the bit value after decoding (the left bit will not change). The transformation value will be stored in D100.

Transform the gray code to binary value.

GBIN has 32 bits mode DBIN, which can transform 32 bits binary value.

(S) Range is 0~32,767 (16 bits instruction); 0~2,147,483,647 (32 bits instruction).

4-9. Floating number Operation

Mnemonic	Function	Chapter
ECMP	Floating Compare	4-9-1
EZCP	Floating Zone Compare	4-9-2
EADD	Floating Add	4-9-3
ESUB	Floating Subtract	4-9-4
EMUL	Floating Multiplication	4-9-5
EDIV	Floating Division	4-9-6
ESQR	Floating Square Root	4-9-7
SIN	Sine	4-9-8
COS	Cosine	4-9-9
TAN	Tangent	4-9-10
ASIN	ASIN	4-9-11
ACOS	ACOS	4-9-12
ATAN	ATAN	4-9-13

4-9-1. Floating Compare [ECMP]

1. Summary

Floating Compare [ECMP]			
16 bits	-	32 bits	ECMP
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	Soft element address need compare	32 bits, BIN
S2	Soft element address need compare	32 bits, BIN
D	Compare result	bit

3. Suitable soft components


Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
Bit	Operand	System										
		X	Y	M*	S*	T*	C*	Dnm				
	D		•	•	•							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.
M includes M, HM, SM; S includes S and HS; C includes C and HC.

Description

(D11, D10) : (D21, D20) → M0, M1, M2


Binary Floating Binary Floating

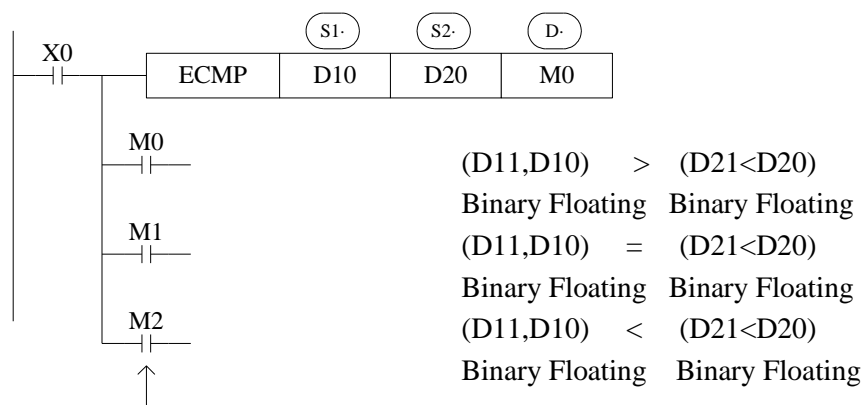

When X0 is OFF, even ECMP doesn't run, M0~M2 will keep the status before X0 is OFF.

The instruction will compare the two source data S1 and S2. The result is stored in three bits from D.

If a constant K or H used as source data, the value is converted to floating value.



(K500) : (D101, D100) → M10, M11, M12

Binary converts Binary floating
to floating

Note: Before the instruction is executed, the comparison data must be all floating numbers (if it is an integer, it can be converted by FLT instructions); otherwise, the execution result will be wrong.

4-9-2. Floating Zone Compare [EZCP]

1. Summary

Floating Zone Compare [EZCP]			
16 bits	-	32 bits	EZCP
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	Soft element address need compare	32 bits, BIN
S2	Upper limit of compare data	32 bits, BIN
S3	Lower limit of compare data	32 bits, BIN
D	The compare result soft element address	bit


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
	S3	•	•			•	•	•	•	•		
Bit	Operand	System										
		X	Y	M*	S*	T*	C*	Dnm				
	D		•	•	•							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD;
DM includes DM, DHM; DS includes DS, DHS.
M includes M, HM, SM; S includes S and HS; C includes C and HC.


Description

Compare the source data with the range



When X0 is OFF, even EZCP doesn't run, M3~M5 will keep the status before X0 is OFF.

Compare the source data S3 to the upper and lower limit value of the range S1~S2. The result will store in three coils starting from D. Constant K and H will transform to binary floating value when they are source data.



(K10) : [D6,D5] : (K2800) → M0, M1, M2
Binary converts Binary Floating Binary converts
to Floating to Floating

Please set $S1 \leq S2$, when $S2 < S1$, make S2 as the same value to S1.

Note: the compare value must be floating numbers, otherwise the result will be error.

4-9-3. Floating Addition [EADD]

1. Summary

Floating Add [EADD]			
16 bits	-	32 bits	EADD

Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S1	Addition operation data address	32 bits, BIN
S2	Addition operation data address	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description



$$(D11, D10) + (D21, D20) \rightarrow (D51, D50)$$

The two binary floating source data do addition operation, the result will be stored in target address.

If a constant K or H used as source data, the value is converted to floating point before the addition operation.



$$(K1234) + (D101, D100) \rightarrow (D111, D110)$$

Binary converts to Floating Binary Floating Binary Floating

The source data and result address can be the same. Please note that when X0 is ON, the instruction will be executed in every scanning period.

Note: the add value must be floating numbers, otherwise the result will be error.

4-9-4. Floating Subtraction [ESUB]

1. Summary

Floating Sub [ESUB]			
16 bits	-	32 bits	ESUB
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S1	Subtraction operation data address	32 bits, BIN
S2	Subtraction operation data address	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
	D	•				•	•	•	•			


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



(D11, D10) — (D21, D20) → (D51, D50)
 Binary Floating Binary Floating Binary Floating

The binary floating value S1 subtract S2, the result is stored in the target address.
 If a constant K or H used as source data, the value is converted to floating point before the subtraction operation.



(K1234) — (D101, D100) → (D111, D110)
 Binary converts to Floating Binary Floating Binary Floating

The source data and result address can be the same. Please note that when X0 is ON, the instruction will be executed in every scanning period.

Note: the operand value must be floating numbers, otherwise the result will be error.

4-9-5. Floating Multiplication [EMUL]

1. Summary

Floating Multiply [EMUL]			
16 bits	-	32 bits	EMUL
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S1	Multiplication operation data address	32 bits, BIN
S2	Multiplication operation data address	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description




$$(D11, D10) \times (D21, D20) \rightarrow (D51, D50)$$

Binary Floating Binary Floating Binary Floating

The floating value of S1 is multiplied with the floating value point value of S2. The result of the multiplication is stored at D as a floating value.

If a constant K or H used as source data, the value is converted to floating point before the multiplication operation.



$$(K100) \times (D101, D100) \rightarrow (D111, D110)$$

Binary converts to Floating Binary Floating Binary Floating

Note: the operand value must be floating numbers, otherwise the result will be error.



4-9-6. Floating Division [EDIV]

1. Summary

Floating Divide [EDIV]			
16 bits	-	32 bits	EDIV
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands


Operands	Function	Data Type
S1	Division operation data address	32 bits, BIN
S2	Division operation data address	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description




$$(D11, D10) \div (D21, D20) \rightarrow (D51, D50)$$

Binary Floating Binary Floating Binary Floating

The floating point value of S1 is divided by the floating point value of S2. The result of the division is stored in D as a floating point value.

If a constant K or H used as source data, the value is converted to floating point before the division operation.



$$(D101, D100) \div (K100) \rightarrow (D111, D110)$$

Binary converts to Floating Binary Floating Binary Floating

The source data S2 is 0, the calculation will be error. The instruction will not work.

Note: the operand value must be floating numbers, otherwise the result will be error.

4-9-7. Float Square Root [ESQR]

1. Summary

Floating Square Root [ESQR]			
16 bits	-	32 bits	ESQR
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-

2. Operands

Operands	Function	Data Type
S	The soft element address need to do square root	32 bits, BIN
D	The result address	32 bits, BIN

3. Suitable soft components


Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



A square root is performed on the floating point value S; the result is stored in D
If a constant K or H used as source data, the value is converted to floating point before the operation.



When the result is zero, zero flag activates.

Only when the source data is positive will the operation be effective. If S is negative then an error occurs and error flag SM409 is set ON, SD409=7, the instruction can't be executed.

Note: the operand value must be floating numbers, otherwise the result will be error.

4-9-8. Sine [SIN]

1. Summary

Floating Sine[SIN]			
16 bits	-	32 bits	SIN
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-


2. Operands

Operand	Function	Data Type
S	The soft element address need to do sine	32 bits, BIN
D	The result address	32 bits, BIN

3. Suitable soft components


Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.



(D51, D50) → (D61, D60) SIN
Binary Floating Binary Floating

This instruction performs the mathematical SIN operation on the floating point value in S (angle RAD). The result is stored in D.



Note: the operand value must be floating numbers, otherwise the result will be error.

4-9-9. Cosine [COS]

1. Summary

Floating Cosine [COS]			
16 bits	-	32 bits	COS
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-


2. Operands

Operands	Function	Data Type
S	Soft element address need to do cos	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•			•	•	•	•	•		
D		•					•	•	•			


*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.



(D51,D50) RAD → (D61,D60) COS
Binary Floating Binary Floating

This instruction performs the mathematical COS operation on the floating point value in S (angle RAD). The result is stored in D.

RAD value ($\text{angle} \times \pi/180$)
Assign the binary floating value
COS value
Binary Floating



Note: Before the instruction is executed, the data in parameter S must be floating number; otherwise, the execution result will be wrong.

4-9-10. TAN [TAN]

1. Summary

TAN [TAN]			
16 bits	-	32 bits	TAN
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement	-	Software requirement	-


2. Operands

Operand	Function	Data Type
S	Soft element address need to do tan	32bit,BIN
D	Result address	32bit,BIN


3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S	•	•			•	•	•	•	•		
	D	•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.



This instruction performs the mathematical TAN operation on the floating point value in S. The result is stored in D.



RAD value ($\text{angle} \times \pi/180$)
Assign the binary floating value
TAN value
Binary Floating

Note: Before the instruction is executed, the data in parameter S must be floating number; otherwise, the execution result will be wrong.

4-9-11. ASIN [ASIN]

1. Summary

ASIN [ASIN]			
16 bits	-	32 bits	ASIN
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement		Software requirement	-

2. Operands


Operands	Function	Data Type
S	Soft element address need to do arcsin	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
		•	•			•	•	•	•	•		
	S	•	•			•	•	•	•	•		
	D	•				•	•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.


Description



(D51, D50) ASIN → (D61, D60) RAD

Binary Floating Binary Floating

This instruction performs the mathematical ASIN operation on the floating point value in S. The result is stored in D.



ASIN value
Binary Floating
RAD value ($\text{angle} \times \pi / 180$)
Assign the binary floating value

Note: Before the instruction is executed, the data in parameter S must be floating number; otherwise, the execution result will be wrong.

4-9-12. ACOS [ACOS]

1. Summary

ACOS [ACOS]			
16 bits	-	32 bits	ACOS
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement		Software requirement	-


2. Operands

Operand	Function	Data Type
S	Soft element address need to do arccos	32 bits, BIN
D	Result address	32 bits, BIN

3. Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•			•	•	•	•	•		
D		•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.



Calculate the arcos value(radian), save the result in the target address



Note: Before the instruction is executed, the data in parameter S must be floating number; otherwise, the execution result will be wrong.

4-9-13. ATAN [ATAN]

1. Summary

ATAN [ATAN]			
16 bits	-	32 bits	ACOS
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement		Software requirement	-

2. Operands


Operands	Function	Data Type
S	Soft element address need to do arctan	32 bit, BIN
D	Result address	32 bit, BIN

3. Suitable soft components


Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S		•	•			•	•	•	•	•		
D		•					•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



Calculate the arctan value (radian), save the result in the target address



Note: Before the instruction is executed, the data in parameter S must be floating number; otherwise, the execution result will be wrong.

4-10. RTC Instructions

Mnemonic	Function	Chapter
TRD	Clock data read	4-10-1
TWR	Clock data write	4-10-2
TCMP	Clock compare	4-10-3

※1: To use the instructions, The Model should be equipped with RTC function;
 ※2: There are some errors in the clock of XD/XL series PLC, which is about ± 5 minutes per month. It can be calibrated regularly by HMI or in the PLC program.

4-10-1. Read the clock data [TRD]

1. Instruction Summary

Read the clock data:

Read the clock data: [TRD]			
16 bits	TRD	32 bits	-
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement		Software requirement	-

2. Operands


Operands	Function	Data Type
D	Register address to save clock data	16 bits, BIN

3. Suitable Soft Components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D	●		●	●							

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



The current time and date of the real time clock are read and stored in the 7 data devices specified by the head address D.

Read PLC's real time clock according to the following format.

Read the special data register (SD013~SD019).

Special data register for real time clock	Unit	Item	Clock data		Unit	Item
	SD018	Year	0-99	→	D0	Year
	SD017	Month	1-12	→	D1	Month
	SD016	Date	1-31	→	D2	Date
	SD015	Hour	0-23	→	D3	Hour
	SD014	Minute	0-59	→	D4	Minute
	SD013	Second	0-59	→	D5	Second
	SD019	Week	0 (Sun.)-6 (Sat.)	→	D6	Week

The RTC (real time clock) value is in BCD code format (SD013 to SD019). Please choose hex format to monitor the RTC value in XDPpro software. The value can be transformed to decimal format by BIN instruction. After reading the RTC by TRD instruction, the value will show in decimal format.

After reading the RTC by TRD, the value becomes decimal value.

after executing TRD instruction, D0 to D6 are occupied.

4-10-2. Write Clock Data [TWR]

1. Instruction Summary

Write the clock data:

Write clock data [TWR]			
16 bits	-	32 bits	TWR
Execution condition	Normally ON/OFF, rising/falling edge	Suitable Models	XD, XL
Hardware requirement		Software requirement	-

2. Operands

Operands	Function	Data Type
S	Write the clock data to the register	16 bits, BIN

3. Suitable Soft Components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D	●		●	●	●	●	●	●			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



Write the RTC value to the PLC.

Write the set clock data into PLC's real time clock.


In order to write real time clock, please set the 7 registers value from D0 to D6.

	Unit	Item	Clock data		Unit	Item	
Data for clock setting	D0	Year	0-99	→	SD018	Year	Special data register for real time clock t
	D1	Month	1-12	→	SD017	Month	
	D2	Date	1-31	→	SD016	Date	
	D3	Hour	0-23	→	SD015	Hour	
	D4	Minute	0-59	→	SD014	Minute	
	D5	Second	0-59	→	SD013	Second	
	D6	Week	0 (Sun.)-6 (Sat.)	→	SD019	Week	

After executing TWR instruction, the time in real time clock will immediately change to be the new time. It is a good idea to set the time few minutes late as the current time, and then drive the instruction when the real time reaches this value.

Note: when choosing secret download program advance mode in XDPpro software, the RTC only can be changed through TWR instruction.

There is another method to write the RTC. In the XDPpro software, please click the clock details in project bar on the left. Then click write into the current time. the PC will auto-write the current time to the PLC.



4-10-3. Clock compare [TCMP]

1. Instruction Summary

Compare three continuous clocks time.

Clock compare [TCMP]			
16 bits	TCMP	32 bits	-

Condition	Normally rising/falling edge	ON/OFF,	Suitable model	XD, XL
Hardware	-		Software	-

2. operand

Operand	Function	Model
S1	The first clock soft component address	16 bits, BIN
S2	The second clock soft component address	16 bits, BIN
S3	The third clock soft component address	16 bits, BIN
S4	PLC real time clock information first address	16 bits, BIN
D2	The compare result first address	bit

3. suitable soft component


Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•	•			•	•	•	•	•		
	S2	•	•			•	•	•	•	•		
	S3	•	•			•	•	•	•	•		
	S4	•	•			•	•	•	•	•		

Bit	Operand	System						
		X	Y	M*	S*	T*	C*	Dnm
	D		•	•	•			

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S, HS; T includes T, HT; C includes C, HC.

Description



Even X0=OFF to stop instruction TCMP, M0~M2 still keep the state before X0 become OFF.


TRD will read the present clock information in D30~D36 (year, month, day, hour, minute, second, week).

X0 from OFF to ON, TCMP worked. Compare the three registers starting from S4 to three registers S1, S2, S3 (year, month, day). When S1, S2, S3 is larger than S4 clock, M0 is ON. When S1, S2, S3 is equal to S4 clock, M1 is ON. When S1, S2, S3 is smaller than S4 clock, M2 is ON.

For example, the present clock is 15:32:49 7,30,2014 Wednesday. D30=14, D31=7, D32=30, D33=15, D34=32, D35=49, D36=3. If the setting time is 1,6,2015, D20=15, D21=1, D22=6, Then M0=ON. If the setting time is 7,31,2014, D20=14, D21=7, D22=31, then M1=ON. If the setting time is 6,31,2014, D20=14, D21=6, D22=31, then M2=ON.

Note: if S4 is D33, it means hour, minute, second, then S1, S2, S3 mean hour, minute, second. S4 can start from year, month, day, hour; cannot start from minute, second. The week cannot compare.

For example:







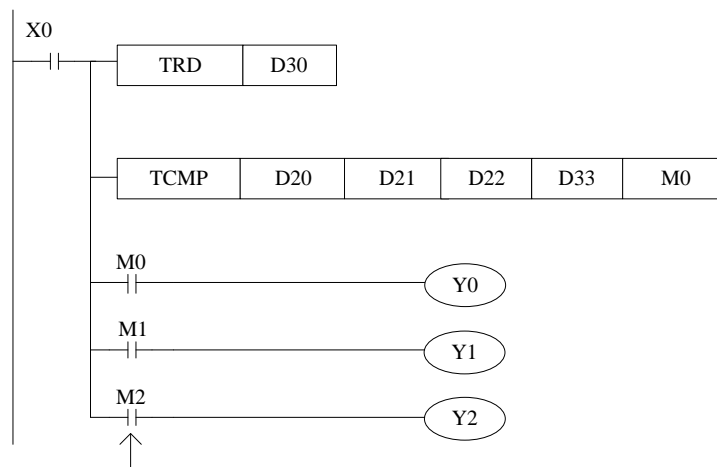


The present clock is 15:32:49 7,30,2014 Wednesday. So D30=14, D31=7, D32=30, D33=15, D34=32, D35=49, D36=3. If the setting time is 15:32:49, D20=15, D21=32, D22=49, so Y1=ON. If the setting time is 17:32:49, D20=17, D21=32, D22=49, so Y0=ON. If the setting time is 2:32:5, D20=2, D21=32, D22=5, so Y2=ON.

5 HIGH SPEED COUNTER (HSC)

This chapter will introduce high speed counter's functions, including high speed count model, wiring method, read/write HSC value, reset etc.

Instructions List for HSC


Instruction name	Function	Instruction	Chapter
HSC read/write			
DMOV	HSC read		5-6-1
DMOV	HSC write		5-6-2
CNT	No 24-segments single phase		5-7-1
CNT_AB	No 24-segments AB phase		5-7-2
CNT	24-segments single phase		5-7-3
CNT_AB	24-segments AB phase		5-7-4
RST	HSC reset		5-8

5-1. Functions Summary

XD, XL series PLC has HSC (High Speed Counter) function which will not affect by the scanning cycle. Via choosing different counter, test the high speed input signals with detect sensors and rotary encoders. The highest testing frequency can reach 80 KHz.

Note:

- (1) The high-speed counting input of XD/XL series PLC can only receive collector open-circuit signal (OC), but can not receive differential signal, so it is necessary to select the encoder of collector open-circuit signal (OC).
- (2) When the counting frequency is higher than 25Hz, please select a high-speed counter.
- (3) The XD1/XL1 series does not support high-speed counting.




5-2. HSC Mode

XD, XL series high speed counter has two working mode: increasing mode and AB phase mode.

Increasing Mode

Under this mode, the count value increase at each pulse's rising edge;




AB Phase Mode


Under this mode, the HSC value increase or decrease according to two differential signal (A phase and B phase). According to the multiplication, we have 1-time frequency and 4-time frequency, but the default count mode is 4-time mode.

1-time frequency and 4-time frequency modes are shown below:

1-time Frequency



4-time Frequency



5-3. HSC Range


HSC's count range is: -2,147,483,648 ~ +2,147,483,647. If the count value overflows this range, then overflow or underflow appears;

Overflow means the count value jumps from +2,147,483,647 to -2,147,483,648, then continue counting; underflow means the count value jumps from -2,147,483,648 to +2,147,483,647 then continue counting.


5-4. HSC Input Wiring

For the counter's pulse input wiring, things differ with different PLC model and counter model; several typical input wiring diagrams are shown below: (take XD3-60 HSC0 as the example):

Increasing mode (counter HSC0)



AB phase mode (counter HSC0)



5-5. HSC ports assignment

Each letter's Meaning:

U	A	B	Z
Pulse input	A phase input	B phase input	Z phase pulse catching

X can use as normal input terminals when there are no high speed pulses input. In the following table, Frequency doubling 2 means 2 frequency doubling; 4 means 4 frequency doubling; 2/4 means 2 and 4 frequency doubling.

Note: Z phase signal counting function is in developping.

XD2-16												
	Increasing mode							AB phase mode				
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC1 0	HSC1 2	HSC0	HSC2	HSC4	HSC6	HSC8
Max frequency	10K	10K	10K					5K	5K	5K		
Frequency doubling								2/4	2/4	2/4		
Counter interruption	√	√	√					√	√	√		
X000	U							A				

X001								B				
X002								Z				
X003		U							A			
X004									B			
X005									Z			
X006			U							A		
X007										B		
X010										Z		

XD2-24/32, XD3-16/24/32, XD5-16/24/32, XL3-16

	Increasing mode							AB phase mode				
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10	HSC12	HSC0	HSC2	HSC4	HSC6	HSC8
Max frequency	80K	10K	10K					50K	5K	5K		
Frequency doubling								2/4	2/4	2/4		
Counter interruption	√	√	√					√	√	√		
X000	U							A				
X001								B				
X002								Z				
X003		U							A			
X004									B			
X005									Z			
X006			U							A		
X007										B		
X010										Z		
X011												

XD2-48/60, XD3-48/60, XD5-48/60

	Increasing mode							AB phase mode				
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10	HSC12	HSC0	HSC2	HSC4	HSC6	HSC8
Max frequency	80K	80K	10K					50K	50K	5K		
Frequency doubling								2/4	2/4	2/4		
Counter interruption	√	√	√					√	√	√		
X000	U							A				
X001								B				
X002								Z				
X003		U							A			
X004									B			
X005									Z			
X006			U							A		
X007										B		
X010										Z		

XD5-24T4/32T4/48T4/60T4, XD5E-30T4, XDM-24T4/32T4/60T4/60T4L, XDC-24/32/48/60T

XL5-32T4, XL5E-32T4, XLME-32T4

	Increasing mode						AB phase mode					
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10
Max frequency	80K	80K	80K	80K			50K	50K	50K	50K		
Frequency doubling							2/4	2/4	2/4	2/4		
Counter interruption	√	√	√	√			√	√	√	√		
X000	U						A					

X001							B					
X002							Z					
X003		U						A				
X004								B				
X005								Z				
X006			U						A			
X007									B			
X010									Z			
X011				U						A		
X012										B		
X013										Z		

XD5-48T6/60T6												
	Increasing mode						AB phase mode					
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10
Max frequency	80K	80K	80K	80K	80K	80K	50K	50K	50K	50K	50K	50K
Frequency doubling							2/4	2/4	2/4	2/4	2/4	2/4
Counter interruption	√	√	√	√	√	√	√	√	√	√	√	√
X000	U						A					
X001							B					
X002							Z					
X003		U						A				
X004								B				
X005								Z				
X006			U						A			
X007									B			
X010									Z			
X011				U						A		
X012										B		
X013										Z		
X014					U						A	
X015											B	
X016											Z	
X017						U						A
X020												B
X021												Z

XD5-60T10, XDM-60T10, XD5E-60T10, XDME-60T10												
	Increasing mode											
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10	HSC12	HSC14	HSC16	HSC18	HSC20	HSC22
Max frequency	80K	80K	80K	80K	80K	80K	80K	80K	80K	80K		
Frequency doubling												
Counter interruption	√	√	√	√	√	√	√	√	√	√		
X000	U											
X001												
X002												
X003		U										
X004												
X005												
X006			U									
X007												
X010												
X011				U								
X012												

X013												
X014					U							
X015												
X016												
X017						U						
X020												
X021												
X022							U					
X023												
X024												
X025								U				
X026												
X027												
X030									U			
X031												
X032												
X033										U		
X034												

XD5-60T10, XDM-60T10, XD5E-60T10, XDME-60T10												
	AB phase mode											
	HSC0	HSC2	HSC4	HSC6	HSC8	HSC10	HSC12	HSC14	HSC16	HSC18	HSC20	HSC22
Max frequency	50K	50K	50K	50K	50K	50K	50K	50K	50K	50K		
Frequency doubling	2/4	2/4	2/4	2/4	2/4	2/4	2/4	2/4	2/4	2/4		
Counter interruption	√	√	√	√	√	√	√	√	√	√		
X000	A											
X001	B											
X002	Z											
X003		A										
X004		B										
X005		Z										
X006			A									
X007			B									
X010			Z									
X011				A								
X012				B								
X013				Z								
X014					A							
X015					B							
X016					Z							
X017						A						
X020						B						
X021						Z						
X022							A					
X023							B					
X024							Z					
X025								A				
X026								B				
X027								Z				
X030									A			
X031									B			
X032									Z			
X033										A		
X034										B		
X035										Z		

5-6. AB phase counting frequency doubling setting

For AB phase counting, the frequency doubling can be set in special FLASH data registers SFD321, SFD322, SFD323... SFD330, when the value is 2, it is 2 frequency doubling, 4 is 4 frequency doubling.

Register name	Function	Setting value	Meaning
SFD320	HSC0 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD321	HSC2 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD322	HSC4 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD323	HSC6 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD324	HSC8 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD325	HSC10 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD326	HSC12 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD327	HSC14 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD328	HSC16 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling
SFD329	HSC18 frequency doubling	2	2 frequency doubling
		4	4 frequency doubling

Note: After the SFD register is modified, it is necessary to restart the high-speed counter (i.e. disconnect and reboot the drive condition) in order to make the new configuration effective!

5-7. HSC instruction

This section introduces the usage of single-phase high-speed counting instruction (CNT), AB-phase high-speed counting instruction (CNT_AB), reset of high-speed counting, reading and writing of high-speed counting.

5-7-1. Single phase HSC [CNT]

Instruction Summary

Single phase HSC instruction.

Single phase HSC [CNT]			
16 bits Instruction	-	32 bits Instruction	CNT
Execution condition	Normally ON/OFF coil	Suitable models	XD, XL
Hardware requirement		Software requirement	-

Operands


Operands	Function	Type
S	Specify HSC code (Eg. HSC0)	32 bits, BIN
D	Specify the compare value (Eg. K100, D0)	32 bits, BIN

Suitable Soft Components

word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM	DS*	K/H	ID	QD
	S1	Only can be HSC										
	S2	•								•		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

FUNCTIONS AND ACTIONS



- When M0 is on, HSC0 counts X0 signal in single phase mode, compares the high-speed counting value with the value set in register D20. When the high-speed counting value is equal to the set value, HSC0 coil is set on immediately, and the counting value is accumulated in HSCD0 (double words).
- If the driving condition M0 is not disconnected, HSC0 will remain on state and

- continue counting, and the counting value in HSCD0 will continue to accumulate.
- If the driving condition M0 is disconnected, HSC0 will remain on state and the counting value in HSCD0 will remain unchanged.
- During the counting process, if M0 is disconnected and connected again, the values in HSCD0 will continue to accumulate after the last counting value.
- In the counting process, if the setting value in D20 changes and the current counting value is less than the new setting value, then the new setting value is compared.

5-7-2. AB phase HSC [CNT_AB]

Instruction Summary

AB phase HSC instruction.

AB phase HSC [CNT_AB]			
16 bits Instruction	-	32 bits Instruction	CNT_AB
Execution condition	Normally ON/OFF coil	Suitable models	XD, XL(exclude XD1, XL1)
Hardware requirement		Software requirement	-

Operands


Operands	Function	Type
S	Specify HSC code (Eg. HSC0)	32 bits, BIN
D	Specify the compare value (Eg. K100, D0)	32 bits, BIN

Suitable Soft Components

word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM	DS*	K/H	ID	QD
	S1	Only can be HSC										
	S2	●								●		

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

FUNCTIONS AND ACTIONS




- When M0 is on, HSC0 counts X0, X1 signal in AB phase mode, compares the high-speed counting value with the value set in register D20. When the high-speed counting value is equal to the set value, HSC0 coil is set on immediately, and the counting value is accumulated in HSCD0 (double words).
- If the driving condition M0 is not disconnected, HSC0 will remain on state and

- continue counting, and the counting value in HSCD0 will continue to accumulate.
- If the driving condition M0 is disconnected, HSC0 will remain on state and the counting value in HSCD0 will remain unchanged.
- During the counting process, if M0 is disconnected and connected again, the values in HSCD0 will continue to accumulate after the last counting value.
- In the counting process, if the setting value in D20 changes and the current counting value is less than the new setting value, then the new setting value is compared.

5-7-3. HSC reset [RST]

The reset mode of high-speed counter is software reset mode.



As shown above, when M0 is ON, HSC0 begins to count the pulse input of X0 port; when M1 changes from OFF to ON, HSC0 is reset, and the count value in HSCD0 (double words) is cleared.

5-7-4. Read HSC value [DMOV]

Instruction Summary

Read HSC value to the specified register;

Read HSC value [DMOV]			
16 bits Instruction	-	32 bits Instruction	DMOV
Execution condition	Normally ON/OFF, rising/falling edge	Suitable models	XD, XL (exclude XD1, XL1)
Hardware requirement		Software requirement	-

Operands

Operands	Function	Type
S	Specify HSC code	32 bits, BIN
D	Specify the read/written register	32 bits, BIN

Suitable Soft Components

word

Operand	System								Constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM	DS*	K/H	ID	QD
S	Only can be HSC										
D	●										

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

FUNCTIONS AND ACTIONS




When the trigger condition is established, the high-speed count value in the accumulative register HSCD0 (double words) corresponding to HSC0 of the high-speed counter is read into the data register D10 (double words).

High-speed counter can not directly participate in any application instructions or data comparison instructions (such as DMUL, LD > etc.) except DMOV, but can only be carried out after reading and writing into other registers.

As high speed counter is double words counter, so it must use 32-bit instruction DMOV. DMOV often uses together with high speed counter.

Program example:

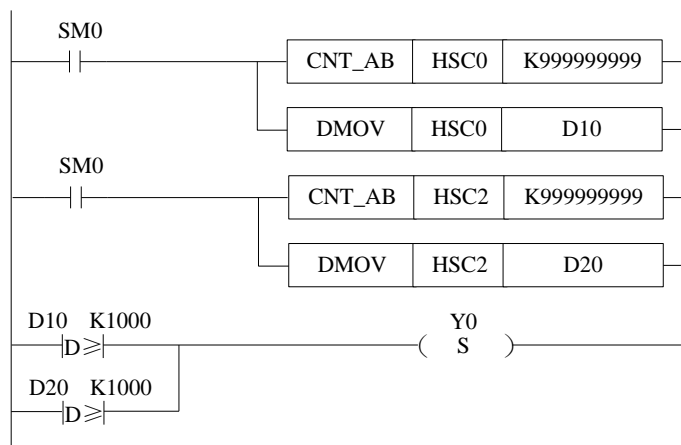

5-7-5. Write HSC value [DMOV]

Instruction Summary

Write the specified register value into HSC;

Write HSC value [DMOV]			
16 bits Instruction	-	32 bits Instruction	DMOV
Execution condition	Normally ON/OFF, rising/falling edge	Suitable models	XD, XL (exclude XD1, XL1)
Hardware requirement		Software requirement	-

operands


Operand	Function	Type
S	Specify HSC code	32 bits, BIN
D	Specify the read/written register	32 bits, BIN

suitable soft components

word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM	DS*	K/H	ID	QD
	S	•								•		
D	Only can be HSC											

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

FUNCTIONS AND ACTIONS



When the trigger condition is established, The value in the double-word data register D20 is written into the accumulative register HSCD0 (double-word) corresponding to the HSC0 of the high-speed counter, and the original data is replaced.

High-speed counter can not directly participate in any application instructions or data comparison instructions (such as DMUL, LD > etc.) except DMOV, but can only be carried out after reading and writing into other registers.

As high speed counter is double words counter, so it must use 32-bit instruction DMOV. DMOV often uses together with high speed counter.

5-7-6. The difference between HSC and normal counter

Although the instructions of high-speed counter use "CNT" in the same way as those of ordinary counter, their functions are quite different.

When M0 is changed from OFF to ON once, the value of common counter is added 1. The high-speed counter trigger condition must be in the normally closed state when counting, which is equivalent to the high-number counter being activated, but the value of the high-number counter does not change. Only when the corresponding external signal input terminal receives the signal, the high-number counter counts. If the external signal input terminal has signal input and its trigger condition is not closed, the high-number counter will not count.


The difference is shown in the following table:

Counter type	Instruction format	Function
Normal counter		Count the OFF to ON times of M0, when the counting value reaches 2000, C0 is ON.
High-speed counter		When M0 is ON, count the X0 input signal, when the counting value reaches 2000, HSC0 is ON, M0 should be always ON when counting.

5-8. HSC Example


The following takes XD3-60 as an example to show the programming method of HSC.

Single-phase incremental mode



When the M0 is ON, HSC0 counts the rising edge of the OFF to ON of the input X0 port at high speed.

When M1 rising edge comes, reset HSC0 high-speed counter and HSCD0 (double word).




Since the high-speed count value is 32-bit, the instructions here are all 32-bit instructions.

Such as DMOV, DLD<, DLD≥


- When SM0 is on, HSC0 counts X0 port in single-phase incremental mode, the setting value is K8888888, and reads the high-speed counting value to D0 (double-word) in real time.
- When D0 (double words) is less than D2 (double words), Y0 is ON, when D0 (double words) is equal to or larger than D2 (double words) and less than D4 (double words), Y1 is ON. when D0 (double words) is equal to or larger than D4 (double words), Y2 is ON.
- When M1 rising edge is coming, reset HSC0 and HSCD0(double words).

- As the high speed counter is double words counter, please use double words instruction DLD < and DLD ≥.

AB phase input mode

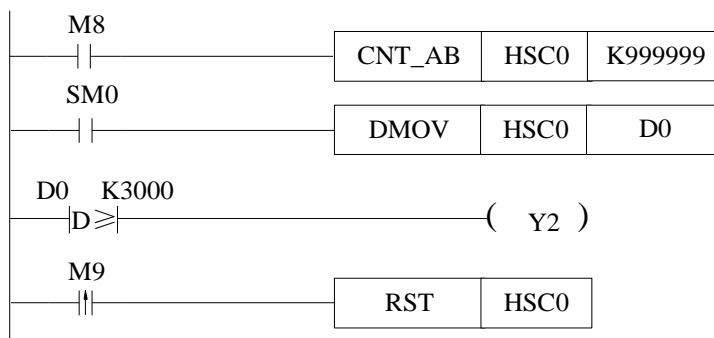

- When M8 is ON, HSC0 starts to count. The signal inputs from X0 (A phase) and X1 (B phase).
- When SM0 is ON, the value in HSCD0 (double words) related to HSC0 is written to D0 (double words) in real-time.
- When the present counting value is over 3000, Y2 is ON.
- When the rising edge of M9 is coming, reset HSC0 and HSCD0 (double words).

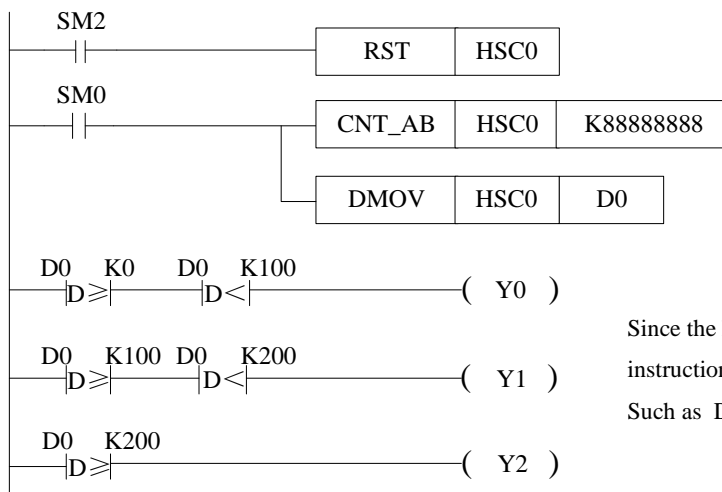

Since the high-speed count value is 32-bit, the instructions here are all 32-bit instructions.

Such as DMOV, DLD<, DLD≥

- When the rising edge of the original forward pulse coil SM2 comes, that is, at the beginning of each scanning cycle, HSC0 is reset and the counting value in HSCD0


-
- is cleared.
- When coil SM0 is on, HSC0 begins to count X0 and X1 ports in AB phase mode. The setting value of counting is K888888. At the same time, the counting value in HSCD0 (double words) is written into D0 (double words) in real time.
 - When the counting value in D0 (double words) is greater than K0 and less than K100, the output coil Y0 is ON; when the counting value in D0 (double words) is greater than or equal to K100 and less than K200, the output coil Y1 is ON; and when the counting value in D0 (double words) is greater than or equal to K200, the output coil Y2 is ON.
 - Since the high-speed counter is a double words counter, it is necessary to use the double words comparison instruction DLD \geq and DLD $<$ for comparison.

5-7. HSC interruption

5-7-1. Function overview and panel configuration

For XD/XL series PLC, some high-speed counters (referring to the high-speed counting input port allocation table of chapter 5-5 of each type of PLC) have a set value of 32 bits in 1-100 sections. When the difference of high-speed counting equals to the set value of corresponding 100 sections, the interruption will occur according to the corresponding interruption mark.

If the set value of N segment is set, there must be interrupt mark and interrupt program corresponding to N segment. The interruption marks corresponding to each high-speed counter are shown in chapter 5-9-4.

When using high-speed counting interrupt function, instructions can be written directly (see chapters 5-9-2 and 5-9-3), or can be configured by software panel. ase click in the XDPPro software, it will show below window.

High Speed Count 24 Section Config

Single phase 100 segment high speed counting

High Speed C: **HSC0**

Compare Value: **D500**

Interrupt Address: **HD100**

☐ Opposite ☒ Absolute

☐ Circulate ☐ Cam

Config Value

Compare Value: **99999999**

Section Num: **3**

Section Num	Value
Segment1 Count Num:	500
Segment2 Count Num:	20000
Segment3 Count Num:	50000


Read From PLC Write To PLC OK Cancel

In this panel, we can configure the parameters related to high speed count interruption. Take the settings in above figure as an example to explain each parameter function.

Parameter		Function
Single phase 100 segment high speed counting	single phase 100 segments high speed counting	High Speed Counting in Single Phase Incremental Mode
	100 segments AB phase high speed counting	High Speed Counting in AB phase mode
High Speed C: HSC0	HSC0~HSC18(32-bit)	High-speed counter number corresponding to high-speed input port
Compare Value: D500	Free to specify	HSC0 is ON when the count value is equal to the value in the register.
Compare Value: 99999999	Free to specify	When it counts to the compare value, HSC0 is ON, the compare value can be set here or put in compare register D500
<input type="checkbox"/> Opposite <input checked="" type="checkbox"/> Absolute	Relative	It will produce the interruption of segment N when the counting value = segment N-1 interruption counting value + segment N setting value.
	Absolute	It will produce the interruption when the counting value is equal to setting value.

Interrupt Address: <input type="text" value="HD100"/>	Free to specify	The set values of 100 segments of high-speed counting interrupts are stored in the registers starting from HD100, and the set values are stored in the double-word registers HD100, HD102, HD104....
<input type="checkbox"/> Circulate <input type="checkbox"/> Cam	Interruption cycle CAM	It must be used in relative mode. When all interrupts are over, high-speed counting interrupts can still be generated circularly. It must be used in absolute mode. When the counting value equals any set value, interruption occurs.
Section Num: <input type="text" value="3"/>	1~100 optional	If set to 3, it means execute three high-speed counting interrupts
<input type="text" value="Value"/>	Free to specify	Each segment corresponds to an interrupt count value, which is written to the address block starting from HD100; the interrupt time is determined by the relative/absolute count mode

For detailed usage of the above parameters, please see the following chapters.
After writing to the PLC and clicking "OK", the high-speed count interrupt instruction configuration is completed, as shown in the following figure:



5-9-2. Single phase 100-segment HSC [CNT]

Summarization

Single phase 100-segment HSC instruction.

Single phase 100-segment HSC [CNT]			
16-bit instruction	-	32-bit instruction	CNT
Execution condition	Normal ON/OFF	Suitable model	XD, XL (exclude XL1, XD1)
Hardware requirements	-	Software requirements	-

Operand


Operand	Function	Type
S1	Set the HSC (for example: HSC0)	32 bits, BIN
S2	Set the compare value (eg. K100, D0)	32 bits, BIN
S3	Set the 100-segment setting value	32 bits, BIN

Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM	DS*	K/H	ID	QD
	S1	Only can be HSC										
	S2	•								•		
	S3	•										

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



- When the high-speed counter HSC0 counts in single-phase mode, high-speed counting value is compared to data block starting from HD100 (such as HD102, HD104 and other double-word registers), it will immediately produce the corresponding high-speed counting interrupt when the condition is met, each section of the corresponding interrupt marks please refer to chapter 5-9-4.
- During the high-speed counting process, it is invalid to modify the set value of 100 segments.
- In the process of high-speed counting, the driving condition M0 can not be disconnected. If M0 is disconnected and then rebooted, no interruption will occur. The high-speed counter must be reset first, and then set ON M0 again to produce interruption.
- When the interrupt is finished in a single execution, if it needs to start the interruption again, the high-speed counter must be reset first, and then the driving condition must be ON again.
- In interrupt loop mode, interrupts can be generated in sequence as long as M0 remains on state.

5-9-3. AB phase 100-segment HSC [CNT_AB]

Summarization

AB phase 100-segment HSC instruction.

AB phase 100-segment HSC [CNT_AB]			
16 bits instruction	-	32 bits instruction	CNT_AB
Execution condition	Normal ON/OFF	Suitable model	XD, XL (exclude XL1, XD1)
Hardware requirements	-	Software requirements	-

Operand

Operand	Function	Type
---------	----------	------

S1	Set the HSC (such as:HSC0)	32 bits, BIN
S2	Set the compare value (such as: K100, D0)	32 bits, BIN
S3	Set the 100-segment setting value	32 bits, BIN

Suitable soft components

Word	Operand	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM	DS*	K/H	ID	QD
S1		Only can be HSC										
S2		•								•		
S3		•										

*Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Description



- When the high-speed counter HSC0 counts in AB phase mode, high-speed counting value is compared to data block starting from HD100 (such as HD102, HD104 and other double-word registers), it will immediately produce the corresponding high-speed counting interrupt when the condition is met, each section of the corresponding interrupt marks please refer to chapter 5-9-4.
- During the high-speed counting process, it is invalid to modify the set value of 100 segments.
- In the process of high-speed counting, the driving condition M0 can not be disconnected. If M0 is disconnected and then rebooted, no interruption will occur. The high-speed counter must be reset first, and then set ON M0 again to produce interruption.
- When the interrupt is finished in a single execution, if it needs to start the interruption again, the high-speed counter must be reset first, and then the driving condition must be ON again.
- In interrupt loop mode, interrupts can be generated in sequence as long as M0 remains on state.

5-9-4. Interruption flag of HSC

The 100 segments interruption flags of each HSC are in the following table. For example, the 100 segments interruption flags of HSC0 are I2000, I2001, I2002..... I2099.

HSC	Interruption flag
-----	-------------------

	Segment 1	Segment 2	Segment 3	...	Segment N	Segment 100
HSC0	I2000	I2001	I2002	...	I (2000+N-1)	I2099
HSC2	I2100	I2101	I2102	...	I (2100+N-1)	I2199
HSC4	I2200	I2201	I2202	...	I (2200+N-1)	I2299
HSC6	I2300	I2301	I2302	...	I (2300+N-1)	I2399
HSC8	I2400	I2401	I2402	...	I (2400+N-1)	I2499
HSC10	I2500	I2501	I2502	...	I (2500+N-1)	I2599
HSC12	I2600	I2601	I2602	...	I (2600+N-1)	I2699
HSC14	I2700	I2701	I2702	...	I (2700+N-1)	I2799
HSC16	I2800	I2801	I2802	...	I (2800+N-1)	I2899
HSC18	I2900	I2901	I2902	...	I (2900+N-1)	I2999

5-9-5. Setting value meaning in absolute or relative mode

The setting value meaning is different in absolute and relative mode. Relative/absolute mode can be set in the software panel. It can also be modified by special Flash register SFD330. (Note: Driving conditions must be OFF and ON again to make the configuration effective.)

0: Relative mode;

1: Absolute mode.

- **Relative mode**


In relative mode, the set value of high-speed counting 100 segments is relative cumulative value. When the set value of counting equals the sum of the interruption count value of N-1 segment and the set value of N segment, the segment N interrupt is generated.

N interrupt markers correspond to N interrupt settings. The N+1 interrupt settings register is reserved for other purposes.

Example1:

The current value of HSC0 is 0, segment one preset value is 10000, the preset value in segment 2 is —5000, the preset value in segment 3 is 20000. When starting to count, when the counter's current value is 10000, it generates the segment 1 interruption I2000; when the counter's current value is 5000, it generates the segment 2 interruption I2001; when the counter's current value is 25000, it generates the segment 3 interruption I2002.


See graph below:

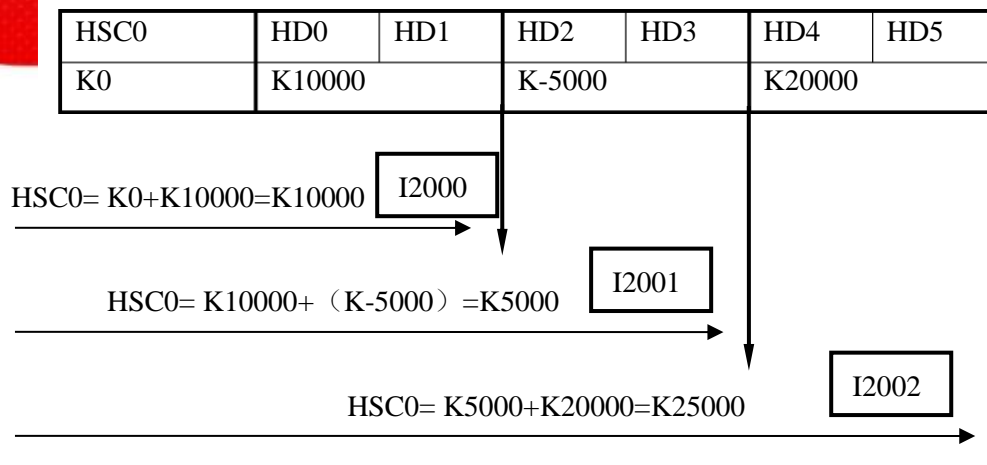

Example 2:

HSC2 current value is 10000, the segment one preset value is 10000, the preset value of segment 2 is 5000, the preset value of segment 3 is 20000. When starting to count, when the counter's current value is 20000, it generates the segment 1 interruption I2100; when the counter's current value is 25000, it generates the segment 2 interruption I2101; when the counter's current value is 45000, it generates the segment 3 interruption I2102.

See graph below:




- **Absolute Mode**


In absolute mode, interruption occurs when the count value equals the set value of each section of the counter. N interrupt markers correspond to N interrupt settings. The N+1 interrupt settings register is reserved for other purposes.

Example 1:

The current value of counter HSC0 is 0, the setting value of segment 1 is 10000, the setting value of segment 2 is 15000, and the setting value of segment 3 is 20000. When it starts counting, if the current value of the counter is 10000, the segment 1 interruption I2000 is generated; when the current value of the counter is 15000, the segment 2 interruption I2001 is generated; when the current value of the counter equals 20000, the segment 3 interruption I2002 is generated.

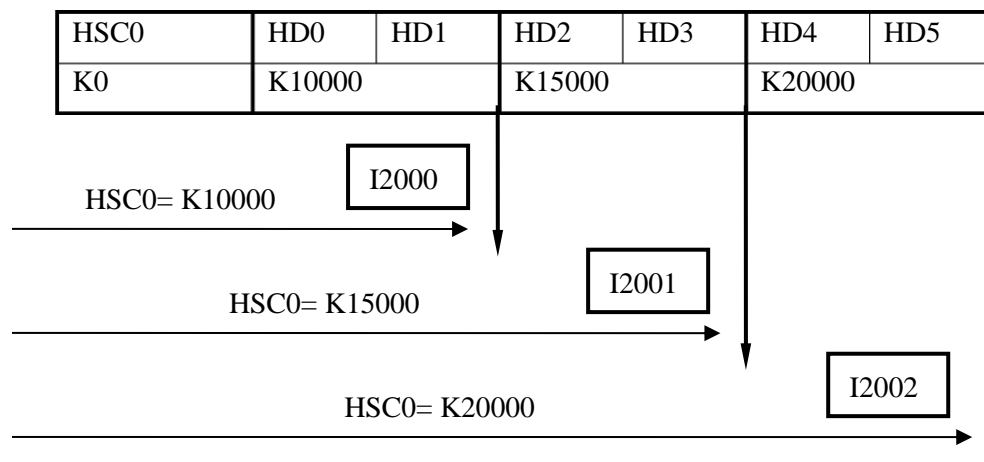**Example 2:**

The current value of counter HSC2 is 5000, segment 1 set value is 10000, segment 2 set value is 5000, and segment 3 set value is 20000. When it starts counting, if the current value of the counter is 10000, segment 1 interrupt I2100 is generated; when the current value of the counter is 5000, segment 2 interrupt I2101 is generated; when the current value of the counter equals 20000, segment 3 interrupt I2102 is generated.



Note: When absolute counting is performed in non-cam mode, counting interrupts are generated sequentially, i.e., segment 1 interruption, segment 2 interruption, segment 3 interruption... When a segment interrupt occurs, no interrupt occurs even if the count value reaches the set value of the segment again.

As in the example above, if the count value is increased from 4000 to 5000 and 10000 after the interruption of segment 1 and 2, the interruption of segment 1 and 2 will not occur again, and the interruption of segment 3 will occur when the count value continues to increase to 20000.

5-9-6. HSC interruption cycle mode


Mode 1: Single loop (normal mode)

The HSC interruption will not happen after it ends. The following conditions can start the interruption again.

reset the HSC

Reboot the HSC activate condition

The interruption is generated as the following sequence when single loop execution:




Mode 2: Continuous loop

Continuous loop interruption is only suitable for relative counting mode. In continuous loop mode, the interruption will start again after it is completed. This mode is especially suitable for the following application:

continuous back-forth movement.

Generate cycle interruption according to the fixed pulse.

When continuous loop interruption is performed (without cam function enabled), interrupts occur in the following order:



Via setting SFD331, users can switch between single loop mode or continuous loop mode. The detailed assignment is show below:

(Note: the settings will be effective after setting OFF and ON the driving condition again)

Address	HSC	Setting
Bit0	100 segments HSC interruption cycle (HSC0)	0: single loop 1: continuous loop
Bit1	100 segments HSC interruption cycle (HSC2)	
Bit2	100 segments HSC interruption cycle (HSC4)	
Bit3	100 segments HSC interruption cycle (HSC6)	
Bit4	100 segments HSC interruption cycle (HSC8)	
Bit5	100 segments HSC interruption cycle (HSC10)	
Bit6	100 segments HSC interruption cycle (HSC12)	
Bit7	100 segments HSC interruption cycle (HSC14)	
Bit8	100 segments HSC interruption cycle (HSC16)	
Bit9	100 segments HSC interruption cycle (HSC18)	

5-9-7. CAM function of high speed counter interruption

High-speed counting cam: After setting all interruption set value, the high-speed counting cam function is selected. When the high-speed counting value is equal to any of the interruption set value, the corresponding high-speed counting interruption (the same as the 100-segment high-speed counting interruption marker) is executed immediately. When the high-speed counting value changes repeatedly, the same high-speed interruption of the cam can be executed repeatedly.

High-speed counting cam not only can fully realize the cyclic sequence interruption function of ordinary electronic cam, but also can generate multiple times of positive and negative single point interruption in single cycle. It is widely used in control systems of high-speed winding machine and packaging machine.

Note: CAM function is only fit for absolute counting mode.


Cam function can be set by configuration panel in XINJE PLC software, or by special Flash register SFD332: (Note: Drive condition must be set OFF and ON again to make configuration effective)

0: No cam function enabled


1: Enable Cam Function

Example:

Four values are stored in four consecutive double-word registers starting with register HD0. When HSC0 starts to count, if the HSC0 count value equals any of the four registers, the corresponding interrupt signal will be generated immediately. As shown in the following figure:



5-9-8. Interruption using notes and parameter address



```
LD M0      //HSC trigger condition M0 (also interruption counting condition)
CNT_AB HSC0 K2000 HD0      //HSC and 100-segment head address setting
LDP M1      //HSC reset trigger condition
RST HSC0     //HSC and 100-segment reset (also reset the interruption)
```

As shown in the above example (note: the interrupt subprogram is omitted, see the application example in chapter 5-9-9). The data register HD0 sets the region starting address for the set value of 100 segments, and then stores the set value of 100 segments in double-word form. Attention should be paid to using high-speed counting interrupts:

- The register after the last segment no needs to set 0, but should be reserved and cannot be used for other purpose. For example, it has 3 segments, segment 1 is HD0, segment 2 is HD2, segment 3 is HD4, then HD6 is reserved.
- It is not allowed to set the interrupt setting value without writing the interrupt

- program. Otherwise, errors will occur.
- 100-segment interrupt of high speed counter generate in turn, that is, if the first interrupt does not occur, the second interrupt will not occur.
 - In high speed counting process, if the present counting value is changed by DMOV, ADD instruction (DMOV K1000 HSCD0), the interruption value will not change at this time. Please do not change the HSCD value when the high speed counter is running.

Some parameters can be modified in special Flash registers, as shown in the following table:

Parameter	Register address	Setting value
Counting mode	SFD330	0: relative 1: absolute
Execution mode	SFD331	0: execution once 1: interruption cycle
CAM function	SFD332	0: not enable 1: enable cam function

The above parameters can also be configured by the configuration panel in the following way:

Move the mouse over the high-speed counting instruction and right-click it. Select "CNT_AB Instruction Parameter Configuration" from the drop-down menu. A configuration panel will appear to configure the parameters in this window. As shown in the following figure:

High Speed Count 24 Section Config

Single phase 100 segment high speed counting

High Speed C: HSC0

Compare Value: D10

Interrupt Address: HD0

☒ Opposite ☐ Absolute ☐ Circulate ☐ Cam

Config Value

Compare Value: 3000

Section Num: 1

Section Num	Value
Segment1 Count Num:	0

Read From PLC Write To PLC OK Cancel

5-9-9. Application of HSC interruption

Application 1:

When M0 is ON, HSC0 starts counting. The counting value is stored in the address starting from HD0. When it reaches the set value, the interruption is produced. When the rising edge of M1 is coming, clear the HSC0.


Method 1:

Configure the parameters through XDPpro software:

Section Num	Value
Segment1 Count Num:	10000
Segment2 Count Num:	-10000

Configure item	Function
High speed counter	Choose HSC, the range is from HSC0 to HSC18
Frequency	Choose the HSC frequency doubling (2 or 4)
Compare value	The value can be register or constant, in this example, when the counting value reaches compare value, HSC0 is ON. here the compare value is 200000 which is saved in D10.
Relative and absolute	The HSC is relative mode or absolute mode
Interrupt address	The starting registers to store 100 segments interruption preset value
Circulate	100 segments interruption mode is cycle or not
Cam	The cam function is executed when any set value of 100-segment high speed counting interruption equals the counting value.

Method 2: make the program





Instruction:

```

LD    SM0                //SM0 is normally ON coil
DMOV K10000      HD0      //segment one preset value HD0 is 10000
DMOV K-10000 HD2        //segment 2 preset value HD2 is -10000
DMOV K200000  D10        //set HSC compare value
LD    M0                //HSC activate condition M0
CNT_AB HSC0 D10 HD0      //HSC interruption instruction
LDP   M1                //HSC reset condition M1
RST   HSC0              //reset HSC and 100 segments interruption
FEND                    //the main program end
I2000                    //segment one interruption flag
LD    SM0                //SM0 is normally ON coil
INC   D0                //D0= D0+1
IRET                    //interruption return flag
I2001                    //segment 2 interruption flag
LD    SM0                //SM0 is normally ON coil
INC   D1                //D1= D1+1
IRET                    //interruption return flag
  
```

Application 2: knit-weaving machine (continuous loop mode)

The machine principle: Control the inverter via PLC, thereby control the motor. Meantime, via the feedback signal from encoder, control the knit-weaving machine and the precise position.

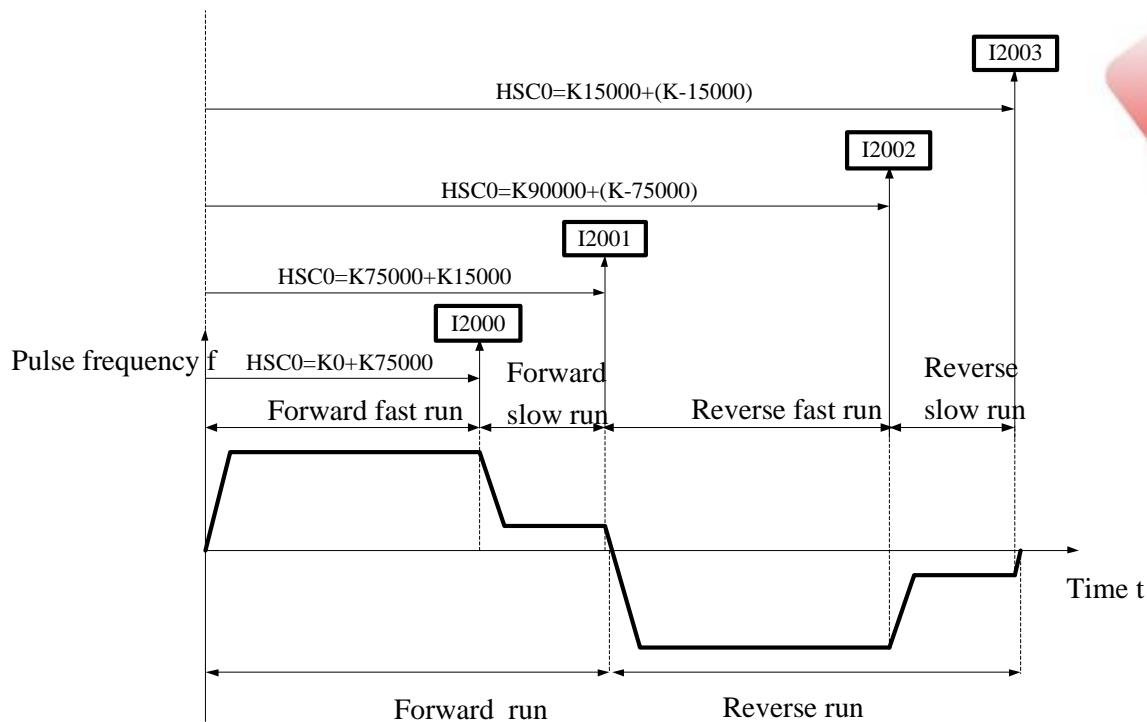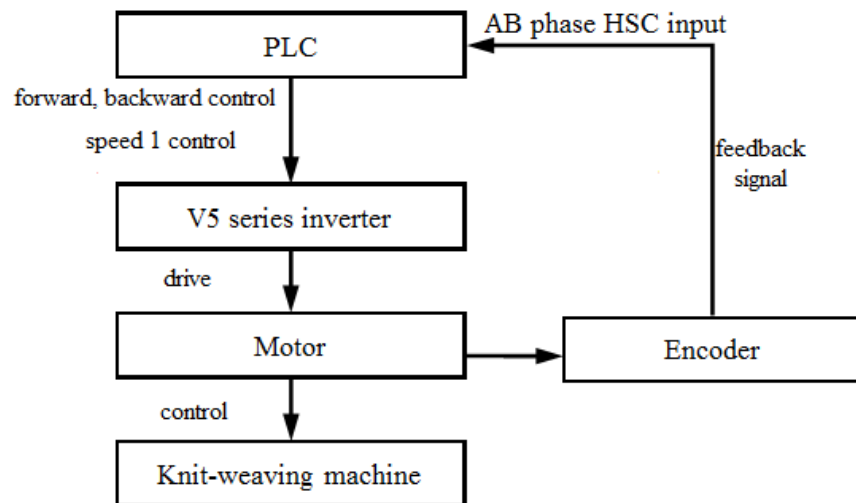

Below is PLC program: Y2 represents forward output signal; Y3 represents reverse output signal; Y4 represents output signal of speed 1; HSC2: Back-forth times accumulation counter; HSC0: AB phase HSC;

High Speed Count 24 Section Config

AB phase 100 segment high speed counting


High Speed Count: HSC0
Frequency: 4
Compare Value: D0
Interrupt Address: D100
☒ Opposite ☐ Absolute ☐ Circulate ☐ Cam

Config Value

Compare Value: 1000000
Section Num: 4

Section Num	Value
Segment1 Count Num:	75000
Segment2 Count Num:	15000
Segment3 Count Num:	-75000
Segment4 Count Num:	-15000

Read From PLC Write To PLC OK Cancel

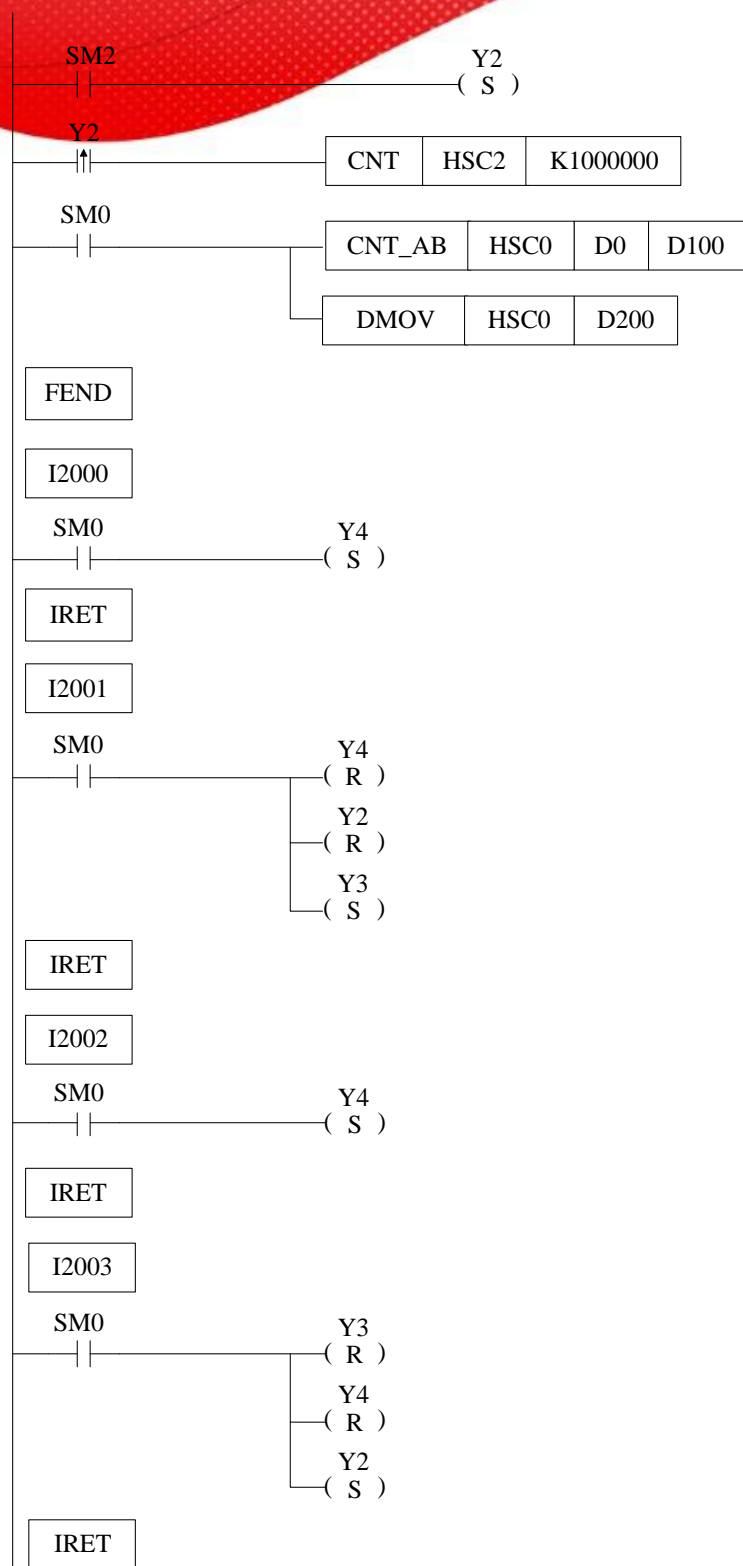













Instruction List:

```
LD    SM2           //SM2 is initial ON coil
SET   Y2            //set ON Y2 (forward run)
LDP   Y2            // Back-forth times activate condition Y2
CNT   HSC2 K1000000 //HSC2 starts counting
LD    SM0           //SM000 is normal ON coil
CNT_AB HSC0 D0 D100 //HSC 100 segments first address
DMOV  HSC0 D200     //read HSC0 counting value to D200
FEND                               //main program end
I2000                               //Interruption 1 flag
LD    SM0           //SM0 is normal ON coil
SET   Y4            //set ON Y4 (run at speed 1)
IRET                               //interruption return
I2001                               //interruption 2 flag
LD    SM0           //SM0 is normal ON coil
RST   Y4            //reset Y4 (stop running at speed 1)
RST   Y2            //reset Y2 (stop forward running)
SET   Y3            //set ON Y3 (reverse running)
IRET                               //interruption return
I2002                               //interruption 3 flag
LD    SM0           //SM0 is normal ON coil
SET   Y4            //set ON Y4 (run at speed 1)
IRET                               //interruption return
I2003                               //interruption 4 flag
LD    SM0           //SM0 is normal ON coil
RST   Y3            //reset Y3 (stop reverse running)
RST   Y4            //reset Y4 (stop running at slow speed)
SET   Y2            //set on Y2 (forward running)
IRET                               //interruption return
```


6 Communication Function

This chapter mainly includes: basic concept of communication, Modbus communication and free communication.

Relative Instruction

Mnemonic	Function	Circuit and soft components	Chapter
MODBUS Communication			
COLR	Coil Read		6-2-3
INPR	Input coil read		6-2-3
COLW	Single coil write		6-2-3
MCLW	Multi-coil write		6-2-3
REGR	Register read		6-2-3
INRR	Input register read		6-2-3
REGW	Single register write		6-2-3
MRGW	Multi-register write		6-2-3
Free Communication			
SEND	Send data		6-3-4
RCV	Receive data		6-3-4
Read and write serial port data			
CFGCR	Read serial port		6-5-1
CFGCW	Write serial port6-3-4		6-5-1

6-1. Summary

XD, XL series PLC main units can fulfill your requirement on communication and network. They not only support Modbus RTU, but also support Modbus ASCII and field bus X-NET. XD, XL series PLC offer multiple communication methods, with which you can communicate with the devices (such as printer, instruments etc.) that have Modbus communication protocol.

6-1-1. COM port

COM Port


XD, XL series PLC have multiple communication ports, such as USB port, Ethernet port, port0~port5, port2-RS232, port2-RS485.

*not support ✓support

	US B	RJ4 5	Port 0	Port 1	Port 2	Port2- RS23 2	Port2- RS48 5	Port 3	Port 4	Port 5
XD1	×	×	✓	✓	✓	×	×	×	×	×
XD2	×	×	✓	✓	✓	×	×	✓	✓	✓
XD3	✓	×	×	✓	✓	×	×	✓	✓	✓
XD5	✓	×	×	✓	✓	×	×	✓	✓	✓
XDM	✓	×	×	✓	✓	×	×	✓	✓	✓
XDC	×	×	×	✓	×	✓	✓	✓	✓	✓
XD5E	✓	✓	×	✓	✓	×	×	✓	✓	✓
XDM E	✓	✓	×	✓	✓	×	×	✓	✓	✓
XL1	×	×	×	✓	✓	×	×	×	×	×
XL3	✓	×	×	✓	✓	×	×	✓	×	×
XL5	✓	×	×	✓	✓	×	×	✓	×	×
XL5E	×	✓	×	✓	✓	×	×	✓	×	×

Note: In the series of "✓" PLCs, there may be some models that do not support USB port or Port2-Port5. See Appendix 5 for details.



The distribution of XD series communication ports is as follows:



Note:

- (1) The USB port of some models is RJ45 port or Port0 port or Port2-RS232;
- (2) Port 1 port of some models is RJ45 port.
- (2) Port2 port of some models is Port2-RS485 port or RJ45 port.
- (3) The left-most output terminal of XD5E is USB port or RS232 port.


The definitions and functions of each communication port are as follows:

Port	Appearance	Definition	protocol	Function
Port0		RS232 port	X-NET	Download program, set the port parameters through software or xinje config tool
Port1		RS232 port	Modbus RTU Modbus ASCII Free communication X-NET	Download program and connect external devices, set the port parameters through software or xinje config tool
Port2-RS232		RS232 port	Modbus RTU Modbus ASCII Free communication X-NET	Download program and connect external devices, set the port parameters through software or xinje config tool
Port2-RS485	A, B port	RS485 port	Modbus RTU Modbus ASCII Free communication X-NET	Download program and connect external devices, set the port parameters through software or xinje config tool
Port2	A, B port	RS485 port		
USB □		USB port	X-NET	High speed download port, please install the USB driver first
RJ45		Ethernet port	TCP/IP communication based on Ethernet	High speed stable download/upload program and data, remote monitoring, communicate with TCP IP device in LAN, set the port parameters through software or xinje config tool
Port3		Left extension ED port (for extending RS232/RS485 port)	Modbus RTU Modbus ASCII Free communication X-NET	connect external devices, set the port parameters through software or xinje config tool
Port4		Above extension BD port/ RS232/RS485/ Optical fiber port (see below details)	Modbus RTU Modbus ASCII Free communication X-NET	connect external devices, set the port parameters through software or xinje config tool
Port5				

Note:

- (1) Port2-RS232 and Port2-RS485 of XDC series can not be used simultaneously; when configuring in programming software, the port number is COM2, just like Port2.
- (2) If the parameters of Port1 can not be online after modification, the problem can be solved by "stop PLC when reboot", initialization after successful stopping, and then re-power-on; if not necessary, it is better not to modify the communication parameters of Port1.
- (3) The communication function of X-NET is not within the scope of this manual. Please refer to the "X-NET User Manual".
- (4) The content of Ethernet communication is not within the scope of this manual. Please refer to the User Manual of TCP IP Communication Based on Ethernet.

1. RS232 port (port0, port1, port2-RS232)




- 2: PRG
- 4: RxD
- 5: TxD
- 6: VCC
- 8: GND

Mini Din 8-pin plug (holes)

2. RS485 port (port2, port2-RS485)

About RS485 port, A is "+" signal、B is "-" signal. XL series PLC RS485 port is put outside. SG terminal is signal ground. The terminal diagram is shown as below:

Please use twisted pair cable for RS485. (See below diagram). But shielded twisted pair cable is better and the single-ended connects to the ground.




3. USB port


When downloading programs and data through the USB port, the USB driver and XINJEConfig tool must be installed first. Because the current USB driver has been built in the XINJEConfig software, the USB driver will be installed automatically after the XINJEConfig software is installed.

After installing the xinje config tool and usb driver, please switch to Xnet mode in the PLC software:

- (1) Open XDPPro software, click option/software serial port config




- (2) Click Xnet protocol to switch to xnet mode. Then click ok to confirm.

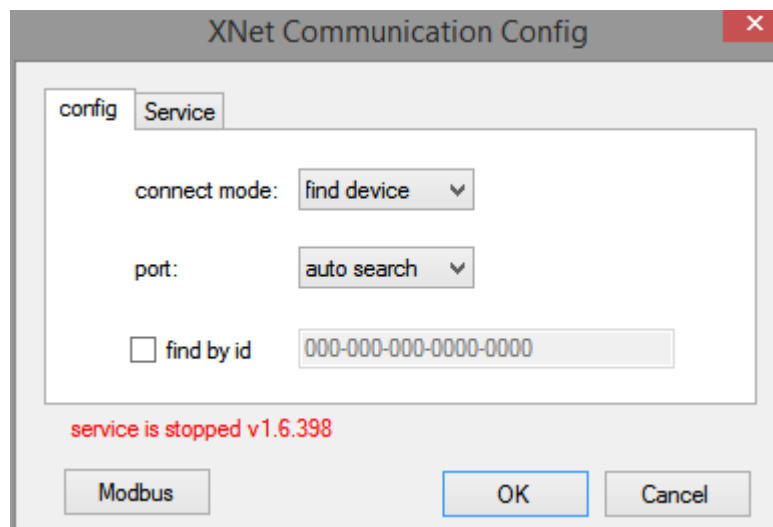

Note:

- (1) If it shows the error "find device: error2 cannot find device", you can click "Restart Service" to try to reconnect, or restart the programming software and PLC to reconnect. If you still can't connect, you need to check whether the PLC is power on, whether the USB download cable is connected properly, whether the USB driver and XINJEConfig software are installed properly.




4. Ethernet port (RJ45)

RJ45 port is unique for Ethernet PLC, supports TCP/IP Ethernet communication, the port is faster and more stable than USB communication, the data monitoring real-time ability is better, program downloading and uploading is faster. The connection mode of Ethernet communication itself has obvious advantages over RS485 and USB. In many situations of PLC communication, users can communicate with any PLC on the spot through only one switch.

In addition to its application in LAN, Ethernet also supports the remote search, monitoring and operation of PLC, download functions, and communication with other TCP IP devices in the network through the Internet.


RJ45 port can be configured in "PLC Config-Ethernet" of XINJE PLC programming software, or through XINJEConfig tool. Refer to the relevant manual for details.

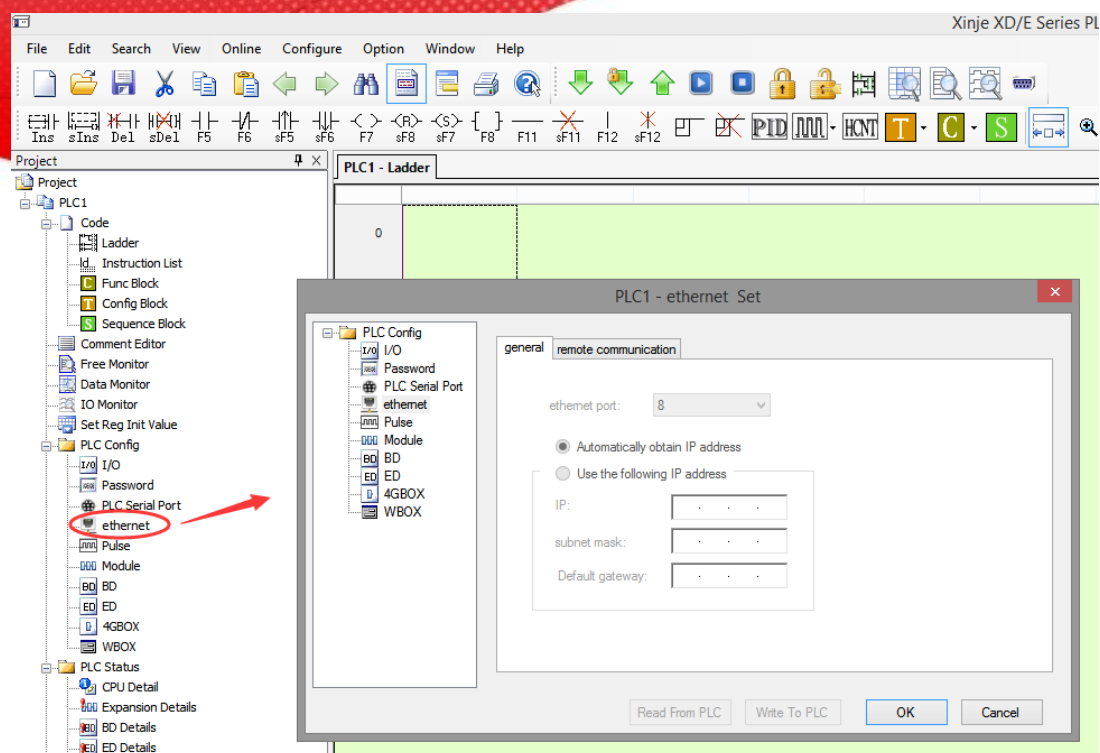

5. Left extension ED port (port3)

The left extension ED port can connect ED card to extend RS232 and RS485 port. The ED models include XD-NES-ED (can extend one RS232 and one RS485 port, but the two cannot communicate at the same time).

XD-NES-ED



Each part name is shown as below:


Name		Function
Power LED		The light is ON when the ED module power on
Communication LED		The light is ON when ED module communication is normal
Wiring terminal	A	RS485+
	B	RS485-
	SG	Ground
	FG	Connect to ground terminal
	-	Empty
	TX	RS232 send
	RX	RS232 receive
Wiring terminal	SG	Ground

6. Above extension BD port (port4, port5)

The above extension port can connect BD card which contains RS232 mode (XD-NS-BD), RS485 mode (XD-NE-BD) and optical fiber mode (XD-NO-BD).

XD series 24/32 I/O PLC can extend one BD card, **XD series 48/60 I/O PLC** can extend 2 BD cards, **XD series 16 I/O PLC** cannot extend BD card.


(1) XD-NS-BD



Each part name is shown as below:

Name		Function
Communication LED		Not support this function
Wiring terminal	TX	Signal send
	RX	Signal receive
	GND	Ground
	•	Empty

(2) XD-NE-BD




Each part name is shown as below:

Name		Function
Communication LED		The light is flashing when the BD card communication is successful
Wiring terminal	A	485+
	B	485-
	S	Signal ground
	•	Empty
Terminal resistor switch		To choose whether to use terminal resistor (120Ω)

XD-NE-BD has the switch to select whether it is terminal. The switch default setting is OFF which means not install terminal resistor. If XD-NE-BD is at the head or end of the bus, it needs to install 120Ω terminal resistor at the both side and turn on the switch (right).

(3) XD-NO-BD



Each part name is shown as below:

Name		Function
Communication LED		Not support this function
Wiring terminal		The left side is signal input terminal, the right side is signal output terminal

6-1-2. Communication parameters

Communication Parameters

Station	Modbus station number: 1~254
Baud Rate	300bps~9Mbps
Data Bit	5, 6, 7, 8, 9
Stop Bit	1, 1.5, 2
Parity	Even, Odd, even, empty, mask

The default parameters: Station number is 1, baud rate is 19200bps, 8 data bits, 1 stop bit, even parity.

There are many ways to set the parameters of PLC communication port:

There are two ways to set Modbus communication parameters: (1) setting parameters by programming software; (2) setting parameters by XINJEConfig tool, refer to chapter 6-2-6 for details.

Free format communication parameters can be set by programming software, refer to chapter 6-3-2 for details.

X-NET communication parameters can be set by Xinje Config tool. Refer to X-NET fieldbus manual for details.

Note: For the A, B terminal on the PLC body, 1Mbps and higher baud rate is only fit for X-NET communication mode.

6-2. MODBUS communication

6-2-1. Function overview

XD, XL series PLC support both Modbus master and Modbus slave.


Master mode: When PLC is set to be master, it can communicate with other slave devices which have MODBUS-RTU or MODBUS-ASCII protocol via Modbus instructions; it also can change data with other devices.

For example: Xinje XD3 series PLC can control inverter by Modbus.


Slave mode: When PLC is set to be slave, it can only response with other master devices.

Master and slave: In RS485 network, there can be one master and several slaves at one time (see below diagram). The master station can read and write any slave station. Two slave stations cannot communicate with each other. Master station should write

program and read or write one slave station; slave station has no program but only response the master station. (Wiring: connect all 485+, connect all 485-)



In RS232 network (see below diagram), there can only be one master and one slave at one time.



There is dotted line in the diagram. It means any PLC can be master station when all PLC in the network don't send data. As the PLC do not have unified clock standard, communication will fail when more than one PLC send data at one time. It is not recommended to use.

Note:


1. For XD/XL series PLC, RS232 and RS485 only support half-duplex.
2. For XC series PLC, if master PLC send one data to slave PLC, and master PLC send data again before slave PLC receiving the last one completely, slave PLC end data error may occur; For XD/XL series PLC, we solve this problem by adding waiting time before communication, which means the slave PLC will receive the next data only after some time the last data finished.

6-2-2. Changing of Modbus instruction

Modbus instruction handling mode has changed in XD/XL series PLC, users can write Modbus instructions directly in program, the protocol station will queue up Modbus requests, which is not the same task with communication; It means users can use one triggering condition to trigger multiple Modbus instructions at the same time. PLC will queue up Modbus requests according to protocol station, which will lead to communication error in XC series PLC.



XC series (✕)



XD3 series (✓)

Note: XD/XL series PLC sequence block has cancelled Modbus communication instructions, which is replaced by the current Modbus instruction handling mode.

6-2-3. Modbus communication address

The soft component's code in PLC corresponds with Modbus ID number, please see the following table:

XD1, XD2, XD3, XL1, XL3 series PLC Modbus address and internal soft component table:

type	component	Address	number	Modbus address (Hex)	Modbus address (decimal)
Coil bit	M	M0~M7999	8000	0~1F3F	0~7999
	X	X0~X77 (main unit)	64	5000~503F	20480~20543
		X10000~X10077 (#1 module)	64	5100~513F	20736~20799
		X10100~X10177 (#2 module)	64	5140~517F	20800~20863
		X10200~X10277 (#3 module)	64	5180~51BF	20864~20927
		X10300~X10377 (#4 module)	64	51C0~51FF	20928~20991
		X10400~X10477 (#5 module)	64	5200~523F	20992~21055
		X10500~X10577 (#6 module)	64	5240~527F	21056~21119
		X10600~X10677 (#7 module)	64	5280~52BF	21120~21183

		X10700~X10777 (#8 module)	64	52C0~52FF	21184~21247
		X11000~X11077 (#9 module)	64	5300~533F	21248~21311
		X11100~X11177 (#10 module)	64	5340~537F	21312~21375
		X20000~X20077(#1 BD)	64	58D0~590F	22736~22799
	Y	Y0~77(main unit)	64	6000~603F	24576~24639
		Y10000~Y10077 (#1 module)	64	6100~613F	24832~24895
		Y10100~Y10177 (#2 module)	64	6140~617F	24896~24959
		Y10200~Y10277 (#3 module)	64	6180~61BF	24960~25023
		Y10300~Y10377 (#4 module)	64	61C0~61FF	25024~25087
		Y10400~Y10477 (#5 module)	64	6200~623F	25088~25151
		Y10500~Y10577 (#6 module)	64	6240~627F	25152~25215
		Y10600~Y10677 (#7 module)	64	6280~62BF	25216~25279
		Y10700~Y10777 (#8 module)	64	62C0~62FF	25280~25343
		Y11000~Y11077 (#9 module)	64	6300~633F	25344~25407
		Y11100~Y11177 (#10 module)	64	6340~637F	25408~25471
		Y20000~Y20077(#1 BD)	64	68D0~690F	26832~26895
	S	S0~S1023	1024	7000~73FF	28672~29695
	SM	SM0~SM2047	2048	9000~97FF	36864~38911
	T	T0~T575	576	A000~A23F	40960~41535
	C	C0~C575	576	B000~B23F	45056~45631
	ET	ET0~ET31	32	C000~C01F	49152~49183
	SEM	SEM0~SEM31	32	C080~C09F	49280~49311
	HM ^{※1}	HM0~HM959	960	C100~C4BF	49408~50367
	HS ^{※1}	HS0~HS127	128	D900~D97F	55552~55679
	HT ^{※1}	HT0~HT95	96	E100~E15F	57600~57695
	HC ^{※1}	HC0~HC95	96	E500~E55F	58624~58719

Register word	HSC※1	HSC0~HSC31	32	E900~E91F	59648~59679
	D	D0~D7999	8000	0~1F3F	0~7999
	ID	ID0~ID99(main unit)	100	5000~5063	20480~20579
		ID10000~ID10099 (#1 module)	100	5100~5163	20736~20835
		ID10100~ID10199 (#2 module)	100	5164~51C7	20836~20935
		ID10200~ID10299 (#3 module)	100	51C8~522B	20936~21035
		ID10300~ID10399 (#4 module)	100	522C~528F	21036~21135
		ID10400~ID10499 (#5 module)	100	5290~52F3	21136~21235
		ID10500~ID10599 (#6 module)	100	52F4~5357	21236~21335
		ID10600~ID10699 (#7 module)	100	5358~53BB	21336~21435
		ID10700~ID10799 (#8 module)	100	53BC~541F	21436~21535
		ID10800~ID10899 (#9 module)	100	5420~5483	21536~21635
		ID10900~ID10999 (#10 module)	100	5484~54E7	21636~21735
		ID20000~ID20099 (#1 BD)	100	58D0~5933	22736~22835
	QD	QD0~QD99(main unit)	100	6000~6063	24576~24675
		QD10000~QD10099 (#1 module)	100	6100~6163	24832~24931
		QD10100~QD10199 (#2 module)	100	6164~61C7	24932~25031
		QD10200~QD10299 (#3 module)	100	61C8~622B	25032~25131
		QD10300~QD10399 (#4 module)	100	622C~628F	25132~25231
		QD10400~QD10499 (#5 module)	100	6290~62F3	25232~25331
		QD10500~QD10599 (#6 module)	100	62F4~6357	25332~25431
		QD10600~QD10699 (#7 module)	100	6358~63BB	25432~25531
		QD10700~QD10799 (#8 module)	100	63BC~641F	25532~25631

		QD10800~QD10899 (#9 module)	100	6420~6483	25632~25731
		QD10900~QD10999 (#10 module)	100	6484~64E7	25732~25831
		QD20000~QD20099 (#1 BD)	100	68D0~6933	26832~26931
	SD	SD0~SD2047	2048	7000~77FF	28672~30719
	TD	TD0~TD575	576	8000~823F	32768~33343
	CD	CD0~CD575	576	9000~923F	36864~37439
	ETD	ETD0~ETD31	32	A000~A01F	40960~40991
	HD ^{※1}	HD0~HD999	1000	A080~A467	41088~42087
	HSD ^{※1}	HSD0~HSD499	500	B880~BA73	47232~47731
	HTD ^{※1}	HTD0~HTD95	96	BC80~BCD F	48256~48351
	HCD ^{※1}	HCD0~HCD95	96	C080~C0D F	49280~49375
	HSCD ^{※1}	HSCD0~HSCD31	32	C480~C49F	50304~50335
	FD ^{※2}	FD0~FD5119	5120	C4C0~D8B F	50368~55487
	SFD ^{※2}	SFD0~SFD1999	2000	E4C0~EC8 F	58560~60559
	FS ^{※2}	FS0~FS47	48	F4C0~F4EF	62656~62703

XD5, XDM, XDC, XD5E, XDME, XL5, XL5E, XLME series PLC Modbus address and internal soft component table:

Type	component	Address	numbers	Modbus address (hex)	Modbus address (decimal)
Coil bit	M	M0~M20479	20480	0~4FFFF	0~20479
	X	X0~X77(main unit)	64	5000~503F	20480~20543
		X10000~X10077 (#1 module)	64	5100~513F	20736~20799
		X10100~X10177 (#2 module)	64	5140~517F	20800~20863
		X10200~X10277 (#3 module)	64	5180~51BF	20864~20927
		X10300~X10377 (#4 module)	64	51C0~51FF	20928~20991
		X10400~X10477 (#5 module)	64	5200~523F	20992~21055
		X10500~X10577	64	5240~527F	21056~21119

		(#6 module)			
		X10600~X10677	64	5280~52BF	21120~21183
		(#7 module)			
		X10700~X10777	64	52C0~52FF	21184~21247
		(#8 module)			
		X11000~X11077	64	5300~533F	21248~21311
		(#9 module)			
		X11100~X11177	64	5340~537F	21312~21375
		(#10 module)			
		X11200~X11277	64	5380~53BF	21376~21439
		(#11 module)			
		X11300~X11377	64	53C0~53FF	21440~21503
		(#12 module)			
		X11400~X11477	64	5400~543F	21504~21567
		(#13 module)			
		X11500~X11577	64	5440~547F	21568~21631
		(#14 module)			
		X11600~X11677	64	5480~54BF	21632~21695
		(#15 module)			
		X11700~X11777	64	54C0~54FF	21696~21759
		(#16 module)			
		X20000~X20077	64	58D0~590F	22736~22799
		(#1 BD)			
	Y	Y0~77(main unit)	64	6000~603F	24576~24639
		Y10000~Y10077	640	6100~613F	24832~24895
		(#1 module)			
		Y10100~Y10177	64	6140~617F	24896~24959
		(#2 module)			
		Y10200~Y10277	64	6180~61BF	24960~25023
		(#3 module)			
		Y10300~Y10377	64	61C0~61FF	25024~25087
		(#4 module)			
		Y10400~Y10477	64	6200~623F	25088~25151
		(#5 module)			
		Y10500~Y10577	64	6240~627F	25152~25215
		(#6 module)			
		Y10600~Y10677	64	6280~62BF	25216~25279
		(#7 module)			
		Y10700~Y10777	64	62C0~62FF	25280~25343
		(#8 module)			
		Y11000~Y11077	64	6300~633F	25344~25407
		(#9 module)			
		Y11100~Y11177	64	6340~637F	25408~25471
		(#10 module)			
		Y11200~Y11277	64	6380~63BF	25472~25535
		(#11 module)			
		Y11300~Y11377	64	63C0~63FF	25536~25599
		(#12 module)			
		Y11400~Y11477	64	6400~643F	25600~25663
		(#13 module)			
		Y11500~Y11577	64	6440~647F	25664~25727
		(#14 module)			

		Y11600~Y11677 (#15 module)	64	6480~64BF	25728~25791
		Y11700~Y11777 (#16 module)	64	64C0~64FF	25792~25855
		Y20000~Y20077(#1 BD)	64	68D0~690F	26832~26895
	S	S0~S7999	8000	7000~8F3F	28672~36671
	SM	SM0~SM4095	4096	9000~9FFF	36864~40959
	T	T0~T4095	4096	A000~AFFF	40960~45055
	C	C0~C4095	4096	B000~BFFF	45056~45151
	ET	ET0~ET39	40	C000~C027	49152~49191
	SEM	SEM0~SEM127	128	C080~C0FF	49280~49407
	HM※1	HM0~HM6143	6144	C100~D8FF	49408~55551
	HS※1	HS0~HS999	1000	D900~DCEF	55552~56551
	HT※1	HT0~HT1023	1024	E100~E4FF	57600~58623
	HC※1	HC0~HC1023	1024	E500~E8FF	58624~59647
	HSC※1	HSC0~HSC36	40	E900~E927	59648~59687
Register word	D	D0~D20479	20480	0~4FFF	0~20479
	ID	ID0~ID99(main unit)	100	5000~5063	20480~20579
		ID10000~ID10099 (#1 module)	100	5100~5163	20736~20835
		ID10100~ID10199 (#2 module)	100	5164~51C7	20836~20935
		ID10200~ID10299 (#3 module)	100	51C8~522B	20936~21035
		ID10300~ID10399 (#4 module)	100	522C~528F	21036~21135
		ID10400~ID10499 (#5 module)	100	5290~52F3	21136~21235
		ID10500~ID10599 (#6 module)	100	52F4~5357	21236~21335
		ID10600~ID10699 (#7 module)	100	5358~53BB	21336~21435
		ID10700~ID10799 (#8 module)	100	53BC~541F	21436~21535
		ID10800~ID10899 (#9 module)	100	5420~5483	21536~21635
		ID10900~ID10999 (#10 module)	100	5484~54E7	21636~21735
		ID11000~ID11099 (#11 module)	100	54E8~554B	21736~21835
		ID11100~ID11199 (#12 module)	100	554C~55AF	21836~21935
		ID11200~ID11299 (#13 module)	100	55B0~5613	21936~22035
		ID11300~ID11399 (#14 module)	100	5614~5677	22036~22135
		ID11400~ID11499 (#15 module)	100	5678~56DB	22136~22235
		ID11500~ID11599 (#16 module)	100	56DC~573F	22236~22335

		ID20000~ID20099(#1 BD)	100	58D0~5933	22736~22835
		QD0~QD99(main unit)	100	6000~6063	24576~24675
QD		QD10000~QD10099 (#1 module)	100	6100~6163	24832~24931
		QD10100~QD10199 (#2 module)	100	6164~61C7	24932~25031
		QD10200~QD10299 (#3 module)	100	61C8~622B	25032~25131
		QD10300~QD10399 (#4 module)	100	622C~628F	25132~25231
		QD10400~QD10499 (#5 module)	100	6290~62F3	25232~25331
		QD10500~QD10599 (#6 module)	100	62F4~6357	25332~25431
		QD10600~QD10699 (#7 module)	100	6358~63BB	25432~25531
		QD10700~QD10799 (#8 module)	100	63BC~641F	25532~25631
		QD10800~QD10899 (#9 module)	100	6420~6483	25632~25731
		QD10900~QD10999 (#10 module)	100	6484~64E7	25732~25831
		QD11000~QD11099 (#11 module)	100	64E8~654B	25832~25931
		QD11100~QD11199 (#12 module)	100	654C~65AF	25932~26031
		QD11200~QD11299 (#13 module)	100	65B0~6613	26032~26131
		QD11300~QD11399 (#14 module)	100	6614~6677	26132~26231
		QD11400~QD11499 (#15 module)	100	6678~66DB	26232~26331
		QD11500~QD11599 (#16 module)	100	66DC~673F	26332~26431
		QD20000~QD20099(#1 BD)	100	68D0~6933	26832~26931
	SD	SD0~SD4095	4096	7000~7FFF	28672~32767
	TD	TD0~TD4095	4096	8000~8FFF	32768~36863
	CD	CD0~CD4095	4096	9000~9FFF	36864~40959
	ETD	ETD0~ETD39	40	A000~A027	40960~40999
	HD ^{※1}	HD0~HD6143	6144	A080~B87F	41088~47231
	HSD ^{※1}	HSD0~HSD1023	1024	B880~BC7F	47232~48255
	HTD ^{※1}	HTD0~HTD1023	1024	BC80~C07F	48256~49279
	HCD ^{※1}	HCD0~HCD1023	1024	C080~C47F	49280~40303
	HSCD ^{※1}	HSCD0~HSCD39	40	C480~C4A7	50304~50343
	FD ^{※2}	FD0~FD8191	8192	C4C0~E4BF	50368~58559
	SFD ^{※2}	SFD0~SFD5999	6000	E4C0~FC2F	58560~64559
	FS ^{※2}	FS0~FS47	48	F4C0~F4EF	62656~62703

Note:

1. *1 is power-off retentive range, *2 is flash range.

2. The address is usually for Modbus-RTU and Modbus-ASCII communication when PLC works as lower computer, and upper computer: SCADA/screen/PLC.....
3. If upper computer is PLC, then we write program according to Modbus-RTU or Modbus-ASCII protocol; if upper computer is SCADA or HMI, there will be two situations: 1. with xinje driver. E.g.: xinje HMI can use PLC soft components directly (Y0/M0). 2. without xinje driver. Please select Modbus-RTU or Modbus-ASCII protocol, then use the address in the above table to define the data variable.
4. For Octonary I/O, calculate corresponding octonary I/O Modbus address. For example, Y0 modbus address is H6000, Y10 modbus address is H6008 (not H6010), Y20 modbus address is H6016 (not H6020).
5. when the modbus address is over K32767, it needs to use hex format to show it and add 0 before the address. For example, HD0 Modbus address is 41088 which cannot write in the software, please convert it to hex format H0A080.

6-2-4 Modbus data format

Modbus transmission mode:

There are two transmission modes: RTU and ASCII; It defines serial transmission of bit content in message domain; it decides how information to pack and decode; transmission mode (and port parameters) of all devices in Modbus serial links should be the same.

Modbus-RTU data structure

RTU mode:

Under Modbus RTU (remote terminal unit) mode, message has two 4-bit hexadecimal characters in every 8-bit byte. This mode has very high data density, higher throughput rate than Modbus ASCII. Every message should be sent by continuous characters.

RTU mode frame check domain: cycle redundancy check (CRC) .

RTU mode frame description:

Modbus station	Function code	data	CRC	
1 byte	1 byte	0~252 byte	2 byte	
			CRC low	CRC high

Format:

START	No input signal $\geq 10\text{ms}$
Address (station no.)	Communication address: 8-bit binary
Function	Function code: 8-bit binary
DATA (n - 1)	Data content: N*8-bit data, $N \leq 8$, max 8 bytes
.....	
DATA 0	
CRC CHK Low	CRC check code
CRC CHK High	16-bit CRC check code is consist of two 8-bit binary
END	No input signal $\geq 10\text{ms}$

2. Modbus address:

00H: All the Xinje XC series PLC broadcast—— slave stations don't response.

01H: Communicate with address 01H PLC.

0FH: Communicate with address 15H PLC.

10H: Communicate with address 16H PLC and so on. Up to 254 (FEH) .

3. Function and DATA:

Function code	Function	Modbus instruction
01H	Read coil	COLR
02H	Read input coil	INPR(not support Xinje PLC)
03H	Read register	REGR
04H	Read input register	INRR
05H	Write coil	COLW
06H	Write register	REGW
10H	Write multi-register	MRGW
0FH	Write multi-coil	MCLW

(1) Take 06H function code as example (single register write), and introduce data format.

E.g.: upper computer write data to PLC H0002 (D2).


RTU mode:

Asking format		Response format	
ID	01H	ID	01H
Function code	06H	Function code	06H
Register ID	00H	Register ID	00H
	02H		02H
Data content	13H	Data contents	13H
	88H		88H
CRC CHECK High	25H	CRC CHECK High	25H
CRC CHECK Low	5CH	CRC CHECK Low	5CH

Explanation:

1. Address is PLC station no.
2. Function code is Modbus-RTU protocol read/write code.
3. Register address is the PLC modbus address, please see chapter 6-2-3.
4. Data content is the value in D2.
5. CRC CHECK High / CRC CHECK Low is high and low bit of CRC check value.

If 2 pieces of Xinje XD3 series PLC communicate with the other one, write K5000 to D2.



M0 is trigger condition (Rising edge). If communication fails, the instruction will try twice. If the third time communication fails, then communication ends.

The relationship between REGW and Modbus RTU protocol (other instructions are the same)

REGW	Function code 06H
K1	Station no.
H0002	Modbus address
K5000	Data contents 1388H
K2	PLC serial port

The complete communication datum are: 01H 06H 00H 02H 13H 88H (system take CRC checking automatically)

If monitor the serial port2 data by serial port debugging tool, the datum are: 01 06 00 02 13 88 25 5C

Note: The instruction doesn't distinguish decimal, hex, binary, octal etc. For example, B10000, K16 and H10 are the same value, so the following instructions are the same.

REGW K1 B111110100 D1 K2

REGW K1 K500 D1 K2

REGW K1 H1F4 D1 K2

(2) Function code 01H/02H: read coil/read input coil

Eg. Read coil address 6000H (Y0). At this time, Y0 and Y1 are ON.

RTU mode:

Asking format		Response format	
Address	01H	Address	01H
Function code	01H/02H	Function code	01H/02H
Coil address	60H	Byte number	01H
	00H		
Coil number	00H	Data contents	03H
	02H		
CRC CHECK Low	A3H	CRC CHECK Low	11H
CRC CHECK High	CBH	CRC CHECK High	89H

As the status of Y0 and Y1 is ON, the data contents are 03H (0000 0011).

(3) Function code 03H: read register

Eg. Read two register starting from 03E8H (D1000, D1001).

RTU mode:

Asking format		Response format	
Address	01H	Address	01H
Function code	03H	Function code	03H
Register address	03H	Byte number	04H
	E8H		
Register number	00H	Data contents	12H
			2EH
	02H		04H
			E8H

CRC Low	CHECK	44H	CRC CHECK Low	9DH
CRC High	CHECK	7BH	CRC CHECK High	CCH

At this time, the data read from D1000 and D1001 are 122EH (4654) and 04E8H (1256).

(4) Function code 05H: write single coil

Eg. Set on the coil address 6000H (Y0).

RTU mode:

Asking format		Response format	
Address	01H	Address	01H
Function code	05H	Function code	05H
Coil address	60H	Coil address	60H
	00H		00H
Data contents (low byte is before high byte)	FFH	Data contents	FFH
	00H		00H
CRC Low	CHECK	CRC CHECK Low	92H
CRC High	CHECK	CRC CHECK High	3AH

Note: when writing single coil, ON is 00FFH, OFF is 0000H; the low byte is before high byte for the data contents.

(5) Function code 0FH: write multiple coils

Eg. Write 16 coils start from address 6000H (Y0).

RTU mode:

Asking format		Response format	
Address	01H	Address	01H
Function code	0FH	Function code	0FH
Coil address	60H	Coil address	60H
	00H		00H
Coil number	00H	Coil number	00H
	10H		10H
Byte number	02H	-	-
Data contents (low byte is before high byte)	03H		
	01H		
CRC Low	CHECK	CRC CHECK Low	4AH
CRC High	CHECK	CRC CHECK High	07H

The data contents are 0103H, the binary format is 0000 0001 0000 0011, write in corresponding Y17~Y0, so Y0, Y1, Y10 are set ON.

Note: when writing the data contents, the low byte is before the high byte.

(6) Function code 10H: write multiple registers

Eg. Write 3 registers starting from address 0000H (D0).

RTU mode:

Asking format		Response format	
Address	01H	Address	01H
Function code	10H	Function code	10H
Register address	00H	Register address	00H
	00H		00H
Register number	00H	Register number	00H
	03H		03H
Byte number	06H	-	-
Data contents	00H		
	01H		
	00H		
	02H		
	00H		
	03H		
CRC CHECK Low	3AH	CRC CHECK Low	3AH
CRC CHECK High	81H	CRC CHECK High	81H

After executing, the value in D0, D1, D2 are 1, 2, 3.

Note: byte number = register number * 2.

Modbus-ASCII data structure

ASCII mode:

For Modbus ASCII (American Standard Code for Information Interchange) mode in serial links, every 8-bit byte is sent as two ASCII characters. When communication links and devices do not fit RTU mode timing monitor, we usually use the ASCII mode. Note: One byte needs two characters, so ASCII mode has lower inefficiency than RTU mode.

E.g.: Byte 0X5B will be encoded as two characters: 0x35 and 0x42 (ASCII code 0x35 ="5", 0x42 ="B") .

ASCII mode frame check domain: Longitudinal Redundancy Checking (LRC)

ASCII mode frame description:

Start mark	Modbus no.	Function code	data	LRC	End mark	
1 character	2 characters	2 characters	0~252*2 characters	2 characters	2 characters	
0x3A					0x0D	0x0A

Format:

STX (3AH)	Start mark=3AH
Address code high bit	Communication position (no) : Consist of 2 ASCII codes
Address code low bit	
Function code high bit	Function code (command) : Consist of 2 ASCII codes
Function code low bit	
Instruction start ID	

Instruction start ID	Command start bit: Consist of 4 ASCII codes
Instruction start ID	
Instruction start ID	
Data length	Length from start to end: Consist of 4 ASCII codes
Data length	
Data length	
Data length	
LRC check high bit	LRC check code: Consist of 2 ASCII codes
LRC check low bit	
END high bit	End mark: END Hi=CR (0DH) , END Lo=CR (0AH)
END low bit	

2. Communication address:

00H: All Xinje XC series PLC broadcast—— slave stations do not response.

01H: Communicate with address 01H PLC.

0FH: Communicate with address 15H PLC.

10H: Communicate with address 16H PLC.

And so on, up to 254 (FEH) .

3. Function and DATA:

Function code	Function	Corresponding modbus
01H	Read coil	COLR
02H	Read input coil	INRR
03H	Read register	REGR
04H	Read input register	INRR
05H	Write single coil	COLW
06H	Write single register	REGW
10H	Write multiple registers	MRGW
0FH	Write multiple coils	MCLW

Take 06H function code (write single register) as example, and introduce data format (other functions are similar to this) :

E.g.: upper computer write data K5000(H1388) to PLC H0002 (D2).

ASCII mode:

Start mark	3AH
ID	30H
	31H
Function code	30H
	36H
Register ID high byte	30H
	30H
Register ID low byte	30H
	32H
Data content high byte	31H
	33H
Data content low byte	38H

	38H
LRC	35H
	43H
End mark	0DH
	0AH

Description:

1. address is PLC station number.
2. Function code is Modbus-ASCII protocol read/write code.
3. Register ID is the PLC modbus communication ID, please see chapter 7-2-2.
4. Data content is the value in D2.
5. LRC CHECK Low / CRC CHECK High is low and high bit of CRC check value.

If two pieces of Xinje XD3 PLC communicate with each other, write K5000 to D2.



M0 is trigger condition (rising edge). When Xinje PLC communicates by Modbus, if communication fails, the instruction will try twice. If the third time communication fails, then communication ends.

The relationship between REGW and ASCII protocol (other instructions are similar to this):

REGW	Function code 06H
K1	Station number
H0002	Modbus ID
K5000	Data content is 1388H
K2	PLC communication serial port

Complete data string: 3AH 30H 31H 30H 36H 30H 30H 30H 32H 31H 33H 38H 38H 35H 43H (system take CRC checking automatically)

If monitor the serial port2 by serial port debugging tool, the datum are: 3AH 30H 31H 30H 36H 30H 30H 30H 32H 31H 33H 38H 38H 35H 43H 0DH 0AH

Note: The data does not distinguish decimal, binary, hexadecimal etc. For example, B10000, K16 and H10 are the same value, so the following instructions are the same.

REGW K1 B111110100 D1 K2

REGW K1 K500 D1 K2

REGW K1 H1F4 D1 K2

6-2-5. Communication Instructions

Modbus instructions include coil read/write, register read/write; below will introduce the details.

Instructions in details:

The operand definition in the instruction:

1. Remote communication station and serial port number.

E.g.: one PLC connects 3 inverters. PLC needs to write and read the parameters of inverter. The inverter station number is 1.2 and 3. So the remote communication number is 1.2 and 3.

2. Remote register/coil start ID number:

Assign remote coil/register number: the start coil/register ID of PLC read and write, it is normally used with 'assigned coil/register number'.

E.g.: PLC read Xinje inverter's output frequency (H2103), output current (H2104), bus voltage (H2105), then remote register/coil start ID is H2103, assigned coil number is K3.

3. Local receipt/send coil/register address: Coil/register in PLC used to exchange data with lower computer.

E.g.: write coil M0: write M0 status to assigned address in lower computer

Write register D0: write D0 value to assigned address

Read coil M1: read content in lower computer assigned address to M1

Read register D1: read content in lower computer assigned address to D1

4. communication condition:

The preconditions of Modbus communication can be normal open/closed coil and rising/falling edge. When the open/close coil triggers, Modbus instructions will always be executed. When the communication between multiple slave stations or the traffic is large, communication delay may occur. The oscillating coil can be used as triggering condition. When the rising/falling edge triggers, Modbus instructions will only be executed once, and only when the next rising/falling edge comes, Modbus instructions will be executed again.

Coil Read [COLR]

Instruction Summary

Read the specified station's coil status to the local device;

Coil read [COLR]			
16 bits instruction	COLR	32 bits instruction	-
Execution condition	Normally ON/OFF coil	Suitable models	XD, XL
Hardware requirement	-	Software Requirement	-

Operands

Operands	Function	Type
S1	Specify the remote communication station no.	16 bits, BIN
S2	Specify the remote coil start address	16 bits, BIN

S3	Specify the coil quantity	16 bits, BIN
D1	Specify the local coil start address	bits
D2	Specify the serial port no.	16 bits, BIN

Suitable soft components

Word


Operands	System								Constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S1	●	●		●	●				●		
S2	●	●		●	●				●		
S3	●	●		●	●				●		

Bit

Operands	System						
	X	Y	M*	S*	T*	C*	Dnm
D1	●	●	●	●	●	●	

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM. M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Function



- Read the coil, Modbus function code 01H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- Operands S3: K1~K2000, the max coil quantity is 2000.
- When X0 is ON, COLR instruction is executed. When the instruction starts to execute, the Modbus read and write flag SM160 (serial port 2) is set on; when the execution is completed, SM160 (serial port 2) is set OFF. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

Input coil read [INPR]

Summary

Read the specified station's input coil status to local device.

Input coil read[INPR]			
16 bits instruction	INPR	32 bits instruction	-
Execution condition	Normally ON/OFF, rising edge	Suitable models	XD, XL
Hardware requirement	-	Software requirement	-

Operands

Operands	Function	Type
S1	Specify remote communication station no.	16 bits, BIN
S2	Specify remote coil start address number	16 bits, BIN
S3	Specify coil number	16 bits, BIN
D1	Specify start address number of local receipt coils	bit
D2	Specify serial port number	16 bits, BIN

Suitable soft components

Word

Operands	System								Constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S1	●	●		●	●				●		
S2	●	●		●	●				●		
S3	●	●		●	●				●		
D2									K		

Bit

Operands	System						
	X	Y	M*	S*	T*	C*	Dnm
D1	●	●	●	●	●	●	

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS. M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Function



- Read input coil, Modbus function code is 02H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- Operand S3: K1~K2000, max input coil number is 2008.

- When X0 is ON, INPR instruction is executed, Modbus read write flag SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.
- This instruction cannot read XINJE PLC input coil.

Single Coil Write [COLW]

Summary

Write local device specified coil to remote station no's coil.

Single Coil write [COLW]			
16 bits instruction	COLW	32 bits instruction	-
Execution Condition	Normally ON/OFF, edge triggering	Suitable Models	XD, XL
Hardware Requirement	-	Software Requirement	-

Operands

Operands	Function	Type
D1	Specify remote communication station number	16 bits, BIN
D2	Specify remote coil start address	16 bits, BIN
S1	Specify start address of local coil	bit
S2	Specify serial port number	16 bits, BIN

Suitable soft components

Word


Operands	System								Constant	Module	
	D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
D1	●	●		●	●				●		
D2	●	●		●	●				●		
S2									K		

Bit

Operand	System						
	X	Y	M*	S*	T*	C*	Dnm
S1	●	●	●	●	●	●	

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS. M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Function



- Write single coil, Modbus function code is 05H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- When X0 is ON, COLW instruction is executed, Modbus read write flag SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

Multiple coils write [MCLW]

Summary

Write local device multiple coils to remote station no's coil.

Multiple coils write [MCLW]			
16 bits instruction	MCLW	32 bits instruction	-
Execution Condition	Normally ON/OFF, edge triggering	Suitable models	XD, XL
Hardware Requirement	-	Software Requirement	-

Operands

Operands	Function	Type
D1	Specify remote communication station number	16 bits, BIN
D2	Specify remote coil start address	16 bits, BIN
D3	Specify coil number	16 bits, BIN
S1	Specify start address of local coils	bit
S2	Specify serial port number	16 bits, BIN

Suitable soft components

Word	Operands	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D1	•	•	•	•					•		
	D2	•	•	•	•					•		
	D3	•	•	•	•					•		
	S2									K		

Bit

Operands	System						
	X	Y	M*	S*	T*	C*	Dnm
S1	•	•	•	•	•	•	

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS. M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Function



- Write multiple coils, Modbus function code is 0FH.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- Operand D3: max coil number is 1976.
- When X0 is ON, MCLW instruction is executed, Modbus read write flag SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

Register read [REGR]

Summary

Read remote station no's register to local device.

Register read[REGR]			
16 bits instruction	REGR	32 bits instruction	-
Execution Condition	Normally ON/OFF, edge triggering	Suitable models	XD, XL
Hardware Requirement	-	Software Requirement	-

Operands

Operands	Function	Type
----------	----------	------


S1	Specify remote communication station number	16 bits, BIN
S2	Specify remote register start address	16 bits, BIN
S3	Specify register number	16 bits, BIN
D1	Specify start address of local register	16 bits, BIN
D2	Specify serial port number	16 bits, BIN

Suitable soft components

Word	Operands	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S1		•	•	•	•					•		
S2		•		•	•					•		
S3		•	•	•	•					•		
D1		•										
D2										K		

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Function



- Read register, Modbus function code is 03H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- Operand S3: max register number is 125.
- When X0 is ON, REGR instruction is executed, Modbus read write flag SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

Input register read [INRR]

Summary

Read remote station no's input register to local device.

Input register read [INRR]			
16 bits instruction	INRR	32 bits instruction	-
Execution Condition	Normally ON/OFF, edge triggering	Suitable models	XD, XL

Hardware Requirement	-	Software Requirement	-
----------------------	---	----------------------	---

Operands


Operands	Function	Type
S1	Specify remote communication station number	16 bits, BIN
S2	Specify remote register start address	16 bits, BIN
S3	Specify register number	16 bits, BIN
D1	Specify start address of local register	16 bits, BIN
D2	Specify serial port number	16 bits, BIN

suitable soft components

Word	Operands	System							Constant	Module		
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	●	●	●	●					●		
	S2	●	●	●	●					●		
	S3	●	●	●	●					●		
	D1	●										
	D2									K		

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Function



- Read input register, Modbus function code is 04H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- Operand S3: max register number is 125.
- When X0 is ON, INRR instruction is executed, Modbus read write flag SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

Single Register write [REGW]

summary

Write local device register to specified remote station no's register.

Register write[REGW]			
16 bits instruction	REGW	32 bits instruction	-
Execution Condition	Normally ON/OFF, edge triggering	Suitable models	XD, XL
Hardware Requirement	-	Software Requirement	-

Operands


Operands	Function	Type
D1	Specify remote communication station number	16 bits, BIN
D2	Specify remote register start address	16 bits, BIN
S1	Specify start address of local register	16 bits, BIN
S2	Specify serial port number	16 bits, BIN

suitable soft components

Word	Operands	System								Constant	Module	
		D	FD	TD	CD	DX	DY	DM	DS	K/H	ID	QD
	D1	•	•	•	•					•		
	D2	•	•	•	•					•		
	S1	•										
	S2									K		

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Function



- Write register, Modbus function code is 06H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- When X0 is ON, REGW instruction is executed, Modbus read write flag SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

Multiple registers write [MRGW]

Summary

Write local device multiple registers to remote station no's registers.

Multi-register write [MRGW]			
16 bits instruction	MRGW	32 bits instruction	-
Execution Condition	Normally ON/OFF, edge triggering	Suitable models	XD, XL
Hardware Requirement	-	Software Requirement	-

Operands


Operands	Function	Type
D1	Specify remote communication station number	16 bits, BIN
D2	Specify remote register start address	16 bits, BIN
D3	Specify register number	16 bits, BIN
S1	Specify start address of local registers	16 bits, BIN
S2	Specify serial port number	16 bits, BIN

suitable soft components

Word	Operands	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D1	•	•	•	•					•		
	D2	•	•	•	•					•		
	S1	•										
	S2									K		

Notes: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

Function



- Write multiple registers, Modbus function code is 10H.
- Serial port: K0~K5. K0: Port0 (RS232), K1: Port1(RS232), K2: Port2(RS485), K3: Port3(left extension port), K4: Port4(above extension port 1), K5: Port5(above extension port 2).
- Operand D3: the max register number is 123.
- When X0 is ON, MRGW instruction is executed, Modbus read write flag

SM160(serial port2) is set ON, SM160 is set OFF when the execution is completed. If a communication error occurs and the number of resend is set, it will be automatically resend. Users can check the relevant registers to determine the cause of the error. The execution result of Modbus read and write instructions of serial port 2 is in SD160.

6-2-6. Modbus serial port configuration

There are two ways to set Modbus communication parameters: 1. setting parameters by programming software; 2. setting parameters by XINJEConfig tool;

1. Set parameters by programming software

When using programming software to configure the parameters of PLC serial port, the version below V3.4 must use XNET communication mode, and the version above V3.4 can also use Modbus communication mode (RS232 port).


- (1) Use the USB download cable to connect the PLC with the computer. Here the USB download cable is the HMI download cable, as shown below, the software must switch to XNet communication mode.



- (2) Open the programming software, click configure/PLC comm port settings. It will show below figure:



- (3) Click add, it will show two modes, modbus mode and free mode, please select modbus mode, it will show below figure.



Port No.: It refers to Port of PLC, COM0 refers to Port 0 (RS232), COM1 refers to Port 1 (RS232), COM2 refers to Port 2 (RS485) or Port 2-RS232 (RS485) or Port 2-RS485 (RS485), COM3 refers to Port 3 (left extended ED port), COM4 refers to Port 4 (upper extended BD port 1), COM5 refers to Port 5 (upper extended BD port 2).

The baud rate, data bit, parity bit, stop bit should be same to the communication device.

Station number: if the PLC is master, the station no. is defaulted 1, if the PLC is slave, it needs to set different station no.

Two communication modes: RTU, ASCII.

Delay before sending: Waiting time before PLC sends data. In the original XC series PLC, if the master PLC communicates with the slave PLC, the master PLC sends data to the slave PLC. If the master PLC sends data to the slave PLC after the first time, and the slave PLC has not yet had time to receive the data, then the master PLC sends data to the slave PLC again, which easily leads to the error of the slave PLC; In XD series PLC, it has send delay to solve the problem. That is, after receiving data from the slave station, it must delay a certain time to receive the next communication data, so as not to cause the above problems.

Reply overtime (ms): it refers to the time when the PLC can not receive the response after sending the request and wait for sending again.

Retry times: It refers to the number of times that the PLC can not receive the reply, and each reply needs a reply timeout time.

- (4) After setting, click write to PLC, then cut off the PLC power supply and power on again to make the settings effective.

Note: V3.4 version of the XD series of PLC download and upload serial configuration data must use XNET communication mode, that is, using USB port to download and upload configuration data. If the following prompt appears, you need to check whether the serial port parameters you configured are downloaded from the USB port to the PLC.

Note: Versions V3.4 and above can be configured in Modbus communication mode (RS232 port); Versions V3.4 and below XD series PLC must use X-NET

communication mode when downloading and uploading serial configuration data, that is, downloading and uploading configuration data through USB port.


2. Set the parameters by using XINJEConfig tool

When using configuration tool XINJEConfig to configure parameters of PLC serial port, the XINJEConfig tools of V1.6.308 and below must use USB port. The XINJEConfig tool for V1.6.309 and above can also be configured using RS232 port.


- (1) Use the USB download cable to connect the PLC with the computer. Here the USB download cable is the HMI download cable, as shown below.



- (2) Open xinjeconfig tool

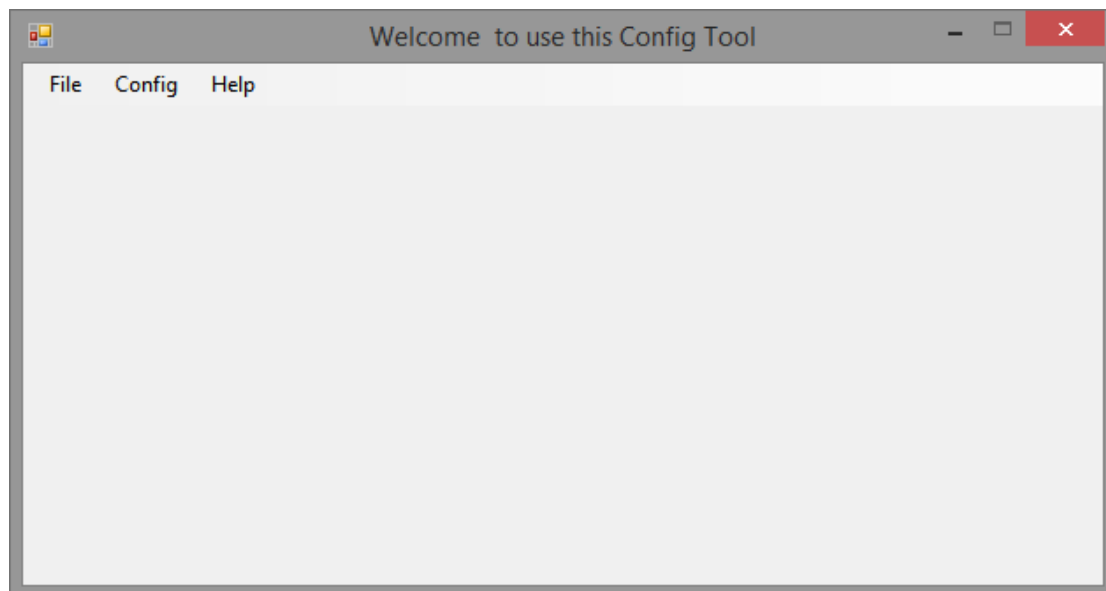


- (3) Click config/find device:




The com port is connecting PC and PLC, please check it in the device manage

- (4) Choose the com port connecting PC and PLC, click ok. Click config/single

device/comport.

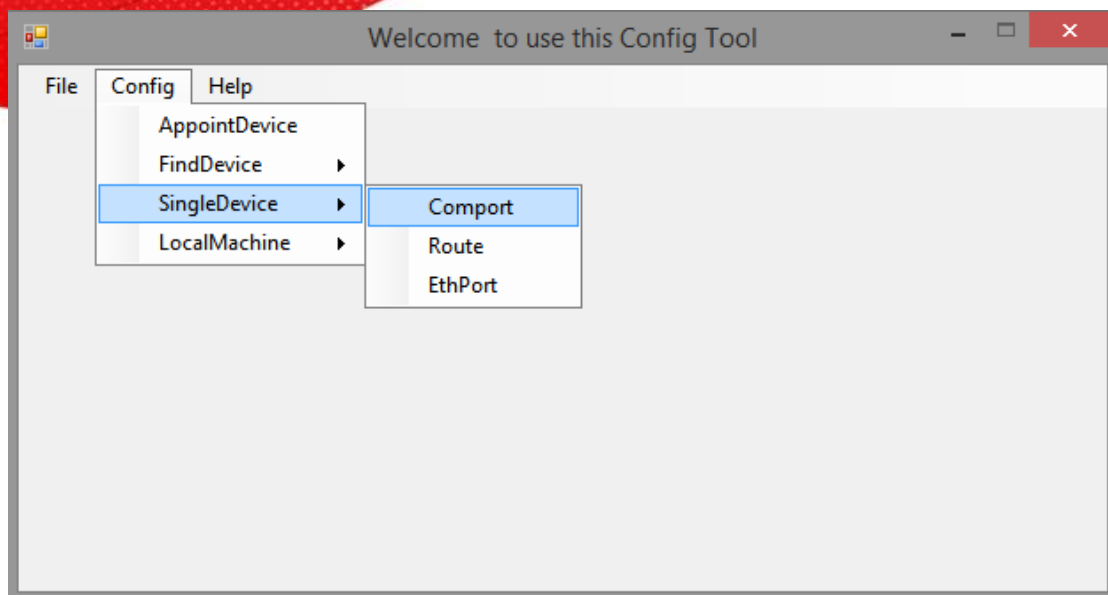


(5) It will show below window.

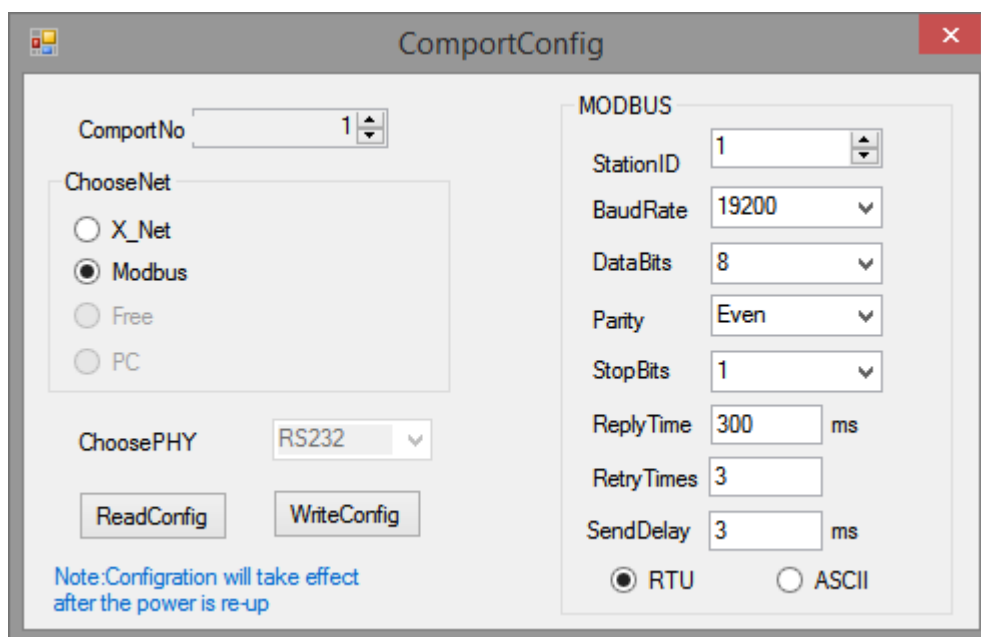

Serial port: K0 ~ K5. Port0 (RS232), Port1 (RS232), Port2 (RS485) or Port2-RS232 (RS232) or Port2-RS485 (RS485), Port3 (left extension port), Port4 (upper extension port 1), Port5 (upper extension port 2).

Here, we can set the communication mode and parameters of each communication port.

(6) When the com port parameters setting is completed, click writeconfig. It will show "write configuration success" message.




- (7) Close XINJEConfig tool, cut the PLC power and power on again to make the settings effective.

6-2-7. Modbus Communication application

Wiring method

There are two wiring methods:


232 wiring methods



Note:

1. COM2 with *1 only show the RS232 pins.
2. XD/XL series PLC, RS232 do not support full-duplex, so it can only communicate in single direction.
3. RS232 communication distance is short (about 13m); RS485 is suitable for longer distance.

485 wiring methods




Connect all A terminals, connect all B terminals. A is RS485+, B is RS485-.

Application: One xinje XD3 series PLC controls 3 XC series PLCs, slave PLCs follow the master's action. (Master PLC Y0 ON, then slave PLC Y0 ON; Master PLC Y0 OFF,


then slave PLC Y0 OFF) Precondition: on-off of Y0 makes communication have enough time to react. Also three slave PLCs can be not that synchronous (not fully synchronous).

Method 1 usual program



The program takes serial port 2 as example, so corresponding communication flag is the serial port 2's. About other serial port, please refer to appendix 1. Serial port, please refer to appendix 1.

Method 2 use broadcasting function:



When master Y0 status changes, it broadcasts the status to all the slaves. The synchronization of three PLCs is better than method 1.

6-2-8. Application


Example 1:

Following are the programs for reading and writing Modbus communication between 1 master station and 3 slave stations.

Program operation:

- (1) Write master PLC Y0~Y11 status to slave PLC 2 Y0~Y11
- (2) Read slave PLC 2 Y0~Y11 to master PLC M10~M19
- (3) Write master PLC D10~D19 to slave PLC 2 D10~D19
- (4) Read slave PLC 2 D10~D19 to master PLC D20~D29
- (5) So as slave PLC 3 and 4

The following is a comparison of XC and XD series Modbus-RTU communication programs for reference. The communication programs in XC series are as follows:

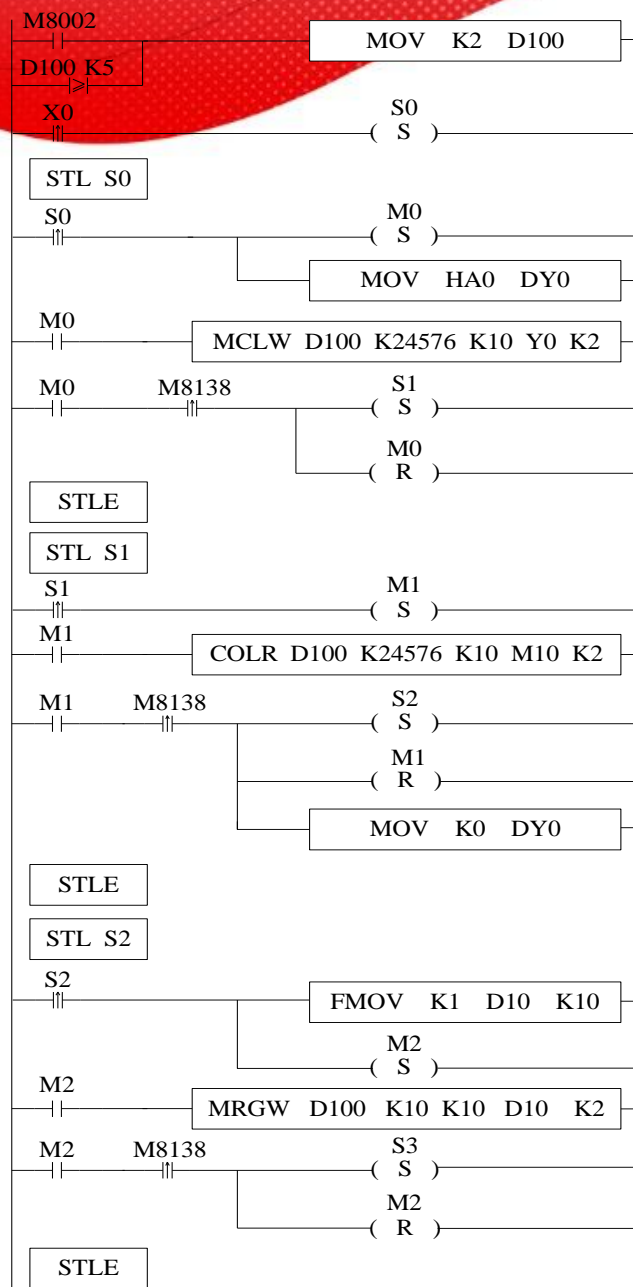


//send station no.2 to D100,
execute the process S0

//set ON Y0~Y11 of master
station, write the master status to
Y0~Y11 of slave PLC 2, 3, 4.
Enter process S1 when the
communication succeeded.

//read the Y0~Y11 of slave PLC 2,
3, 4 to master PLC M10~M19.
Reset master PLC Y0~Y11 and
enter process S2 after the
communication is successful.


//write 1 to master PLC D10~D19,
write the master PLC D10~D19 to
D10~D19 of slave PLC 2, 3, 4.
Enter process S3 when the
communication is successful.

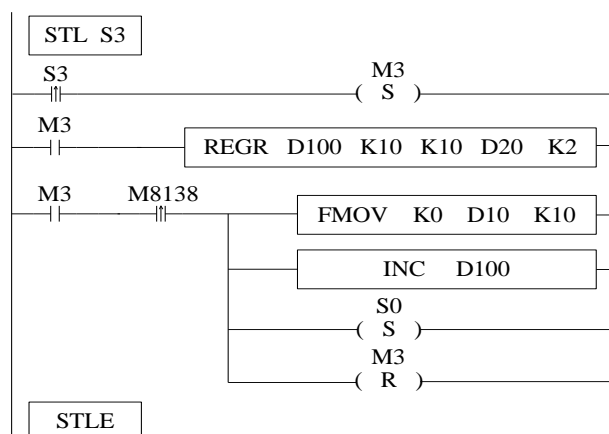

//read the D10~D19 of slave PLC
2, 3, 4 to master PLC D20~D29,
reset D10~D19 after the
communication is successful, then
the station no. is added 1, process
S0 is executed, cycle.

Modbus-RTU instruction processing mode has changed. Users can write Modbus-RTU instructions directly in user programs. Protocol stack will queue Modbus-RTU communication requests. Communication is another task. In the main program, users can write multiple Modbus-RTU communication instructions together and trigger them at the same time through the same triggering condition. PLC will trigger these communications. Instructions are queued according to the protocol station by Modbus-RTU, which will not cause communication errors when multiple communication instructions are executed at the same time as the original XC series PLC.

XD series program:

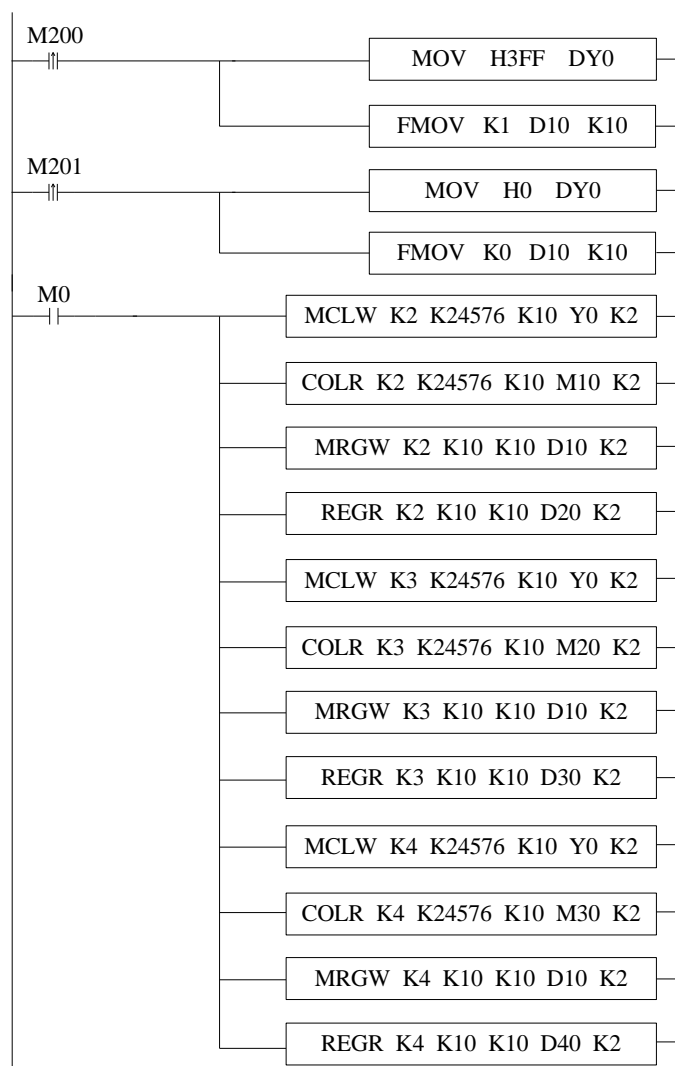

//at the rising edge of M200, set ON the master PLC Y0~Y11, D10~D19 are set to 1, at the rising edge of M201, set OFF Y0~Y11 of master PLC, reset D10~D19.

//write the Y0~Y11 of master PLC to Y0~Y11 of slave PLC 2, read the Y0~Y11 of slave PLC 2 to M10~M19 of master PLC. Write the D10~D19 of master PLC to D10~D19 of slave PLC 2. Read the D20~D29 of slave PLC 2 to D20~D29 of master PLC.

6-3. Free communication

6-3-1. Free communication mode

Free format communication is data transmission in the form of data blocks, limited by the PLC cache, the maximum amount of data sent each time is 256 bytes.

The so-called free communication, i.e. custom protocol communication, now many intelligent devices on the market support RS232 or RS485 communication, but the protocols used by various products are different, such as: Xinje PLC uses standard Modbus-RTU protocol, some temperature controller manufacturers use custom protocols; if using Xinje PLC to communicate with temperature controller, it is necessary to use free communication to send data in full accordance with the protocol of the instrument manufacturer, so as to communicate.

Prerequisites for free communication:

1. Port0(RS232), Port1(RS232), Port2(RS485) or Port2-RS232(RS232) or Port2-RS485(RS485), Port3(left extension port), Port4(upper extension port 1), Port5(upper extension port 2) all support free communication. As the free communication needs to change the communication parameters, port1 is not recommended.
2. Baud rate: 300bps~3Mbps, 4.5Mbps~9Mbps (special model supported)
3. The data format must be the same as the lower device settings. There are several options as follows:
Data bit: 5 bits (special model supported), 6 bits (special model supported), 7 bits, 8 bits, 9 bits.
Parity bit: none, odd parity, even parity, empty, mask
Stop bit: 1 bit, 1.5 bit, 2 bits
4. Starter: 1 byte, terminator: 1 byte
Users can set a start/termination character. After setting the start/termination character, PLC automatically adds the start/termination character when sending data, and automatically removes the start/termination character when receiving data.
In fact, the initiator and terminator can be regarded as the data frame head and end in the protocol. Therefore, if the lower device communication has start and termination character, it can be set in the software or written in the protocol.
5. Communication mode: 8 bits, 16 bits
When 8-bit buffer is selected for communication, the high bytes of registers are invalid. PLC only uses the low bytes of registers to send and receive data.
When 16-bit buffer is selected for communication, the PLC will send all the data of the register, and send low-byte data first, then high-byte data.
When it is necessary to transfer low bytes and high bytes of one 16-bit register to another 16-bit register, 16-bit buffers must be selected for communication, and the number of communication bytes is 2. When the value stored in a 16-

bit register occupies only low bytes, we can choose 8-bit buffer to communicate. The number of communication bytes is 1. Usually when we communicate, the data will not exceed the low byte of a register (HFF), so we only need to use the default 8-bit buffer in the software to communicate.

6. Timeout: frame timeout (ms), reply timeout (ms)

Frame: A data string.

Frame timeout: refers to the time interval between two frames of data received by the PLC, which ensures that the PLC can distinguish the end time of receiving a frame. It is usually used to judge whether a frame of data in PLC has been received or not. When the interval between two frames of data is longer than the frame time-out, it means the end of one frame of communication data.

Reply timeout: refers to the time when the PLC can not receive the response after sending the request, waiting for the resend. If the response time is set to exceed 300 ms, when default communicating, the PLC waits 300ms for the other party to respond. If the response time is not received, the request will be sent again.


If you want to shorten the communication time, you can adjust the above two parameters according to the size of baud rate.

6-3-2. Serial port configuration


- (1) Use the USB download cable to connect the PLC with the computer. Here the USB download cable is the HMI download cable, as shown below, the software must switch to XNet communication mode.



- (2) Open the programming software, click configure/PLC comm port settings. It will show below figure:



- (3) Click add, it will show two modes, modbus mode and free mode, please select free mode, it will show below figure.



Port No.: It refers to Port of PLC, COM0 refers to Port 0 (RS232), COM1 refers to Port 1 (RS232), COM2 refers to Port 2 (RS485) or Port 2-RS232 (RS485) or Port 2-RS485 (RS485), COM3 refers to Port 3 (left extended ED port), COM4 refers to Port 4 (upper extended BD port 1), COM5 refers to Port 5 (upper extended BD port 2).

Frame timeout (ms): It refers to the time interval between two frames of data sent by PLC, which ensures that the receiver distinguishes the end time of receiving a frame.

Response timeout (ms): refers to the time when the PLC can not receive the response after sending the request, waiting for the resend.

Other serial parameters can be set according to the parameters of the lower device.

- (4) After setting, click write to PLC, then cut off the PLC power supply and power

on again to make the settings effective.

Note: Versions V3.4 and above can be configured in Modbus communication mode (RS232 port); Versions V3.4 and below XD series PLC must use X-NET communication mode when downloading and uploading serial configuration data, that is, downloading and uploading configuration data through USB port.

6-3-3. Suitable occasion

When does free communication need to be used?

As an example, the situation described in the above section is that XINJE PLC communicates with the temperature control instrument, and the instrument uses its own communication protocol, which stipulates that the reading temperature should be sent four characters: "R", "T", "CR". Each character has the following meanings:

Character	Meaning
:	Data start
R	Read
T	temperature
CR	Enter, data end

PLC needs to send the ASCII code of the above characters to the instrument in order to read the current temperature value measured by the instrument. The ASCII code values (hexadecimal) of each character can be obtained by querying the ASCII code table.

Character	ASCII code value
:	3A
R	52
T	54
CR	0D

Obviously, according to the situation described above, using MODBUS instructions can not communicate, at this time you need to use free communication. Detailed usage will be used as an example to program the sample program in later chapters.

6-3-4. Free communication instruction

Send data [SEND]

1. Instruction overview

Write the local data to specified remote station address.

Send data [SEND]			
16-bit instruction	SEND	32-bit instruction	-
Execution condition	Normally ON/OFF, rising edge triggering	Suitable model	XD, XL

Hardware	V3.2.3 and higher version	Software	V3.2.2 and higher version
----------	---------------------------	----------	---------------------------


2. Operand

Operand	Function	Type
S1	Local data starting address	16-bit, BIN
S2	Send byte number	16-bit, BIN
n	Communication port no.	16-bit, BIN


3. Suitable soft component

Word	operand	System								constant	Module		
		D	FD	ED	TD	CD	DX	DY	DM	DS	K/H	ID	QD
	S1	●	●		●	●							
	S2	●	●		●	●					●		
	n	●									K		

Function and action



- Data sending instructions, M0's rising edge sends data once.
- Communication port. Scope: K0 ~ K5. Port0, Port1, Port2 or Port2-RS232 or Port2-RS485, Port3, Port4, Port5.
- In the process of data transmission, the "sending" flag SM162 (communication port 2) is set on.



- When the buffer number is 8 bits, only low-byte data is sent, so D100 = the number of registers sent, for example, to send low-byte data in D10-D17, D100 should be set to 8.
- When the buffer number is 16 bits, high and low byte data will be sent, so D100 = the number of registers sent * 2. For example, when sending high and low byte data in D10-D17, D100 should be set to 16, and when sending, low byte will be before the high byte.

Receive data [RCV]

1. Instruction overview

Write the specified remote station no's data to local device.

Send data [RCV]			
16-bit instruction	RCV	32-bit instruction	-
Execution condition	Normally ON/OFF, rising edge triggering	Suitable model	XD, XL
Hardware	V3.2.3 and higher version	Software	V3.2.2 and higher version


2. Operand

Operand	Function	Type
S1	Local data starting address	16-bit, BIN
S2	Receive byte number or soft component address	16-bit, BIN
n	Communication port no.	16-bit, BIN


3. Suitable soft component

Word	operand	System								constant	Module		
		D	FD	ED	TD	CD	DX	DY	DM	DS	K/H	ID	QD
	S1	●	●		●	●							
	S2	●	●		●	●					●		
	n										●		

Function and action



- Data receiving instructions, M1's rising edge receives data once.
- Communication port. Scope: K0 ~ K5. Port0, Port1, Port2 or Port2-RS232 or Port2-RS485, Port3, Port4, Port5.
- After receiving the data, the "received" flag SM163 (communication port 2) is set on.



- When the buffer number is 8 bits, the received data is only stored in low bytes, so $D200 = \text{the number of bytes to be received} \times 2$, for example, to receive 8

bytes of data, stored in the low bytes of the eight registers D20-D27 in turn, at this time, D200 should be set to 16.

- When the buffer number is 16 bits, the received data is stored in a complete register, so D200 = the number of bytes to be received, for example, to receive 8 bytes of data, stored in the four registers of D20-D23 in turn, at this time, D200 should be set to 8. And when receiving, low bytes are before high bytes.

Release serial port [RCVST]

1. Instruction overview

Release the specified serial port.

Release serial port [RCVST]			
16-bit instruction	RCVST	32-bit instruction	-
Execution condition	Normally ON/OFF, rising edge triggering	Suitable model	XD, XL
Hardware	V3.2.3 and higher version	Software	V3.2.2 and higher version


2. Operand

Operand	Function	Type
n	Communication port no.	16-bit, BIN


3. Suitable soft component

Word	operand	System								constant	Module	
		D	FD	ED	TD	CD	DX	DY	DM	DS	K/H	ID
	n										K	

Function and action



- Release serial port instructions, M0's rising edge execute once.
- Communication port. Scope: K0 ~ K5. Port0, Port1, Port2 or Port2-RS232 or Port2-RS485, Port3, Port4, Port5.
- When releasing the serial port, the "received" flag SM163 (communication port 2) is set OFF.
- For free communication, if there is no timeout or the timeout time is set too long, the occupied serial port resources can be released immediately through RCVST instructions for other communication operations.




6-3-5. Free communication example

Example 1: In chapter 6-3-3, we give an example of communication between Xinje PLC and temperature control instrument when explaining why to use free communication. Here is an example.

Operation steps:

1. Connect the hardware first. Here we use the serial port 2 of the PLC to communicate, that is, 485 + on the instrument is connected to A of the output port of the PLC, and 485- on the instrument is connected to B of the output port of the PLC.
2. Set the serial port parameters of PLC according to the communication parameters of temperature control instrument. The parameters are set as follows. After setting the parameters, the power can be restarted.



3. make the program according to the descriptions in chapter 6-3-3.

Read temperature: “:” “R” “T” “CR”


“:” ----- data start

“R” ----- read

“T” ----- temperature

“CR” ----- enter, data end

Program:




When trying to communicate between PLC and other intelligent devices, it is suggested to use serial debugging tool to determine the data format of communication, that is, protocol. The advantages of this method are: the serial debugging tool is easy to modify and flexible to use; after the serial debugging tool determines that communication can be successful, the PLC program is written according to the data format obtained, which is often twice the result with half the effort. In fact, Modbus-RTU protocol can be regarded as a special kind of free protocol. The relationship between them is similar to ellipse and circle. We can try to use free format to realize the function of Modbus instruction.

Example 2: The values of the five registers of a XD3 PLC are sent to the D1-D5 of another XDM PLC.


If the user understands the Modbus communication, he can use the Modbus-RTU communication mode to do so, as long as he writes a "write multiple register instructions (MRGW)" in the host. Here we do it in free communication mode.

Operation steps:

1. Connect the hardware first. Here we use the serial port 2 of the PLC to communicate, that is, connect A of the two PLC, and connect B of the two PLC.
2. Set the same serial port parameters of the two PLC. The parameters are set as follows. After setting the parameters, the power can be restarted.

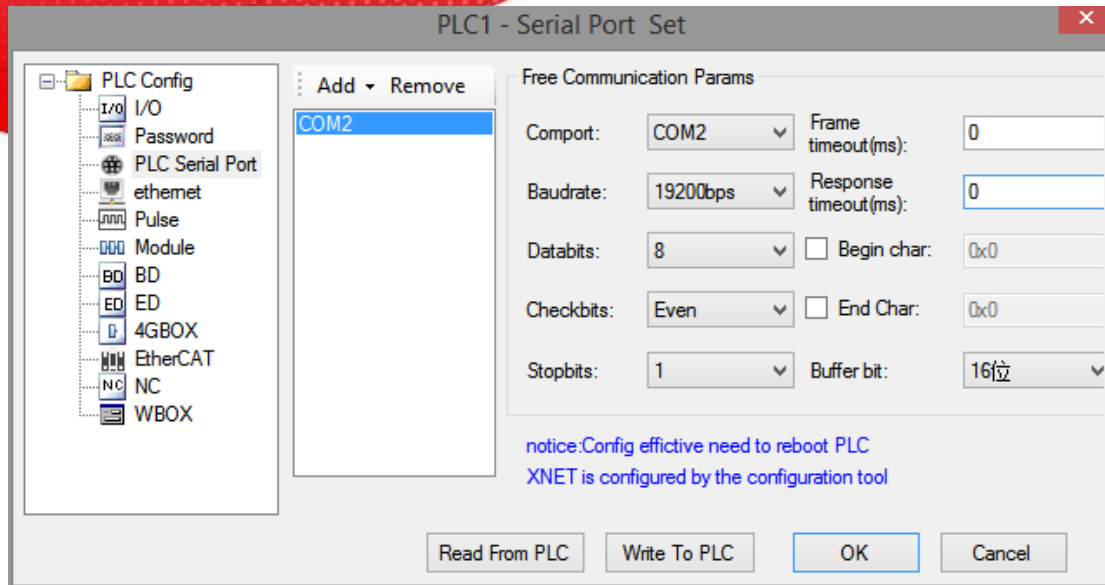

3. XD3 program:



XDM program:



Sometimes the data of user communication is stored in multiple registers in the form of ASCII code. Users need to take this value out, store it in a register and display it on the HMI. Customers often consider using HEX (ASCII to hexadecimal) instructions to achieve it. But HEX instructions are difficult to use and understand. Often, we will not use this instruction to complete it. The relationship between values can be found by ASCII code comparison table.

ASCII code table:

ASCII value	Control character	ASCII value	Control character	ASCII value	Control character	ASCII value	Control character
0	NUT	32	(space)	64	@	96	`
1	SOH	33	!	65	A	97	a

2	STX	34	"	66	B	98	b
3	ETX	35	#	67	C	99	c
4	EOT	36	\$	68	D	100	d
5	ENQ	37	%	69	E	101	e
6	ACK	38	&	70	F	102	f
7	BEL	39	'	71	G	103	g
8	BS	40	(72	H	104	h
9	HT	41)	73	I	105	i
10	LF	42	*	74	J	106	j
11	VT	43	+	75	K	107	k
12	FF	44	,	76	L	108	l
13	CR	45	-	77	M	109	m
14	SO	46	。	78	N	110	n
15	SI	47	/	79	O	111	o
16	DLE	48	0	80	P	112	p
17	DC1	49	1	81	Q	113	q
18	DC2	50	2	82	R	114	r
19	DC3	51	3	83	S	115	s
20	DC4	52	4	84	T	116	t
21	NAK	53	5	85	U	117	u
22	SYN	54	6	86	V	118	v
23	TB	55	7	87	W	119	w
24	CAN	56	8	88	X	120	x
25	EM	57	9	89	Y	121	y
26	SUB	58	:	90	Z	122	z
27	ESC	59	;	91	[123	{
28	FS	60	<	92	\	124	
29	GS	61	=	93]	125	}
30	RS	62	>	94	^	126	~
31	US	63	?	95	—	127	DEL

Example 3: A pressure controller communicates with PLC in free communication mode to realize data acquisition. The value displayed on the pressure controller is - 0.7814 MPa. The value collected by PLC is stored from D0, and seven registers are stored in turn. However, the value of the seven registers combination needs to be taken out and stored in D46 in the form of decimal.

Through the data monitoring of PLC, ASCII codes in D0~D6 registers can be monitored as follows:

PLC-数据监控									
搜索: D7									
	X	Y	M	S	SM	T	ET	C	HM
	HS	HT	HC	HSC	D	SD	ID	QD	HD
	HSD	FD	SFD	SEM					
	+0	+1	+2	+3	+4	+5	+6	+7	+8
D0	-	0	.	7	8	1	4		
D10									
D20									
D30									
D40									

10进制 2进制 16进制 无符号 ASCII

Switch to decimal format and show as below:


	+0	+1	+2	+3	+4	+5	+6	+7	+8	+9
D0	45	48	46	55	56	49	52	0	0	0
D10	0	0	0	0	0	0	0	0	0	0
D20	0	0	0	0	0	0	0	0	0	0
D30	0	0	0	0	0	0	0	0	0	0
D40	0	0	0	0	0	0	0	0	0	0

By comparing the relationship between ASCII codes and decimal values, we can find the rule that there is 48 difference between ASCII codes in D1, D3, D4, D5, D6 and decimal values. The final decimal values are obtained by subtracting the values in registers by K48 and multiplying by 10. The formula is as follows:

$$D46=(D1-48)*1+(D3-48)*0.1+(D4-48)*0.01+(D5-48)*0.001+(D6-48)*0.0001$$

D0 is a symbol bit. Looking up the table, we know that when D0 = K45, it represents a negative value; when D0 = K43, it represents a positive value.

The ladder diagram is as follows:



6-4. Communication flag and register

Communication flag

Serial port	Register address	Function	Explanation
Port 0	SM140	Modbus read-write instruction execution flag	When the instruction starts to execute, set ON When execution is completed, set OFF
	SM141		
	SM142	Free communication sending flag	When the instruction starts to execute, set ON When execution is completed, set OFF
	SM143	Free communication received flag	When receiving a frame of data or receiving data timeout, set ON. Require user program to set OFF
	SM144		
		
	SM149		
Port 1	SM150	Modbus read-write instruction execution flag	When the instruction starts to execute, set ON When execution is completed, set OFF
	SM151		
	SM152	Free communication sending flag	When the instruction starts to execute, set ON When execution is completed, set OFF
	SM153	Free communication received flag	When receiving a frame of data or receiving data timeout, set ON. Require user program to set OFF
	SM154		
		
	SM159		
Port 2	SM160	Modbus read-write instruction execution flag	When the instruction starts to execute, set ON When execution is completed, set OFF
	SM161		
	SM162	Free communication sending flag	When the instruction starts to execute, set ON When execution is completed, set OFF
	SM163	Free communication received flag	When receiving a frame of data or receiving data timeout, set ON. Require user program to set OFF

	SM164		
		
	SM169		
Port 3	SM170~SM179		
Port 4	SM180~SM189		
Port 5	SM190~SM199		

Communication registers

	No.	Function	Explanation
Port 0	SD140	Modbus read and write instruction execution result	0: correct 100: receive error 101: receive timeout 180: CRC error 181: LRC error 182: station number error 183: send buffer overflow 400: function code error 401: address error 402: length error 403: data error 404: slave station busy 405: memory error (erase FLASH)
	SD141	X-Net communication result	0: correct 1: communication timeout 2: memory error 3: receive CRC error
	SD142	Free communication sending result	0: correct 410: free communication buffer overflow
	SD143	Free communication receiving result	0: correct 410: send data length overflow 411: receive data short 412: receive data long 413: receive error 414: receive timeout 415: no start symbol 416: no end symbol
	SD144	free communication receiving data number	Count as byte, not include start symbol and end symbol
		
	SD149		
Port 1	SD150	Modbus read and write instruction execution result	0: correct 100: receive error 101: receive timeout 180: CRC error 181: LRC error 182: station number error 183: send buffer overflow 400: function code error 401: address error

			402: length error 403: data error 404: slave station busy 405: memory error (erase FLASH)
	SD151	X-Net communication result	0: correct 1: communication timeout 2: memory error 3: receive CRC error
	SD152	Free communication sending result	0: correct 410: free communication buffer overflow
	SD153	Free communication receiving result	0: correct 410: send data length overflow 411: receive data short 412: receive data long 413: receive error 414: receive timeout 415: no start symbol 416: no end symbol
	SD154	free communication receiving data number	Count as byte, not include start symbol and end symbol
		
	SD159		
Port 2	SD160	Modbus read and write instruction execution result	0: correct 100: receive error 101: receive timeout 180: CRC error 181: LRC error 182: station number error 183: send buffer overflow 400: function code error 401: address error 402: length error 403: data error 404: slave station busy 405: memory error (erase FLASH)
	SD161	X-Net communication result	0: correct 1: communication timeout 2: memory error 3: receive CRC error
	SD162	Free communication sending result	0: correct 410: free communication buffer overflow
	SD163	Free communication receiving result	0: correct 410: send data length overflow 411: receive data short 412: receive data long 413: receive error 414: receive timeout 415: no start symbol 416: no end symbol
	SD164	free communication receiving data number	Count as byte, not include start symbol and end symbol
		

	SD169		
Port 3	SD170~SD179		
Port 4	SD180~SD189		
Port 5	SD190~SD199		

6-5. Read write serial port parameters

In addition to modifying communication parameters through serial configuration panel, it can also be realized by reading instruction [CFGCR] of serial parameters and writing instruction [CFGCW] of serial parameters.

6-5-1. Read serial port parameters [CFGCR]

1. Instruction overview

Read the serial port parameters to local specified registers.

Read serial port parameters [CFGCR]			
16-bit instruction	CFGCR	32-bit instruction	-
Execution condition	Normally ON/OFF, rising edge triggering	Suitable model	XD, XL
Hardware	-	Software	V3.4 and higher version

2. Operand


Operand	Function	Type
D	Local register starting address	16-bit, BIN
S1	Read serial port parameters number	16-bit, BIN
S2	Serial port no.	16-bit, BIN

3. Suitable soft component

Word	operand	System								constant	Module		
		D	FD	ED	TD	CD	DX	DY	DM	DS	K/H	ID	QD
	D	●											
	S1	●	●								●		
	S2	●									●		

*** Note:** D denotes D HD; TD denotes TD HTD; CD denotes CD HCD HSCD HSD; DM denotes DM DHM; DS stands for DS DHS.

Function and action



- Operator S1: The number of registers used to read serial parameters is generally 8 (XD5E/XDME series is 9).
- Operator S2: Serial port range: K0 ~ K5. K0: Port0, K1: Port1, K2: Port2 or Port2-RS232 or Port2-RS485, K3: Port3, K4: Port4, K5: Port5.
- Read 8 parameters of serial port 2 to HD0~HD7. See sections 6-5-3 for the names and definitions of specific parameters.

6-5-2. Write serial port parameters [CFGWCW]

1. Instruction overview

Write the local specified register value to specific serial port.

Write serial port parameters [CFGWCW]			
16-bit instruction	CFGWCW	32-bit instruction	-
Execution condition	Normally ON/OFF, rising edge triggering	Suitable model	XD, XL
Hardware	-	Software	V3.4 and higher version

2. Operand

Operand	Function	Type
S1	Local register starting address	16-bit, BIN
S2	Write serial port parameters number	16-bit, BIN
S3	Serial port no.	16-bit, BIN

3. Suitable soft component

Word	operand	System								constant	Module		
		D	FD	ED	TD	CD	DX	DY	DM	DS	K/H	ID	QD
	S1	●											
	S2	●	●								●		
	S3	●									●		

* **Note:** D denotes D HD; TD denotes TD HTD; CD denotes CD HCD HSCD HSD; DM denotes DM DHM; DS stands for DS DHS.

Function and action



- Operator S2: The number of registers used to write serial parameters is generally 8 (XD5E/XDME series is 9).
- Operator S3: Serial port range: K0 ~ K5. K0: Port0, K1: Port1, K2: Port2 or

Port2-RS232 or Port2-RS485, K3: Port3, K4: Port4, K5: Port5.

- Write HD0~HD7 parameters to serial port 2. See sections 6-5-3 for the names and definitions of specific parameters.

6-5-3. Serial port parameter name and setting

Assuming that HD0~HD14 corresponds to serial port parameters, the parameter names and settings represented by registers are shown in the table below.

Parameter address	Parameter name and settings				
	MODBUS communication (HD0=1)	Free communication (HD0=2)	X-NET communication		Ethernet communication (HD0=3)
			OMMS (HD0=3)	TBN (HD0=3)	
HD0	Network type 1: MODBUS; 2: free ; 3: X-NET; 4: MODBU-TCP				
HD1	MODBUS station no. 1~254	Baud rate refer to table 1	Net ID 0~32767	Net ID 0~32767	Net ID IP address high 2-byte
HD2	Transmission mode 0: RTU 128: ASCII	Frame format refer to table 2	Station no. 0~100	Station no. 0~100	Station no. IP address low 2-byte
HD3	Baud rate refer to table 1	Free properties bit7: 1: with start character 0: no start character bit6: 1: with end character 0: no end character	Physical layer type 1: PHY_RS485 2: PHY_SOF (Unidirectional Fiber Ring Network) 3: PHY_OFPP (Optical Fiber Point Network) 4: PHY_RS232 5: PHY_RS422 6: PHY_TTL (TTLvoltage network)		
HD4	Frame format refer to table 2	Start character	Link Layer Type 0: TBN 1: HDN 2: CCN 3: PPF 4: PPU 5: Ethernet		
HD5	retry count 0~5	End character	OMMS properties 128: Supports periodic communication, otherwise does not support	Baud rate refer to table 1	Subnet mask high 2-byte

HD6	Reply timeout 0~65535	Frame timeout 0~255	OMMS baud rate refer to table 1	Token Cycle Time 1~60000 (ms)	Subnet mask low 2-byte
HD7	Delay before sending 0~255	Reply timeout 0~65535 (0 is infinite wait)	OMMS slave station list Each bit of each byte in the array indicates whether the slave station is accessible (the master station is valid, i.e. the station number is 1).	Max station number 1~100	Gateway address high 2-byte
HD8	-	-	-	-	Gateway address low 2- byte

Note: The table does not contain "buffer digits" in free communication mode, so "buffer digits" can not be read and written through CFGCR and CFGCW instructions, but can be read and written using MOV instructions. The address of "buffer digits" is shown in Appendix 3.

Table 1: baud rate

Value	Baud rate	Value	Baud rate	Value	Baud rate	Value	Baud rate
1	300 bps	7	19200 bps	13	256000 bps	19	1000000 bps
2	600 bps	8	28800 bps	14	288000 bps	20	1200000 bps
3	1200 bps	9	38400 bps	15	384000 bps	21	1500000 bps
4	2400 bps	10	57600 bps	16	512000 bps	22	2400000 bps
5	4800 bps	11	115200 bps	17	576000 bps	23	3000000 bps
6	9600 bps	12	192000 bps	18	768000 bps		

Table 2: frame format

Stop bit		Parity bit			Data bit length		
Bit7	Bit6	Bit5	Bit4	Bit3	Bit2	Bit1	Bit0
00: 1		000: no			000: 5		
01: 1.5		001: odd			001: 6		
10: 2		010: even			010: 7		
		011: empty			011: 8		
		100: Mask			100: 9		

7 PID Control Function

In this chapter, we mainly introduce the applications of PID instructions for XD, XL series, including: call the instructions, set the parameters, items to notice, sample programs etc.

7-1. PID Introduction

PID instruction and auto tune function are added into XD/XL series PLC basic units. Via auto tune method, users can get the best sampling time and PID parameters and improve the control precision.

PID instruction has brought many facilities to the users.

Output can be data form D, HD, and on-off quantity Y, user can choose them freely when programming.

Via auto tune, users can get the best sampling time and PID parameters and improve the control precision.

User can choose positive or negative action via software setting. Positive action is used for heating control; negative action is used for cooling control.

PID control separates the basic units with the expansions, which improves the flexibility of this function.

XD/XL series PLC have two methods for auto tune, step response method and critical oscillation method.

For temperature control object:

Step response method: the PID auto tune will start when current temperature of object controlled is equal to ambient temperature.

Critical oscillation method: the PID auto tune can start at any temperature.

7-2. Instruction Form

Brief Introduction of the Instructions

Execute PID control instructions with the data in specified registers.

PID control [PID]			
16 bits instruction	PID	32 bits instruction	-

Executing condition	Normally ON/normally closed coil trigger	Suitable models	XD/XL
Hardware requirement	-	Software requirement	V3.2

Operands

Operands	Function	Type
S1	set the address of the target value (SV)	16bits, BIN
S2	set the address of the tested value (PV)	16 bits, BIN
S3	set the start address of the control parameters	16 bits, BIN
D	the address of the operation result (MV) or output port	16 bits, BIN; bit


Suitable soft components

	Operands	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
Word	S1	•	•							•		
	S2	•	•									
	S3	•	•									
	D	•	•									
Bit	Operands	System										
		X	Y	M*	S*	T*	C*	Dnm				
	D		•	•	•	•	•					

*Note: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.

M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Functions and Action




S3~ S3+ 69 will be occupied by this instruction, so please don't use them as the common data registers.

This instruction executes when each sampling time interval comes.

For the operation result, data registers are used to store PID output values; the output points are used to output the occupy duty ratio in the form of ON/OFF.

PID control rules are shown as below:

P: proportion, I: integral, D: differential

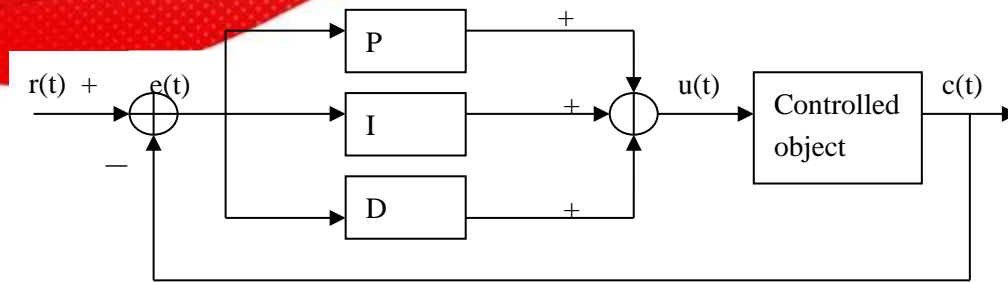

Analog PID control system

$$e(t) = r(t) - c(t) \quad (1-1)$$

$$u(t) = K_p [e(t) + 1/T_i \int e(t)dt + T_D de(t)/dt] \quad (1-2)$$

Here, $e(t)$ is offset value, $r(t)$ is the setting value, $c(t)$ is actual output value and the $u(t)$ is the control value;

In function (1-2), K_p is the proportion coefficient, T_i is the integration time coefficient, and T_D is the differential time coefficient.

The result of the operation:

1. Analog output: digital form of $MV = u(t)$, the default range is 0~4095.
2. Digital output: $Y = T * [MV / \text{PID output upper limit}]$. Y is the outputs activate time within the control cycle. T is the control cycle, equals to the sampling time. PID output upper limit default value is 4095.

7-3. Parameters setting

Users can call PID in XDP Pro software directly and set the parameters in the window (see graph below), for the details please refer to XDP Pro user manual. Users can also write the parameters into the specified registers by MOV instructions before PID operation.

PID Instruction Parameter Config

Target Value (SV): Measure Value (PV): Parameter: Output:

Parameter Config

☒ Manual ☐ Auto

Sampling Time: ms

Proportion Gain (KP): %

Integration Time (TI): *100ms

Differential Time (TD): *10ms

PID Computation Scope:

PID Control Death Band:

Self Study Periodic Value:

Self Study Method:

Self Study PID Control Mode:

Mode Config

☒ Common Mode ☐ Advanced Mode

Input Filter Constant (a): %

Differential Increase (KD): %

Output Upper Limit Value:

Output Lower Limit Value:

Direction Config

☒ Negative Movement ☐ Positive Movement

Negative Movement: Along with the increase of the measures definite value PV, outputvalue MV will also reduce. It's usually used in heat up control.

Positive Movement: Along with the increase of the measures definite value PV, outputvalue MV will also increase. It's usually used in cool control.

Overshoot Config

☒ Enable Overshoot ☐ Disable Overshoot

Each time adjust the increase: %

Current target value resident Count:

Suggestion value

Read From PLC Write To PLC OK Cancel

Parameter Range: HD0 - HD69

Auto tune mode:

PID Instruction Parameter Config

Target Value (SV): Measure Value (PV): Parameter: Output:

Parameter Config

☐ Manual ☒ Auto

Sampling Time: ms

Proportion Gain (KP): %

Integration Time (TI): *100ms

Differential Time (TD): *10ms

PID Computation Scope:

PID Control Death Band:

Self Study Periodic Value:

Self Study Method:

Self Study PID Control:

Mode Config

☒ Common Mode ☐ Advanced Mode

Input Filter Constant (a): %

Differential Increase (KD): %

Output Upper Limit Value:

Output Lower Limit Value:

Direction Config

☒ Negative Movement ☐ Positive Movement

Negative Movement: Along with the increase of the measures definite value PV, outputvalue MV will also reduce. It's usually used in heat up control.

Positive Movement: Along with the increase of the measures definite value PV, outputvalue MV will also increase. It's usually used in cool control.

Overshoot Config

☒ Enable Overshoot ☐ Disable Overshoot

Each time adjust the increase: %

Current target value resident Count:

Suggestion value

Read From PLC Write To PLC OK Cancel

Parameter Range: H00 - H069

V3.2 and higher version software can choose auto tune mode: step response or critical oscillation.

7-3-1. Register and their functions

PID control instruction's relative parameters ID, please refer to the below table:

ID	Function	Description	Memo
S3	Sampling time	Whatever it is manual or auto mode, all needs to set	32 bits without sign, Unit ms
S3+2	Mode setting	bit0: 0: negative action; 1: positive action bit1~bit6 not usable bit7: 0: manual PID; 1: auto tune PID bit8: 1: auto tune successful flag bit9 ~ bit10 : auto tune method 00: step response 01: critical oscillation	

		bit11~bit12: not useful bit13 ~ bit14 auto tune PID mode (valid in critical oscillation mode) 00: PID control 01: PI control 10: P control bit15: 0: regular mode; 1: advanced mode;	
S3+3	Proportion Gain (Kp)	Range: 1~32767[%]	
S3+4	Integration time (TI)	0~32767[unit: 100ms]	0 is taken as no integral.
S3+5	Differential time (TD)	0~32767[unit: 10ms]	0 is taken as no differential.
S3+6	PID operation zone	0~32767	PID adjustment band width value
S3+7	Control death zone	0~32767	PID output value will not change in death zone
S3+8	Sampling temperature filter coefficient	0~100[%]	Filter the input sampling temperature in advanced mode, 0 is no input filter
S3+9	Differential gain(KD)	0~100[%]	Only for advanced mode (normal mode default value is 50%), 0 is no differential gain
S3+10	Upper limit value of output	0~32767	
S3+11	Lower limit value of output	0~32767	
S3+12	Change of Unit Temperature Corresponds to Change of AD Value	full scale AD value * (0.3~1%) default value is 10	16-bit no sign, only for step PID
S3+13	PID auto tune overshoot	0: enable overshoot 1: not overshoot (try to reduce the overshoot)	only for step PID
S3+14	Current target value adjusting percentage every time in auto tune end transition stage	Cannot adjust	16-bit no sign, only for step PID
S3+15	Number of times exceeding the target value in auto tune end transition stage when limiting the overshoot		only for step PID, default value is 15
S3+16	PID type and status	Bit0~bit1: 00: manual mode	Internal use parameters of the

		01: step mode 10: Critical oscillation mode Bit8: 0: manual control status 1: auto tune end, enter manual control status	system for monitoring purposes only
S3+1 7	PID max output	0~32767	Internal use parameters of the system for monitoring purposes only
S3+1 8	PID min output	0~32767	Internal use parameters of the system for monitoring purposes only
S3+1 9	Last time sampling time	0~sampling time (unit: ms)	16-bit no sign, Internal use parameters of the system for monitoring purposes only
S3+2 0	Actual sampling time space	The value is around the sampling time	32-bit no sign, Internal use parameters of the system for monitoring purposes only
S3+2 2	Last time user set target temperature	The value before changing the target temperature	Internal use parameters of the system for monitoring purposes only
S3+2 3	-	-	Parameter is reserved

The following is the joint address (divided into step setting, critical oscillation setting and manual control)

Step part (read only parameters, only for monitoring)

S3+24	Actual sampling space	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+26	Operating segment of auto-tuning PID	0: Preparation stage 1 ~ 2: auto tune parameter collection 3: calculate PID parameters	Internal usage parameters of the system
S3+28	Duration of auto-tuning PID operating parameters	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+30	Real-time accumulation of two inflection points	Clear and recalculate the time when reaching the inflection point 0~4294967296 (unit: ms)	Internal usage parameters of the system

S3+32	Sampling variation of inflection point	Sampling difference between two inflection points -2147483648~2147483647	Internal usage parameters of the system
S3+34	Sampling interval time of inflection point EK	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+36	Time from auto-tuning PID to inflection point	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+38	Last sampling temperature	-32767~32767	Internal usage parameters of the system
S3+39	The time from auto-tuning PID operation to inflection point	-32767~32767 (unit: ms)	Internal usage parameters of the system
S3+40	Starting sampling value of auto-tuning PID operation	-32767~32767	Internal usage parameters of the system
S3+41	Number of times at inflection point during auto-tuning	0~65535	Internal usage parameters of the system
S3+42	Useless time	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+44	Stop temperature	Temperature at the end of auto-tuning Range: -32767~32767	Internal usage parameters of the system
Critical oscillation part (read only parameters, only for monitoring)			
S3+24	PID control mode	0: PID control 1: PI control 2: P control	16-bit no sign, internal usage parameters of the system
S3+25	Current auto-tuning segment	0: Preparation stage 1: start to auto tune 2 ~ 3: auto-tuning parameter collection 4: calculation of PID parameters	16-bit no sign, internal usage parameters of the system
S3+26	The auto-tuning temperature is located at the number of peaks	0: first peak 1: second peak	16-bit no sign, internal usage parameters of the system
S3+27	The lowest sampling temperature	-32767~32767	Internal usage parameters of the system
S3+28	The highest sampling temperature	-32767~32767	Internal usage parameters of the system
S3+30	sampling time of the lowest sampling temperature	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+32	sampling time of the highest sampling temperature	0~4294967296 (unit: ms)	Internal usage parameters of the system

S3+34	auto-tuning time cumulative	0~4294967296 (unit: ms)	Internal usage parameters of the system
Manual control part (read only parameters, only for monitoring)			
S3+24	current target temperature	-32767~32767	Internal usage parameters of the system
S3+25	Need to update target temperature	0: no need 1: need	16-bit no sign, internal usage parameters of the system
S3+26	Number of times to reach target temperature	0~65535	Internal usage parameters of the system
S3+27	PID upper limit of operational range	-32767~32767	Internal usage parameters of the system
S3+28	PID lower limit of operational range	-32767~32767	Internal usage parameters of the system
S3+30	High voltage time when PID uses Y to output	0~4294967296 (unit: ms)	Internal usage parameters of the system
S3+32	Sampling temperature after last filtering	The filtered temperature acquired in the last sampling time (the input filter constant in the advanced mode needs to be set first)	Floating point, internal usage parameters of the system
S3+34	Last temperature deviation		Floating point, internal usage parameters of the system
S3+36	Value of last integral term	digital value corresponding to Ui of the last sampling time	Floating point, internal usage parameters of the system
S3+38	Value of last differential term	digital value corresponding to Ud of the last sampling time	Floating point, internal usage parameters of the system
S3+40	Last PID output		Floating point, internal usage parameters of the system

Note: When the auto-tuning mode is changed to manual control, the value in the original address of S3+24~S3+40 will be overwritten by the value in manual control mode.

7-3-2. Parameters Description

Movement direction:

Positive movement: the output value MV will increase with the increasing of the measured value PV, usually used for cooling control.

Negative movement: the output value MV will decrease with the increasing of the measured value PV, usually used for heating control.

Mode setting

Common Mode:

Parameters register range: S3~S3+69, and S3~S3+7 need to be set by users;

S3+8~S3+69 are occupied by system, users can't use them.

Advanced Mode

Parameters register range: S3~S3+69, among them S3~S3+7 and S3+8~S3+11 need to be set by users; S3+16~S3+69 are occupied by system, users can't use them.


Sample time[S3]

The system samples the current values according to some certain interval and compares them with the output value. This time interval is the sample time **T**. There is no requirement for **T** during **DA** output; **T** should be larger than one PLC scan period during port output. **T** value should be chosen among 100~1000 times of PLC scan periods.

PID Operation Zone[S3+6]

PID control is entirely opened at the beginning and close to the target value with the highest speed (default value is 4095), when it entered into the PID computation range, parameters Kp, TI, TD will be effective.


See graph below:



If the target value is 100, PID operation zone is 10, and then the real PID's operation zone is from 90~110.

Death Region [S3+7]

If the measured value changed slightly for a long time, and PID control is still in working mode, then it belongs to meaningless control. Via setting the control death region, we can overcome this situation. See graph below:



Suppose: we see the death region value to be 10. Then in the above graph, the difference is only 2 comparing the current value with the last value. It will not do PID control; the difference is 13 (more than death region 10) comparing the current value with the next value, this difference value is larger than control death region value. it will do the PID control with 135.

7-4. Auto Tune Mode

If users do not know how to set the PID parameters, they can choose auto tune mode which can find the best control parameters (sampling time, proportion gain **K_p**, integral time **T_i**, differential time **T_D**) automatically.

Auto tune mode is suitable for these controlled objects: temperature, pressure; not suitable for liquid level and flow.

Auto-tuning is the process of extracting PID parameters. Sometimes auto-tuning can not find the best parameters at one time. It needs auto-tuning for many times. It is normal that there is a vibration in the process. After the optimum parameters are found at the end of auto-tuning, please switch to the manual PID mode. If the control object is unstable in the process of manual PID, it can not be controlled at a constant target value, which may be caused by the unsatisfactory adjustment of parameters. It is necessary to re-adjust the parameters of PID to achieve stable control.

For step response method: Users can set the sampling cycle to be 0 at the beginning of the auto tune process then modify the value manually in terms of practical needs after the auto tune process is completed.

For step response method: Before doing auto tune, the system should be under the non-control steady state. Take the temperature for example: the measured temperature should be the same to the environment temperature.


For critical oscillation method: user needs to set the sampling time at the beginning of the auto tune process. For slow response system, 1000ms. For fast response system, 10-100ms.

For critical oscillation method: the system can start the auto tune at any state. For object temperature, the current temperature doesn't need to be same to ambient temperature.

Two different methods and PID control diagram:


(1) Step response method

Make sure current temperature is equal to ambient temperature



(2) Critical oscillation method

The auto tune start temperature can be any value.



To enter the auto tune mode, please set bit7 of (**S3+ 2**) to be 1 and turn on PID working condition. If bit8 of (**S3+ 2**) turn to 1, it means the auto tune is successful.

PID auto tune period value [S3+12]

Set this value in S3+12 during auto tune. This value decides the auto tune performance, in a general way, set this value to be AD result corresponding to one standard tested unit. The default value is 10. The suggested setting range: full-scale AD result \times 0.3~1%. User doesn't need to change this value. However, if the system is interfered greatly by outside, this value should be increased modestly to avoid wrong judgment of positive and negative movement. If this value is too large, the PID control period (sampling time) got from the auto tune process will be too long. As the result do not set this value too large.

※1: If users have no experience, please use the default value 10, set PID sampling time (control period) to be 0ms then start the auto tune.

PID auto tune overshooting permission setting [S3+13]

If set 0, overshooting is permitted, and the system can study the optimal PID parameters all the time. But in auto tune process, detected value may be lower or higher than the target value, safety factor should be considered here.

If set 1, overshooting is not permitted. For these objectives which have strict safety demand such as pressure vessel. Set [S3+13] to be 1 to prevent from tested value over the target value seriously.

In the process, if [S3+2] bit8 changes from 0 to 1, it means the auto tune is successful and the optimal parameters are got; if [S3+2] bit8 keeps 0, when [S3+2] bit7 changes from 1 to 0, it means auto tune is finished, but the parameters are not the best and they need to be modified by hand.

Every adjustment percent of current target value in auto tune end transition stage [S3+14]

This parameter is effective only when [S3+13] is 1.


If doing PID control after auto tune, small range of overshooting may be occurred. It is better to decrease this parameter to control the overshooting. But response delay may occur if this value is too small. The defaulted value is 100% which means the parameter is not effective. The recommended range is 50~80%.

Cutline Explanation:

Current target value adjustment percent is 2/3 (**S3 + 14** = 67%), the original temperature of the system is 0 °C, target temperature is 100 °C, and the current target temperature adjustment situation is shown as below:

Next current target value = current target value + (final target value – current target value) \times 2/3;

So the changing sequence of current target is 66 °C, 88 °C, 96 °C, 98 °C, 99 °C, 100 °C.

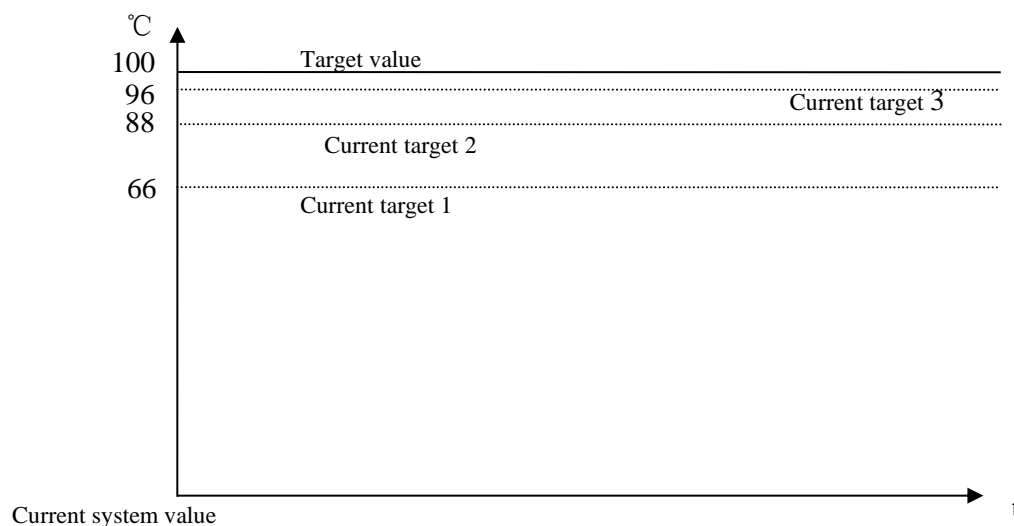

Over target value times in auto-tuning end transition stage when limiting the overshoot [S3+15]

This parameter is valid only when [S3+13] is 1;

If entering into PID control directly after auto tune, small range of overshoot may occur. It is good to prevent the overshoot if increasing this parameter properly. But it will cause response lag if this value is too large. The default value is 15 times. The recommended range is from 5 to 20.

7-5. Advanced Mode

Users can set some parameters in advanced mode in order to get better PID control effect. Enter into the advanced mode, please set **[S3+2]** bit 15 to be 1, or set it in the XDP Pro software.

Input Filter constant [S3+8]

It will smooth the sampling value. The default value is 0%, which means no filter.

Differential Gain[S3+9]

The low pass filtering process will relax the sharp change of the output value. The default value is 50%; the relaxing effect will be more obviously if increasing this value. Users do not need to change it.

Upper-limit and lower-limit value [S3+10], [S3+11]

Users can choose the analog output range via setting this value.

Default value: lower-limit output =0

Upper-limit =4095

7-6. Application outlines

Under the circumstances of continuous output, the system whose effect ability will die down with the change of the feedback value can do auto tune, such as temperature or pressure. It is not suitable for flux or liquid level.

Under the condition of overshooting permission, the system will get the optimal PID parameters from auto tuning.


Under the condition that overshoot not allowed, the PID parameters got from auto tune is up to the target value, it means that different target value will produce different PID parameters which are not the optimal parameters of the system and for reference only. If the auto tune is not available, users can set the PID parameters according to practical experience. Users need to modify the parameters when debugging. Below are some experience values of the control system for your reference:

- Temperature system: P (%) 2000 ~ 6000, I (minutes) 3 ~ 10, D (minutes) 0.5 ~ 3
- Flux system: P (%) 4000 ~ 10000, I (minutes) 0.1 ~ 1
- Pressure system: P (%) 3000 ~ 7000, I (minutes) 0.4 ~ 3
- Liquid level system: P (%) 2000 ~ 8000, I (minute) 1 ~ 5

7-7. Application

Example 1:

PID control program is shown below:

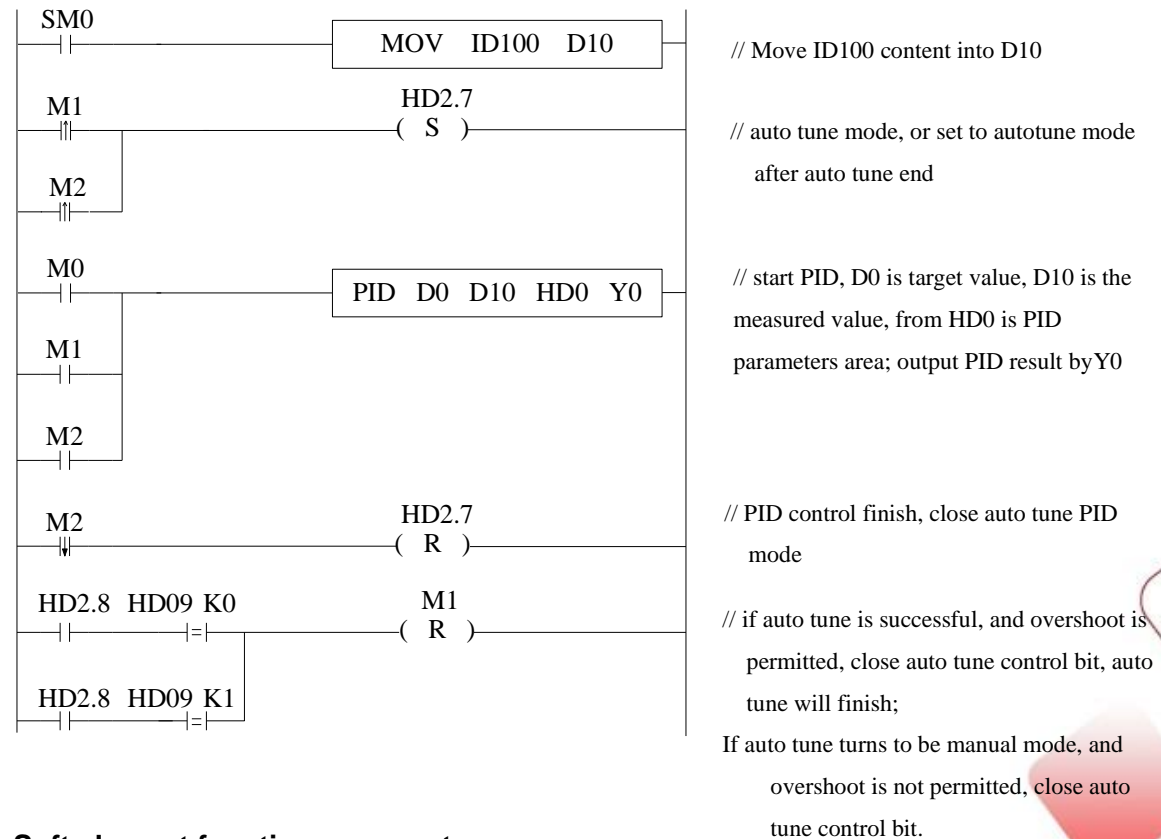

Soft element function comments:

HD2.7: Auto tune bit

HD2.8: Successful flag of auto tune

M0: Normal PID control

M1: Auto tune control

M2: Enter PID control after auto tune

Operation steps:

1. Send the actual temperature to PID collection register
2. Set probably value for P, I, D, sampling period
3. Set ON auto tune control bit M1 to startup PID auto tune
4. M1 will be reset after the auto tune is finished
5. Set ON M0, use the PID parameters getting from auto tune
6. If the PID effect is not good by using the auto tune PID parameters, user can adjust the PID parameters to get good effect.

Note: This PLC temperature PID control program is applicable to almost all temperature control projects.

Example 2:

To control the target temperature 60°C in step response mode.

Overshoot is permitted:

1. The target temperature 60°C (600)
2. Parameters setting

PID Instruction Parameter Config

Target Value (SV): D4500 Measure Value(PV): D2 Parameter: D4000 Output: Y0

Parameter Config

☐ Manual ☒ Auto

Sampling Time: 100 ms

Proportion Gain (KP): 0 %

Integration Time(TI): 0 *100ms

Differential Time(TD): 0 *10ms

PID Computation Scope: 1000

PID Control Death Band: 20

Self Study Periodic Value: 1p

Self Study Method: Step Response

Self Study PID Control Mode: PID Control

Mode Config

☒ Common Mode ☐ Advanced Mode

Input Filter Constant (a): 0 %

Differential Increase (KD): 50 %

Output Upper Limit Value: 4095

Output Lower Limit Value: 0

Direction Config

☒ Negative Movement ☐ Positive Movement

Negative Movement: Along with the increase of the measures definite value PV, outputvalue MV will also reduce.
It's usually used in heat up control.

Positive Movement: Along with the increase of the measures definite value PV, outputvalue MV will also increase.
It's usually used in cool control.

Parameter Range: D4000 - D4069

Overshoot Config

☒ Enable Overshoot ☐ Disable Overshoot


Each time adjust the increase: 100 %

Current target value resident Count: 15

Suggestion value

Read From PLC Write To PLC OK Cancel

3. The result curve



Explanation:

The target temperature is 60 degree, PID calculation range is 10 degree, PID control dead area is 0.2 degree, auto tune period changing value is 10. When the PID control works in normal atmospheric temperature, the PID output terminal will heat the temperature from 28 to 100 degree, then the output stops, the temperature keeps increasing to 110 degree (max temperature) as the remaining warmth. Then the temperature keeps decreasing to 60 degree, the output starts to heat again to 70 degree and stops. The temperature increases a little then decreases again. This process will repeat. Finally, the temperature will fluctuate close the target temperature.

Note:

1. When the temperature reaches 100 degree and stops heating, the PID start bit D4002.7 will not reset at once, it has delay before reset.
2. When the temperature reaches 100 degree and stops heating, the PID auto tune success bit D4002.8 will be ON at once.
3. When it starts PID calculation, the PLC will auto set a sampling time (about 2500). This parameter will be replaced by the PID best sampling time after stoping heating at 100 degree.
4. When it starts PID calculation, the PLC will auto set the PID parameters (P=4454, I=926, D=2317). These parameters will be replaced by the best PID value after stoping heating at 100 degree.
5. When the temperature reaches 100 degree and stops heating, the PID start bit D4002.7 will not reset at once, it has delay before reset. At this time, the sampling temperature is higher than target temperature. If user sets ON the PID auto tune again, PLC will get all the PID parameters as 0. Please set ON the PID after the temperature decreases under the normal atmospheric temperature.
6. If PID auto tune start bit and auto tune success bit are power-off retentive, please set or reset them propably to avoid calculation error when starting the PLC next time.

7. The final heating temperature will up to 110 degree when the overshoot is permitted. It is over the target temperature by 50 degree, the overshoot amount is too large.
8. When the PID starts to work, the output will heat the object from 28 degree to 60 degree, then the output is forced to stop heating to avoid overshoot, but this will interrupt the PID auto tune process.
9. To enlarge the PID calculation range can suppress the heating overshoot.

Overshoot is not permitted:

1. The target temperature is 60 degree (600)
2. The related parameter settings:

PID Instruction Parameter Config

Target Value (SV): D4500 Measure Value (PV): D0 Parameter: D4000 Output: Y0

Parameter Config

☐ Manual ☒ Auto

Sampling Time: 100 ms

Proportion Gain (KP): 0 %

Integration Time (TI): 0 *100ms

Differential Time (TD): 0 *10ms

PID Computation Scope: 1000

PID Control Death Band: 20

Self Study Periodic Value: 10

Self Study Method: Step Response

Self Study PID Control Mode: PID Control

Mode Config

☒ Common Mode ☐ Advanced Mode

Input Filter Constant (a): 0 %

Differential Increase (KD): 50 %

Output Upper Limit Value: 4095

Output Lower Limit Value: 0

Direction Config

☒ Negative Movement ☐ Positive Movement

Negative Movement: Along with the increase of the measures definite value PV, outputvalue MV will also reduce. It's usually used in heat up control.

Positive Movement: Along with the increase of the measures definite value PV, outputvalue MV will also increase. It's usually used in cool control.

Overshoot Config

☐ Enable Overshoot ☒ Disable Overshoot

Each time adjust the increase: 100 %


Current target value resident Count: 15

Suggestion value

Parameter Range: D4000 - D4069

Read From PLC Write To PLC OK Cancel

3. The result curve



Explanation:

The target temperature is 60 degree, PID calculation range is 10 degree, PID control dead area is 0.2 degree, auto tune period changing value is 10. When the PID control works in normal atmospheric temperature, the PID output terminal will heat the temperature from 28 to 48 degree, then the output stops, the temperature keeps increasing to 70 degree (max temperature) as the remaining warmth. Then the temperature keeps decreasing to 60 degree, the output starts to heat again to 62 degree and stops. The temperature increases a little (about 64 degree) then decreases again. This process will repeat. Finally, the temperature will fluctuate close the target temperature. The precision is ± 0.25 degree.

Note:

1. When the temperature reaches 48 degree and stops heating, the PID start bit D4002.7 will not reset at once, it has delay before reset.
2. When the temperature reaches 48 degree and stops heating, the PID auto tune success bit D4002.8 will not be ON at once. It hasn't set ON even when the auto tune succeeded.
3. When it starts PID calculation, the PLC will auto set a sampling time (about 2500). This parameter will be replaced by the PID best sampling time after stopping heating at 48 degree.
4. When it starts PID calculation, the PLC will auto set the PID parameters (P=4454, I=926, D=2317). These parameters will be replaced by the best PID value after stopping heating at 48 degree.
5. When the temperature reaches 48 degree and stops heating, the PID start bit D4002.7 will not reset at once, it has delay before reset. At this time, the sampling temperature is higher than target temperature. If user sets ON the PID auto tune again,

PLC will get all the PID parameters as 0. Please set ON the PID after the temperature decreases under the normal atmospheric temperature.

6. If PID auto tune start bit and auto tune success bit are power-off retentive, please set or reset them properly to avoid calculation error when starting the PLC next time.

7. The final heating temperature will up to 70 degree when the overshoot is permitted. It is over the target temperature by 10 degree, the overshoot amount is small.

8. To enlarge the PID calculation range can suppress the heating overshoot.

8 C Language Function Block

In this chapter, we focus on C language function block's specifications, edition, instruction calling, application points etc. We also attach the common function list.

8-1. Summary

XD, XL supports almost all C language function in XDPro software (also supports global variable). Users can call the function at many places and call different functions, which greatly increase program security and programmer's efficiency.

8-2. Instruction Format

1. Instruction Summary

Call the C language Function Block at the specified place.

Call the C language function block [NAME_C]			
16 bits instruction	NAME_C	32 bits Instruction	-
Execution condition	Normally ON/OFF, Rising/Falling Edge activation	Suitable Models	XD, XL
Hardware		Software	

2. Operands


Operands	Function	Type
S1	Name of C Function Block, defined by the user	String
S2	Corresponding start ID of word W in C language function	16 bits, BIN
S3	Corresponding start ID of word B in C language function	bit, BIN

3. Suitable Soft Components

Word	Operands	System								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S2	●										
Bit	Operands	System										
		X	Y	M	S*	T*	C*	Dnm				
	S3			●								

*Note: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS. M includes M, HM, SM; S includes S and HS; T includes T and HT; C includes C and HC.

Function and Action




S1 is the function name. It consists of numbers, letters and underlines. The first character can't be number, and the name length should be ≤ 9 ASC.

The name can be the same with PLC's self instructions like LD, ADD, SUB, PLSR etc.


The name can't be the same with the function blocks existing in current PLC;

8-3. Operation Steps

1. Open PLC edit tool, in the left "Project" toolbar, choose "Func Block", right click it and choose "Add New Func Block".



2. See graph below, fill in the information of your function;

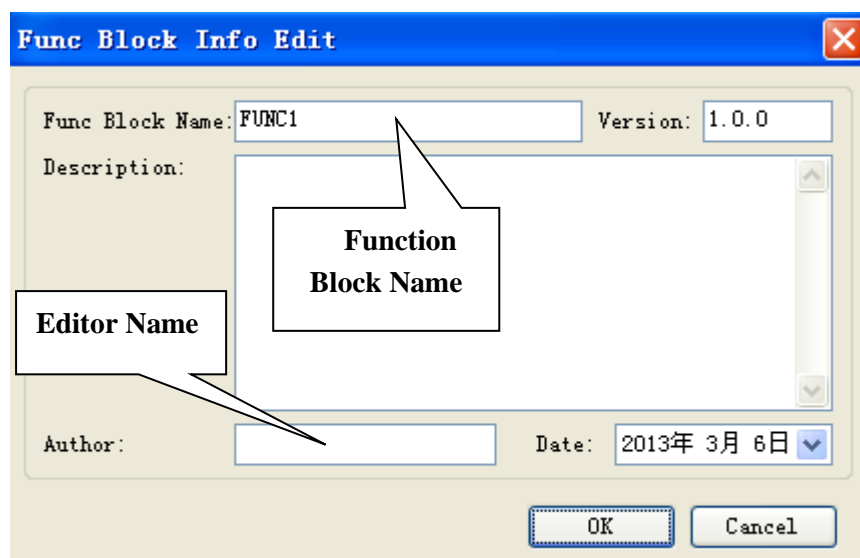

Function Block name is the name we use to call the BLOCK. For example: the diagram of FUNC1 should be written as below:



3. After creating the new Function Block, you can see the edit interface as shown below:

Main function's name (it's function block's name, this name can't be changed freely, and users should modify in the edit window.)


```

PLC1 - Ladder FuncBlock-FUNC1
Information Export Compile
1 /*****
2     FunctionBlockName:  FUNC1
3     Version:           1.0.0
4     Author:
5     UpdateTime:       2013-3-6 10:49:07
6     Comment:
7
8     ****
9 void FUNC1( WORD W , BIT B )
10 {
11
12 }
13

```

Edit your C language program between ‘{ }’

WORD W: correspond to soft component D
BIT B: correspond to soft component M

- Parameters' transfer way: if call the **Function Block** in ladder, the transferred D and M is the start ID of W and B. Take the above graph as the example, start with D0 and M0, then W[0] is D0, W[10] is D10, B [0] is M0, B [10] is M10; if the used parameters in the ladder are D100, M100, then W[0] is D100, B [0] is M100; if the parameters in the ladder are HD0, HM0, then W[0]=HD0,B[0]=HM0; if the parameters in the ladder are D100, HM100, then W[0]=D100, B[0]=HM100. So, word and bit components start address are defined in PLC program by the user.

Note: The coil and data type in one C language should be the same. All the coils in C language are power loss retentive, or not power loss retentive; so is the same with data register.

- Parameter **W**: represent **Word** soft component, use it in the form of data group. E.g W[0]=1; W[1]=W[2]+W[3]; in the program, use soft components according to standard C language rules.
- Parameter **B**: represent **Bit** soft component, use it in the form of data group. Support **SET** and **RESET**. E.g: B[0]=1; B[1]=0; And assignment, for example, B[0]=B[1].
- Double word operation: add **D** in front of **W**. E.g. DW[10]=100000, it means assignment to double-word W[10]W[11]. Double-word operation: Support the definition of floating variable in the function, and execute floating operation; (E.g: float register D0(double word) means FW[0], FW[0]=123.456)
- Other soft elements definition in C language:

In C language of PLC, if you want to use input(X) and output(Y), then macro definition '#define SysReg Addr_X_Y' is needed; E.g: send the state of input X0 to given coil M0, then B[0]=X[0]; send the state of Y0 to given coil M10, then: B[10]=Y[0]; (Note: corresponding X Y in C language is decimal, not Octonary number) .

Note: Marco definition #define SysRegAddr_X_Y should be behind the variable definition, otherwise, it will be error.

Eg. int a,b,c;
#define SysRegAddr_Y
b=3000;
c=W[1030];
a=b+c;
if(B[a]==1)
Y[3]=0;

In a similar way, if the not-power-loss-retentive flow S, Counter C, timer T, counter register TD is in the C language, macro definition '#define SysRegAddr_S_C_T_CD_TD' is also needed; if the power-loss-retentive flow HS, counter HC, timer HT, counter register HCD, timing register HTD etc, macro definition '#define SysRegAddr_HS_HC_HT_HCD-HTD' is needed.

E.g: W[0]=CD[0];W[1]=TD[0];B[1]=C[0];B[2]=T[0];


- Function Library: In **Function Block**, users can use the Functions and Constants in function library directly. For the Functions and Constants in function library, see 9-8.
- The other data type supported:

```
BOOL;          //BOOL Quantity
INT8U;          //8 bits unsigned integer
INT8S;          //8 bits signed integer
INT16U          //16 bits unsigned integer
INT16S          //16 bits signed integer
INT32U          //32 bits unsigned integer
INT32S          //32 bits signed integer
FP32;          // single precision floating
FP64;          //double precision floating
Predefined Marco:  #define      true      1
                   #define      false     0
                   #define      TRUE      1
                   #define      FALSE    0
```

8-4. Import and Export the Functions

1. Export

(1) Function: Export the function as the file, then other PLC program can import to use;




(2) Export Format

- a) Editable: Export the source codes out and save as a file. If import again, the file is editable;
- b) Not editable: Don't export the source code, if import the file, it's not editable;

2. Import

Function: Import the existing **Func Block** file, to use in the PLC program.



Choose the **Func Block**, right click 'Import Func Block from Disk', choose the correct file, and then click OK.

8-5. Edit the Func Blocks

Example: Add D0 and D1 in PLC's registers, and then assign the value to D2;
(1) In 'Project' toolbar, new create a **Func Block**, here we name the **Func Block** as **ADD_2**, then edit C language program;
(2) Click 'compile' after edition.

```
PLC1 - Ladder FuncBlock-ADD_2
Information Export Compile
7      W [2] =W [0] +W [1]
8      *****
9  void ADD_2( WORD W , BIT B )
10 { W [2] =W [0] +W [1];
11
12 }
13
```

Information(1)
Error List Output
1. ...\\tmp\\PrjFuncB\\ADD_2.c: In function 'ADD_2':
..\\tmp\\PrjFuncB\\ADD_2.c:6:1: error: expected ';' before 'asm'

The information list


According to the information shown in the output blank, we can search and modify the grammar error in C language program. Here we can see that in the program there is no ';' sign behind W [2] =W [0] + W [1].

Compile the program again after modifying the program. In the information list, we can confirm that there is no grammar error in the program.


```
Information Export Compile
6      Comment:
7      W [2] =W [0] +W [1]
8      *****
9  void ADD_1( WORD W , BIT B )
10 { W [2] =W [0] +W [1];
11
12 }
```

Information
Error List Output


(3) Write PLC program, assign value 10 and 20 into registers D0, D1 separately, then call Func Block ADD_2, see graph below:



(4) Download program into PLC, run PLC and set M0.

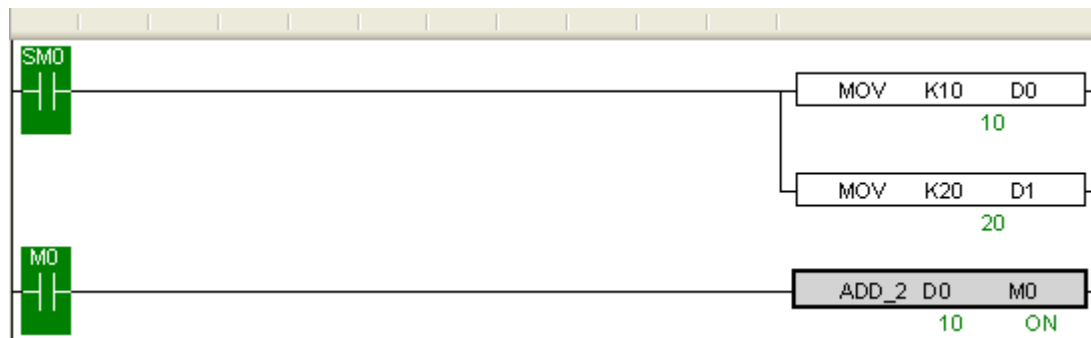

(5) From Free Monitor in the toolbar, we can see that D2 changes to be 30, it means assignment is successful;



8-6. Program Example

If PLC needs to do complicated calculation (including plus and minus calculation), the calculation will be used for many times, C language function is easy to use.

Example 1:

Calculation $a = b/c + b*c + (c-3)*d$


Method 1: use ladder chart:

Get the result of $c-3$

Get the result of three multiplication equations

Get the sum


Ladder chart only support two original operands, it needs many steps to get the result.



Note:

1. The result of MUL is Dword, the result is stored in D14~D15.
2. The result of DIV has quotient D16 and remainder D17. If D17 has value, the calculation precision will decrease. Please use float format to ensure the precision.
3. D16 quotient is word value, in plus calculation all the data should be changed to Dword. The final result is stored in D22~D23.

Method 2: use C language:



RESULT	Function name
D0	In the function, W [0] =D0, W [1] =D1... If D0=D32, then W [0] =D32, W [1] =D33... If S2=HD32, then W [0] =HD32, W [1] =HD33...
M0	In the function, B [0] = M0, B [1] =M1... If S2=M32, then B [0] = M32, B [1] =M33... If S2=HM32, then B [0] = HM32, B [1] =HM33...

C program

```

9 void RESULT( WORD W , BIT B )
10 {
11 long int a,b,c,d;;
12 b=W[1];
13 c=W[2];
14 d=W[3];
15 a=b/c+b*c+(c-3)*d;
16 DW[4]=a;
17 }

```

Method 2 can simplify the program.

The above C language function is similar to ladder chart of method 1, whose precision is not high. If it needs to get the high precision, please use float calculation.

Example 2: Calculate CRC parity value via Func Block

CRC calculation rules:

- (1) Set 16-bit register (CRC register) = FFFF H
 - (2) XOR (Exclusive OR) the first 8-bit byte message and the low 16-bit CRC register.
 - (3) Right shift 1 bit of CRC register, fill 0 into the highest bit.
 - (4) Check the right shifted value, if it is 0, save the new value from step3 into CRC register; if it is not 0, XOR the CRC register value with A001 H and then save the result into the CRC register.
 - (5) Repeat step3&4 until all the 8-bit have been calculated.
 - (6) Repeat step (2) ~ (5) , then calculate the next 8-bit message. Until all the messages have been calculated, the result will be the CRC parity code in CRC register.
- Edit C language Function Block program, see graph below:


```

9 void CRC_CHECK( WORD W , BIT B )
10 {
11 int i,j,m,n;
12 unsigned int reg_crc=0xffff,k;
13
14 for( i = 0 ; i < W[0] ; i++ )
15 {
16 reg_crc^=W[i+1];
17 for(j=0;j<8;j++)
18 {
19 if(reg_crc&0x01)
20 reg_crc=(reg_crc>>1)^0xa001;
21 else
22 reg_crc=reg_crc>>1;
23 }
24 }
25
26 m=W[0]+1;
27 n=W[0]+2;
28 k=reg_crc&0xff00;
29 W[n] = k>>8;
30 W[m]=reg_crc&0xff;
31 }

```

Edit PLC ladder program,

D0: Check byte number of data,
D1~D5: Check data content. See graph below:

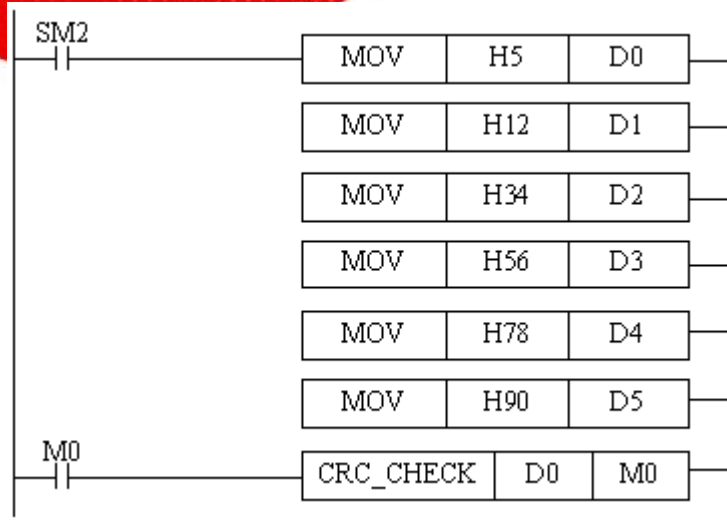

Download to PLC, then RUN PLC, set M0, via Free Monitor, we can find that values in D6 and D7 are the highest and lowest bit of CRC parity value;

8-7. Application notes


In one Func Block file, you can write many functions, and they can be called by each other.

Each Func Block file is independent, they can't call block in each other;


Func Block files can call C language library function in form of floating, arithmetic like sin, cos, tan.

XC series PLC only support local variable, while XD/XL series PLC support both local and global variable. This makes C language Block more flexible and convenient.


XDPPro software v3.3 and later version keep C function library:



In this function block, user can call the C function directly:



For example: click TEL10, the function name will show on the project bar:

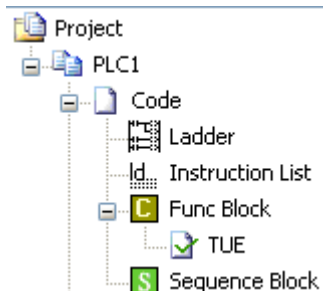

User can call it in the ladder chart editing window at any time.

8-8. Function Table

The default function library

Constant	Data	Description
_LOG2	(double)0.693147180559945309417232121458	Logarithm of 2
_LOG10	(double)2.3025850929940459010936137929093	Logarithm of 10
_SQRT2	(double)1.41421356237309504880168872421	Radical of 2

_PI	(double)3.1415926535897932384626433832795	PI
_PIP2	(double)1.57079632679489661923132169163975	PI/2
_PIP2x3	(double)4.71238898038468985769396507491925	PI*3/2

String Function	Description
void * memchr(const void *s, int c, size_t n);	Return the first c position among n words before s position
int memcmp(const void *s1, const void *s2, size_t n);	Compare the first n words of position s1 and s2
void * memcpy(void *s1, const void *s2, size_t n);	Copy n words from position s2 to s1 and return s1
void * memset(void *s, int c, size_t n);	Replace the n words start from s position with word c , and return to position s
char * strcat(char *s1, const char *s2);	Connect string ct behind string s
char * strchr(const char *s, int c);	Return the first word c position in string s
int strcmp(const char *s1, const char *s2);	Compare string s1 and s2
char * strcpy(char *s1, const char *s2);	Copy string s1 to string s2

Double-precision math function	Single-precision math function	Description
double acos(double x);	float acosf(float x);	Inverse cosine function
double asin(double x);	float asinf(float x);	Inverse sine function
double atan(double x);	float atanf(float x);	Inverse tangent function
double atan2(double y, double x);	float atan2f(float y, float x);	Inverse tangent value of parameter (y/x)
double ceil(double x);	float ceilf(float x);	Return the smallest double integer which is greater or equal with parameter x
double cos(double x);	float cosf(float x);	Cosine function
double cosh(double x);	float coshf(float x);	Hyperbolic cosine function, $\cosh(x)=(e^x+e^{-x})/2$
double exp(double x);	float expf(float x);	Exponent (e^x) of a nature data
double fabs(double x);	float fabsf(float x);	Absolute value of parameter x
double floor(double x);	float floorf(float x);	Return the largest double integer which is smaller or equals with x
double fmod(double x, double y);	float fmodf(float x, float y);	If y is not zero, return the remainder of floating x/y
double frexp(double val, int _far *exp);	float frexpf(float val, int _far *exp);	Break floating data x to be mantissa and exponent x = m*2^exp , return the mantissa of m, save the logarithm into exp .

double ldexp(double x, int exp);	float ldexpf(float x, int exp);	X multiply the (two to the power of n) is $x \cdot 2^n$.
double log(double x);	float logf(float x);	Nature logarithm logic
double log10(double x);	float log10f(float x);	logarithm (log10x)
double modf(double val, double *pd);	float modff(float val, float *pd);	Break floating data X to be integral part and decimal part, return the decimal part, save the integral part into parameter ip.
double pow(double x, double y);	float powf(float x, float y);	Power value of parameter y (x^y)
double sin(double x);	float sinf(float x);	sine function
double sinh(double x);	float sinhf(float x);	Hyperbolic sine function, $\sinh(x) = (e^x - e^{-x})/2$
double sqrt(double x);	float sqrtf(float x);	Square root of parameter X
double tan(double x);	float tanf(float x);	Tangent function.
double tanh(double x);	float tanhf(float x);	hyperbolic tangent function $\tanh(x) = (e^x - e^{-x}) / (e^x + e^{-x})$

The using method of the functions in the table:

float asinf (float x) ;

float asinf: float means the return value is float format;

float x: float means the function formal parameter is float format. In actual using, it do not need to write the float. See line 14 in the following example:

```

9 void ZHENGXIAN( WORD W , BIT B )
10 {
11 int a;
12 float x,y,z;
13 x=FW[0];
14 y=asinf(x);
15 z=180*y/3.14159;
16 a=(int)z;
17 W[2]=a;
18 }

```

9 Sequence BLOCK

This chapter mainly introduces sequence block instruction and the application.

Sequence Block instruction:

Mnemonic	Function	Ladder chart	Chapter
Sequence Block			

SBSTOP	Pause BLOCK		SBSTOP	S1	S2	9-6-1
SBGOON	Go to execute BLOCK		SBGOON	S1	S2	9-6-1


9-1. Concept of the BLOCK

Sequence block whose brief name is BLOCK is a program block to realize some functions. As a special flow, all instructions in the block are executed in order, which is the biggest difference with general processes.

BLOCK starts from SBLOCK and ends with SBLOCKE, and programmers can write instructions in the BLOCK. If one BLOCK contains multiple pulse output instructions (or other instructions), then pulse output instructions will execute in accordance with conditions meet order; And meanwhile the next pulse output instruction will not execute until the current instruction is over.

The XD3, XDM series PLC supports multiple BLOCKs^{※1}.

A complete BLOCK structure is shown as below:

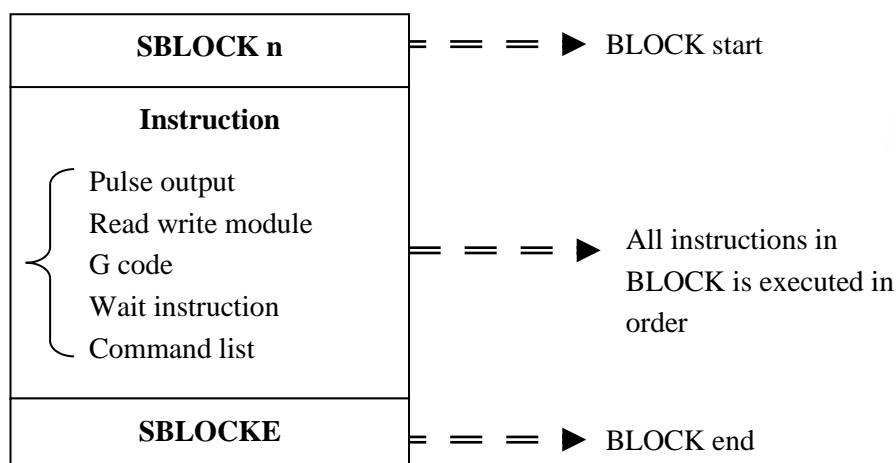

※1: Firmware version below V3.4.5: the XD series PLC allows up to eight BLOCKs. Firmware version V3.4.5 and above: XD/XL series PLC can write up to 100 BLOCKs, but at the same time can only run 8.

※2: When the trigger condition of the BLOCK is triggered by the closure of the normally open coil, it will be executed from the top of the BLOCK to the bottom in turn. When the last instruction is executed, the execution of the BLOCK will be restarted immediately from the top to the bottom. When the trigger condition is disconnected, the BLOCK will not stop immediately, but will complete the last scan and stop after the execution of the unexecuted program.


※3: When the triggering condition of BLOCK is triggered by the rising edge of the coil, the sequential function BLOCK will be executed one time from top to bottom and will not be executed circularly.

9-2. Call the BLOCK


In one program file, it can call many BLOCK; the following is the method to add BLOCK in the program.

9-2-1. Add the BLOCK

Open XDPPro software, right click the sequence block in the project bar:

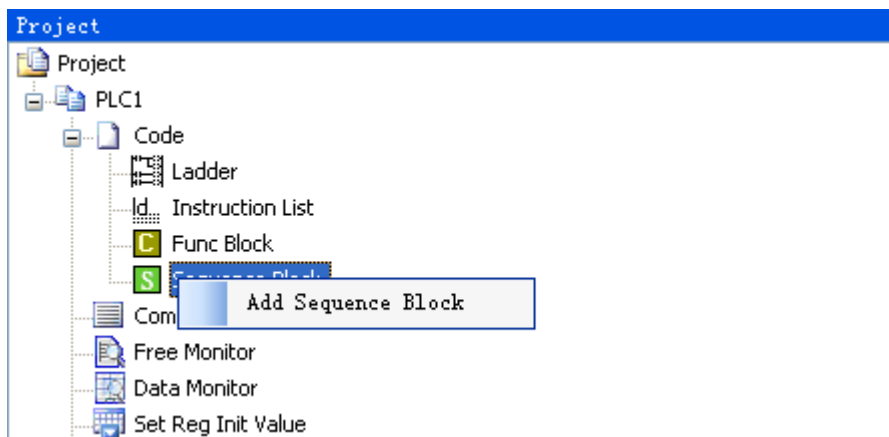


Click the command 'add sequence block', the following window will jump out:




You can edit the BLOCK in the window, Upwards/Downwards are used to change the position of instructions in the block.


Click 'insert' button, some instructions list under the menu:




Take 'Pulse Item' for example:




After click 'OK', you will find information in the configuration:



Click 'OK', the following instructions are added in the ladder:




Meantime, a new sequence block is added in the right of the project bar:




9-2-2. Move the BLOCK


If you want to move the BLOCK to other place, you have to select the original BLOCK and delete it (select all, then delete):



Move the cursor to the new place, and then right click the BLOCK and select 'add to lad':

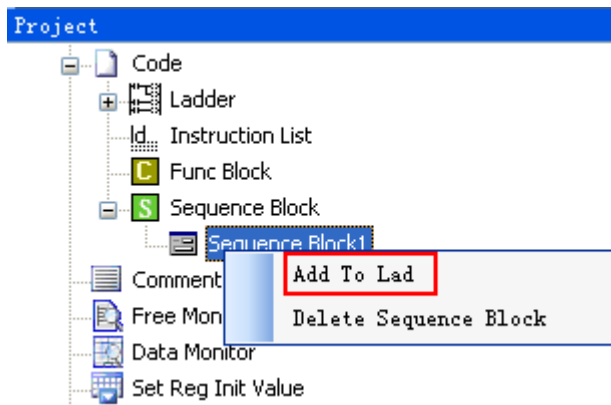


Now the BLOCK is moved to the new place:



9-2-3. Delete the BLOCK



You can select the called BLOCK and delete it. If you want to completely delete the BLOCK, right click the function block and select 'delete sequence block'. After this operation, you can't call this BLOCK any more:

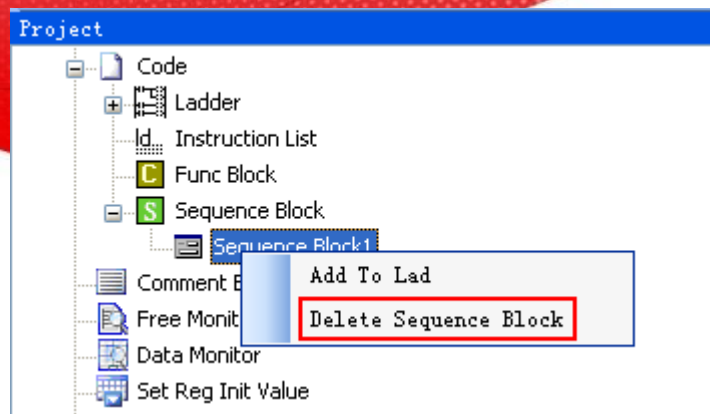


9-2-4. Modify the BLOCK

There are two methods to modify the BLOCK.

(A) Double click the start/end segment to modify the BLOCK in general:




(B) Double click the middle part to modify :




Users can add instructions in the frame.

Skip: to control the stop and run of the instructions. If you select skip and input control coil in the frame, then when the control coil is ON, the command will not be executed. If not select, the default action is execution.

Comment: to modify the note for the instruction.

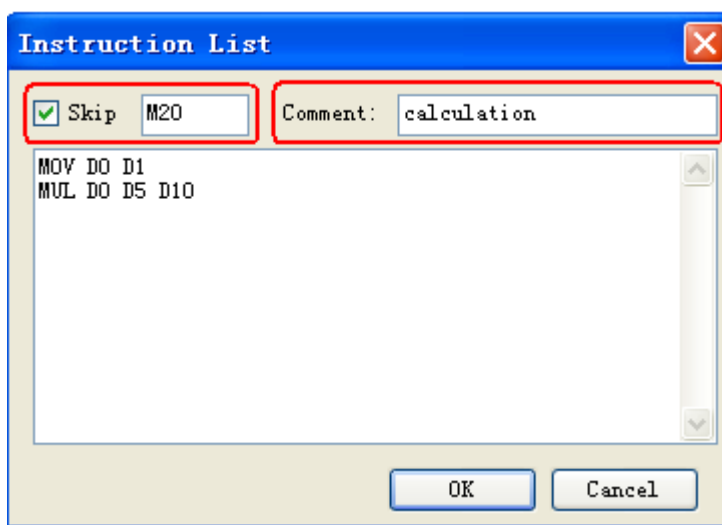


Click 'OK', the ladder program will change as the following:

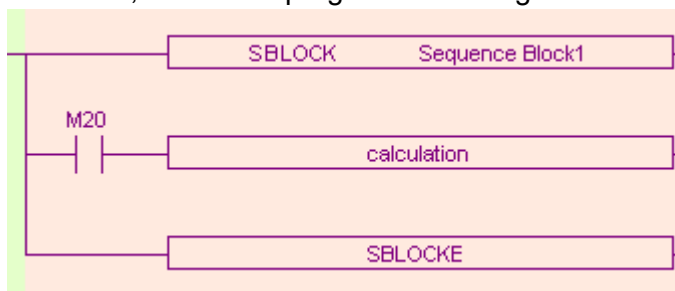

Note: We can add multiply instructions in one BLOCK and use 'Skip' as every instruction's execution condition.


9-3-2. Pulse Item

Open the 'pulse item' in the same way:

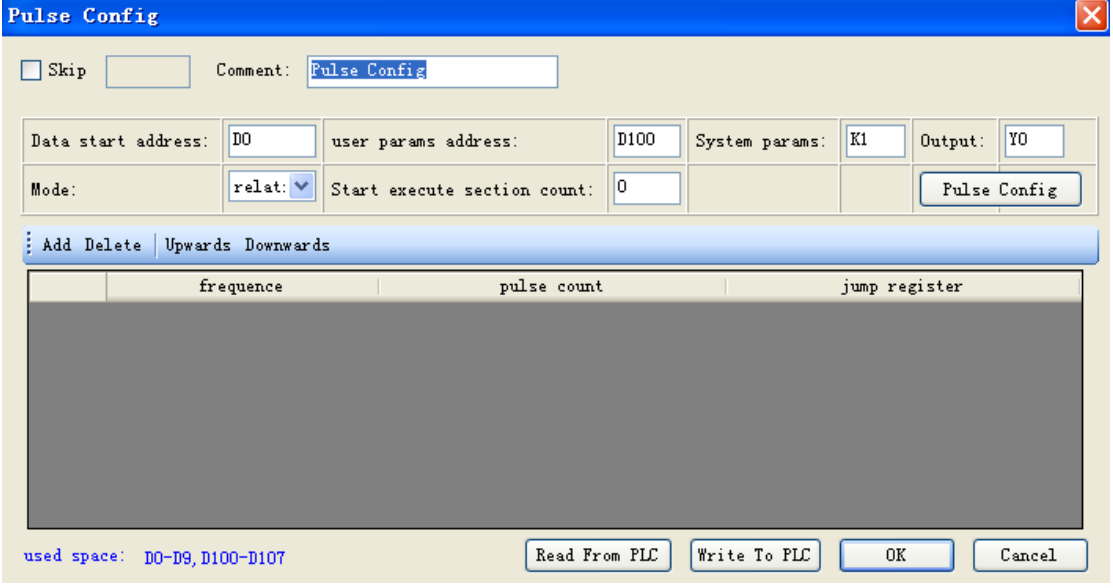

The 'Pulse Config' dialog box is shown. It has a blue title bar with the text 'Pulse Config' and a close button. Below the title bar, there is a 'Skip' checkbox and a 'Comment' field containing 'Pulse Config'. The main area contains several input fields: 'Data start address' (D0), 'user params address' (D100), 'System params' (K1), and 'Output' (Y0). There is also a 'Mode' dropdown set to 'relat:' and a 'Start execute section count' field set to 0. A 'Pulse Config' button is located to the right of these fields. Below these fields is a table with three columns: 'frequence', 'pulse count', and 'jump register'. The table is currently empty. At the bottom of the dialog, there is a 'used space' label showing 'D0-D9, D100-D107' and four buttons: 'Read From PLC', 'Write To PLC', 'OK', and 'Cancel'.

In the following BLOCK, we add two impulse instructions:




9-3-3. Wait Item

'Wait Item': to wait coil flag or timer bit.

Open 'Wait Item' in the same way. There are two waiting modes: flag bit and timer wait.

(A) Flag bit

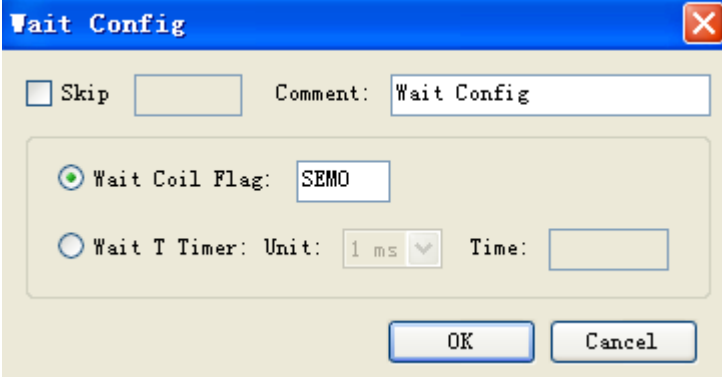


The 'Wait Config' dialog box is shown. It has a blue title bar with the text 'Wait Config' and a close button. Below the title bar, there is a 'Skip' checkbox and a 'Comment' field containing 'Wait Config'. The main area contains two radio buttons: 'Wait Coil Flag' (selected) and 'Wait T Timer'. The 'Wait Coil Flag' option has a text field containing 'SEMO'. The 'Wait T Timer' option has a 'Unit' dropdown set to '1 ms' and a 'Time' field. At the bottom of the dialog, there are two buttons: 'OK' and 'Cancel'.


SEM corresponding ladder diagram is as below:



(B) Timer wait

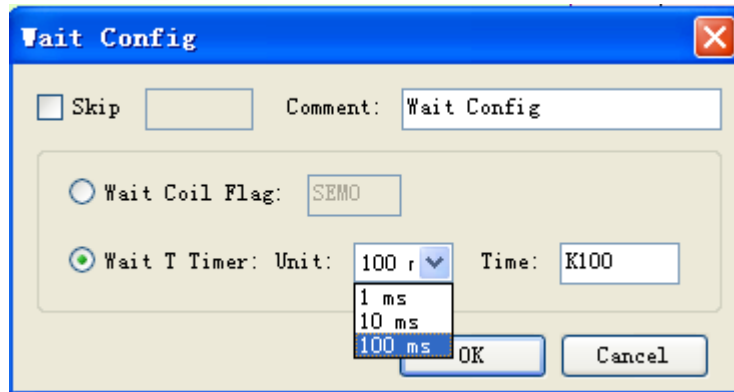

(C) Corresponding ladder diagram:



Note: Do not add normal coil after WAIT instruction in XD/XL series PLC sequence BLOCK, and add XD, XL series PLC special signal SEM bit(SEM0~SEM31); SEM cannot be controlled by set or reset. It can only be set by POST instruction and reset by WAIT SEM instruction. Or output via OUT instruction. The difference between them is that the POST command needs to be triggered by the pulse edge to keep the state of SEM; the OUT command needs to be triggered by the normally open coil, and the SEM is reset when the triggering condition is disconnected.

9-3-4. Module Read and Write (FROM/TO) instruction

This item is used to read and write data between PLC and modules, and the operate panel is as below:

1#read

Read/Write Module

☐ Skip Comment: Read/Write Module


☐ Read module ☒ Write module

Module no: K0 Module address: K0

Count: K6 PLC address: M10

OK Cancel

FROM/TO instruction can be selected from pull-down list:

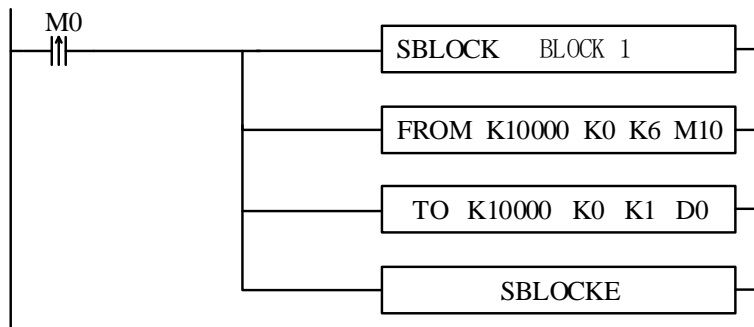



Note: As shown in the figure above, in V3.4 and above version software, when the module number is set to K0~K15, the corresponding ladder diagram will be displayed as K10000~K10015.

9-4. Running form of the BLOCK

1. If there are many blocks, they run as the normal program. The block is running when the condition is ON.


(A) The condition is normal ON, normal OFF coil





Note: When the program in the BLOCK is not executed and the triggering condition M is disconnected, the BLOCK will not stop immediately, but will complete the last scan, and will stop after the rest of the program has been executed.


(B) The condition is rising or falling edge of pulse

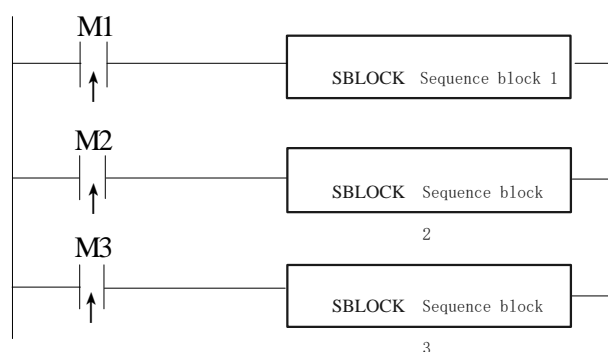


When M1, M2, M3 is from OFF to ON, all these blocks will run once.

2. The instructions in the block run in sequence according to the scanning time. They run one after another when the condition is ON.


(A) Without SKIP condition

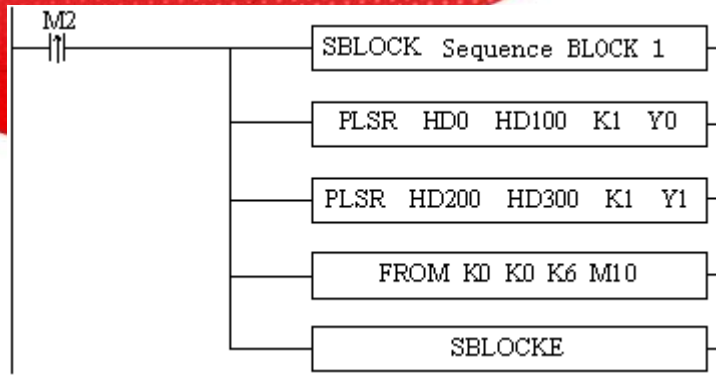

The instructions running sequence in block 1 is shown as below:



(B) With SKIP condition




Explanation:

- A) When M2 is ON, block 1 is running.
- B) All the instructions run in sequence in the block.
- C) M3, M4, M5 are the sign of SKIP, when they are ON, this instruction will not run.
- D) When M3 is OFF, if no other instructions use this Y0 pulse, PLSR HD0 HD100 K1 Y0 will run; if not, the PLSR HD0 HD100 K1 Y0 will run after it is released by other instructions.
- E) After Y0 pulse sending completed, check M4. If M4 is OFF, check Y1 block, if M4 is ON, check M5. If M5 is OFF, module communication will run.


9-5. BLOCK instruction editing rules

In the BLOCK, the instruction editing should accord with some standards.


Do not use the same pulse output terminal in different BLOCK.




Do not use the same pulse output terminal in BLOCK and main program.

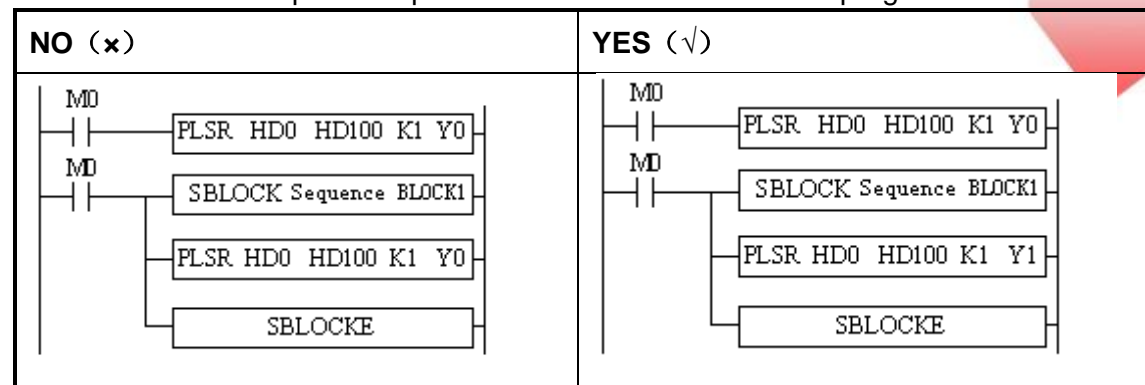


There only can be one SKIP condition for one BLOCK instruction.

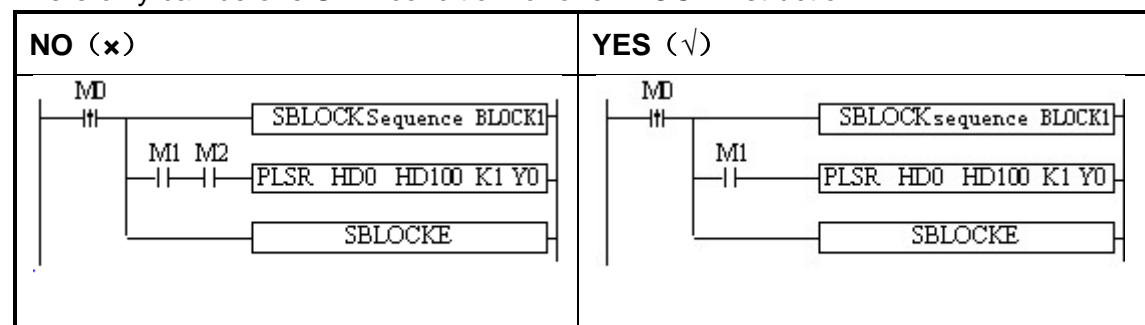


The SKIP condition only can use M, X, can not use other coil or register.

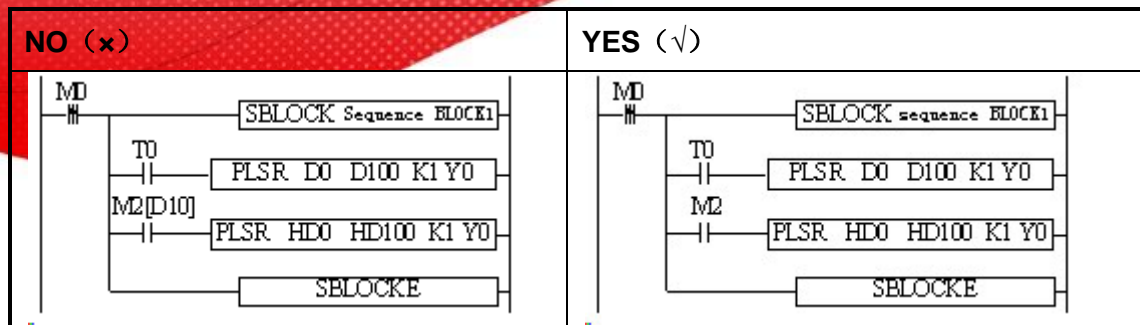

The output instructions cannot be CNT_AB(CNT), PWM.

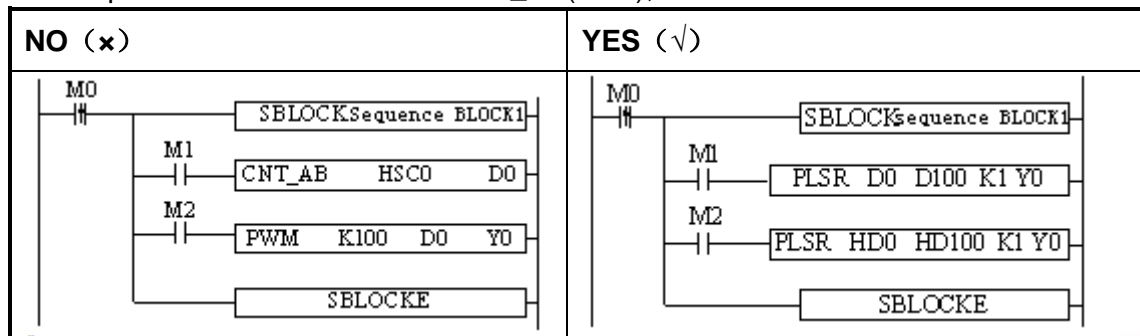

BLOCK is not recommended to put in the STL, because if one STL ends, while the BLOCK doesn't end, then big problem will happen.

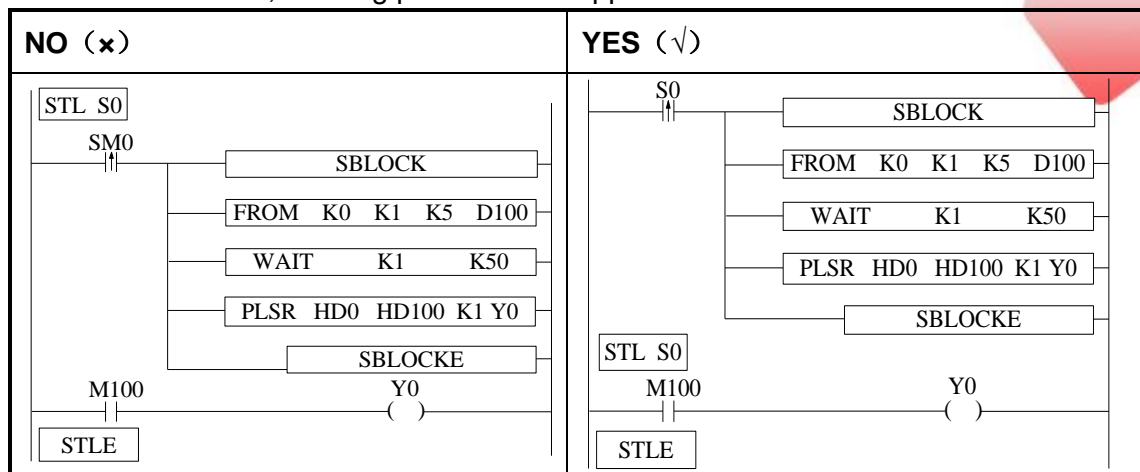

Label Kind type cannot be used in the block

Sign P, I cannot be used in block. Even they can be added in block, but they do not work in fact.

9-6. BLOCK related instructions

9-6-1. Instruction explanation

stop running the BLOCK [SBSTOP]

Summarization

Stop the instructions running in the block

[SBSTOP]			
16 bits	SBSTOP	32 bits	-
Condition	NO,NC coil and pulse edge	Suitable types	XD, XL
Hardware		Software	V3.2


Operand

Operand	Function	Type
S1	The number of the BLOCK	16bits, BIN
S2	The mode to stop the BLOCK	16bits, BIN

Suitable component

Word	Operand	Register								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	S1	•								•		
	S2									•		


***Note:** D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HSCD, HSD; DM includes DM, DHM; DS includes DS, DHS.



S2 is the mode for BLOCK stop, operand: K0, K1, K2

K0: stop the BLOCK slowly, if the pulse is outputting, the BLOCK will stop after the pulse outputting is finished.

K1: stop the BLOCK immediately; stop all the instructions running in the BLOCK.



K2: Destructive slow stop BLOCK, that is, when the pulse is being sent, the SBSTOP condition holds, then the pulse will slow down along the slope, without to use with the SBGOON instruction, so the remaining instructions will not be executed. After executing this instruction, the BLOCK can be restarted. (Note: K2 mode is only supported by V3.4.2 and above PLC)

Continue running the BLOCK[SBGOON]

Summarization

This instruction is opposite to SBSTOP. To continue running the BLOCK.

[SBGOON]			
16 bits	SBGOON	32 bits	-
Condition	Pulse edge	Suitable types	XD, XL
Hardware	-	Software	V3.2


Operand

Operand	Function	Type
S1	The number of the BLOCK	16 bits, BIN
S2	The mode to continue running the BLOCK	16 bits, BIN

Suitable component

Word	Operand	Register								Constant	Module	
		D*	FD	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S1		•								•		
S2										•		

Note: D includes D, HD; TD includes TD, HTD; CD includes CD, HCD, HS CD, HSD; DM includes DM, DHM; DS includes DS, DHS.



S2 is the mode to continue running the BLOCK. Operand: K0, K1.

K0: continue running the instructions in the BLOCK.

For example, if pulse outputting stopped last time, SBGOON will continue outputting the rest pulse;



K1: continue running the BLOCK, but abandon the instructions have not finished last time.

Such as the pulse output instruction, if the pulse has not finished last time, SBGOON will not continue outputting this pulse but go to the next instruction in the BLOCK.

This instruction only applies to PLSR instructions in BLOCK, and can only send the remaining pulses for interpolation instructions, which can not be skipped.

9-6-2. The timing sequence of the instructions

SBSTOP (K1 K1) + SBGOON (K1 K1)

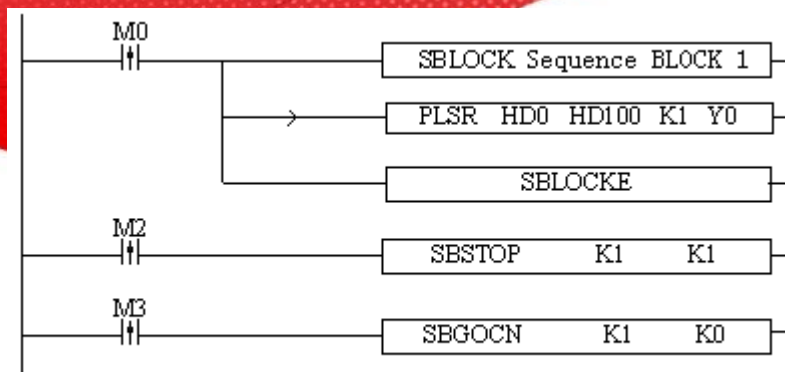



When M0 is from OFF→ON, run “PLSR HD0 HD100 K1 Y0” in the BLOCK to output the pulse;

When M2 is from OFF→ON, the BLOCK stops running at once;

When M4 is from OFF→ON, abandon the rest pulse.

SBSTOP (K1 K1) +SBGOON (K1 K0)




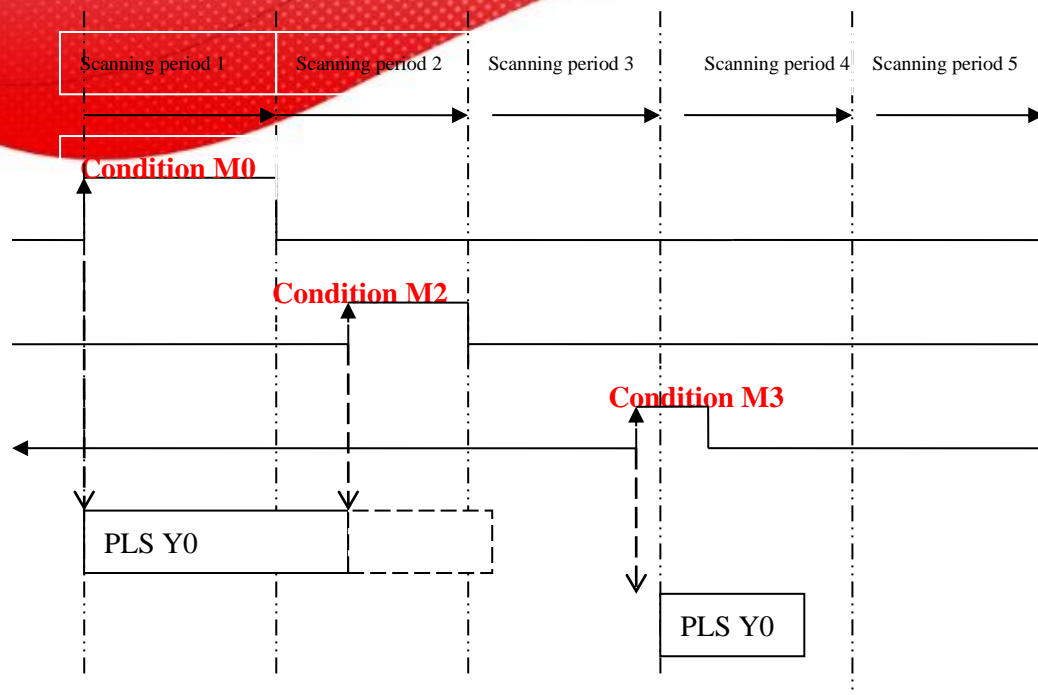


When M0 is OFF→ON, run 'PLSR HD0 HD100 K1 Y0' in the BLOCK to output the pulse; When M2 is OFF→ON, the BLOCK stops running, the pulse output stops at once;

When M3 is OFF→ON, output the rest pulses.

3. SBSTOP(K1 K0)+SBGOON(K1 K1)




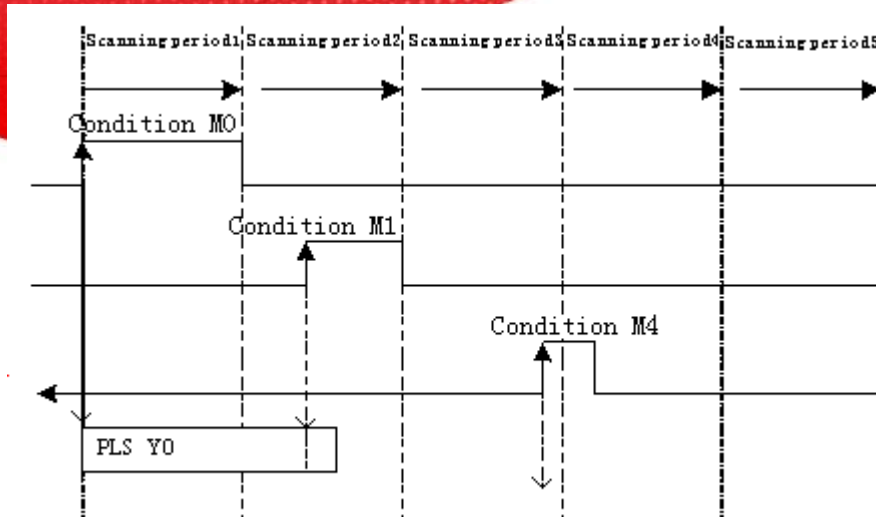


When M0 is from OFF→ON, run 'PLSR HD0 HD100 K1 Y0' in the BLOCK to output the pulse;

When M1 is from OFF→ON, stop running the BLOCK, the pulse will stop slowly with slope;

When M4 is from OFF→ON, abandon the rest pulses.

4. SBSTOP(K1 K0)+SBGOON(K1 K0)



When M0 is from OFF→ON, run 'PLSR HD0 HD100 K1 Y0' in the BLOCK to output the pulse;

When M1 is from OFF→ON, suspend running the BLOCK, the pulse will stop slowly with slope;

When M3 is from OFF→ON, output the rest pulses.

Please note that by the SBSTOP stops the pulse with slope, there may be still some pulses; in this case, if run SBGOON K1 K0 again, it will output the rest of the pulses.

9-7. BLOCK flag bit and register

1. BLOCK flag bit:

Address	Function	Explanation
SM300	BLOCK1 running flag	1: running 0: not running
SM301	BLOCK2 running flag	
SM302	BLOCK3 running flag	
.....	
.....	
SM399	BLOCK100 running flag	

2. BLOCK flag register:







Address	Function	Explanation
SD300	BLOCK1 running instruction	BLOCK use this value when monitoring
SD301	BLOCK2 running instruction	
SD302	BLOCK3 running instruction	
.....	
.....	
SD399	BLOCK100 running instruction	

If GBLOCK is used, it will occupy SM399 and SD399.

10 Special Function Instructions

This chapter mainly introduces PWM (pulse width modulation), precise timing, interruption etc.

Special Function Instructions List:

Mnemonic	Function	Circuit and soft components	Chapter
Pulse Width Modulation, Frequency Detection			
PWM	Output pulse with the specified duty cycle and frequency		10-1
FRQM	Fixed pulses frequency measurement		10-2
Time			
STR	Precise Time		10-3
Interruption			
EI	Enable Interruption		10-4-1
DI	Disable Interruption		10-4-1
IRET	Interruption Return		10-4-1

10-1. Pulse Width Modulation [PWM]

1. Instruction's Summary

Instruction to realize PWM pulse width modulation

PWM pulse width modulation [PWM]			
16 bits instruction	PWM	32 bits instruction	-
execution condition	normally ON/OFF coil	suitable models	XD/XL (except XD1/XL1)
hardware requirement	-	software requirement	-

2. Operands

Operands	Function	Type
S1	specify the duty cycle value or soft component's ID number	32 bits, BIN
S2	specify the output frequency or soft component's ID number	32 bits BIN
D	specify the pulse output port	bit


3. Suitable Soft Components

Word	Operands	System								Constant		Module	
		D*	FD	ED	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
		•	•		•	•					•		
	S1	•	•		•	•					•		
	S2	•	•		•	•					•		

Bit	Operands	System						
		X	Y	M*	S*	T*	C*	Dnm
			•					
	D		•					

*Note: D includes D, HD; TD includes TD HTD; CD includes CD HCD HSCD HSD; DM includes DM DHM; DS includes DS DHS. M includes M HM SM; S includes S HS; T includes T HT; C includes C HC

Function and



Duty cycle n: 1~65535

Output pulse f: 1~100KHz


XD series PLC PWM output need transistor type terminal:

PLC model	PWM terminal
XD2-16T/RT -24T/RT -32T/RT -48T/RT -60T/RT	Y0、Y1
XD3-16T/RT -24T/RT -32T/RT -48T/RT -60T/RT	Y0、Y1
XD5-16T -24T/RT -32T/RT -48T/RT -60T/RT	Y0、Y1
XD5-24T4 -32T4 -48T6 -60T6	Y0、Y1、Y2、Y3
XDM-24T4 -32T4 -60T4 -60T10	Y0、Y1、Y2、Y3
XDC-24T -32T -48T -60T	Y0、Y1
XD5E-30T4 -60T10	Y0、Y1、Y2、Y3
XDME-60T10	Y0、Y1、Y2、Y3
XL3-16T	Y0、Y1
XL5-32T4、XL5E-32T4、XLME-32T4	Y0、Y1、Y2、Y3

Duty cycle of **PWM** output = $n / 65535 \times 100\%$

PWM use the unit of 0.1Hz, so when set S2 frequency, the set value is 10 times of the actual frequency (10f). E.g.: to set the frequency as 72 KHz, and then set value in S2 is 720000.

When X0 is ON, output PWM wave; When X0 is OFF, stop output. PMW output doesn't have pulse accumulation.




In the left graph:

$$T0=1/f$$

$$t/T0=n/65535$$

Note: it needs to connect 1K ohm amplification resistor between output terminal and common terminal when using PWM instruction.

Example



There is a LED driven by DC24V. It needs to control the brightness of the LED. In order to decrease the power loss of wave collector, turn ON the switch at the moment it is OFF, then turn it OFF. This process will cycle. Connet a transistor between the power supply and LED. The pulse signal will input from the transistor base terminal. The current between base and emitter is pulse. The LED input voltage is proportional to the duty ratio. The LED input voltage will be changed by changing the duty ratio. There are many methods to change the value. The normal way is pulse width modulation (PWM) which means only changing the ON holding time but not changing the ON frequency.


This example applies the PWM technology to the LED brightness adjustment. The controller can accpet 24V PWM control signal. The brightness range includes 25%, 50%, 75%, 100%. The brightness is controlled by the PWM duty ratio.

Element explanation:

PLC component	Explanation	Mark
X0	Start button, X0 is ON when pressed.	
X1	Stop button, X1 is ON when pressed.	
X2	25% brightness button, X2 is ON when pressed.	
X3	50% brightness button, X3 is ON when pressed.	
X4	75% brightness button, X4 is ON when pressed.	

X5	100% brightness button, X5 is ON when pressed.	
HD0	PWM duty ratio register	
HD2	PWM frequency register	Defaulted 100Hz

Program:

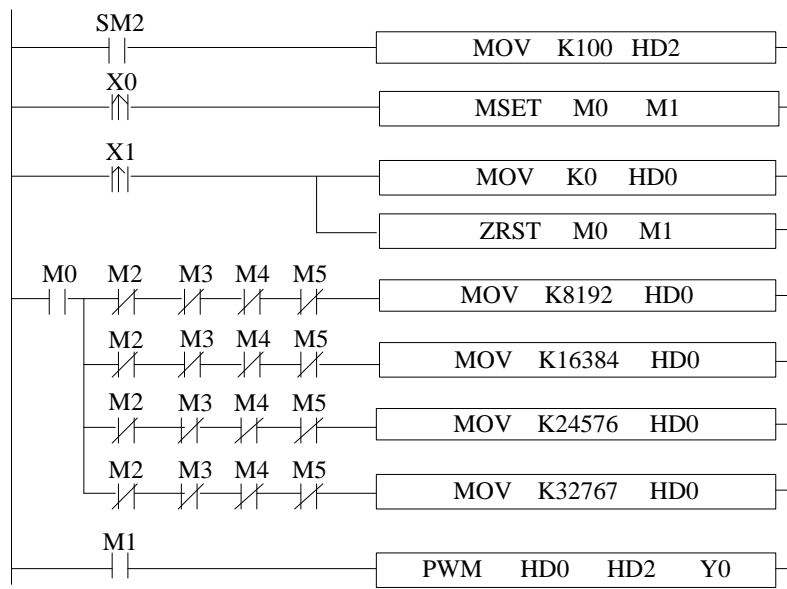

Program explanation:

1. HD0 will control the LED voltage. The voltage = $24 \times \text{HD0} / 32767$, pulse output frequency is 100Hz.
2. Press start button, X0 is ON, M0, M1 is ON, the LED brightness adjustment starts.
3. X2 is ON, HD0=8192, $\text{HD0} / 32768 = 0.25$, the LED brightness is 25%.
4. X3 is ON, HD0=16384, $\text{HD0} / 32768 = 0.5$, the LED brightness is 50%.
5. X4 is ON, HD0=24576, $\text{HD0} / 32768 = 0.75$, the LED brightness is 75%.
6. X5 is ON, HD0=32768, $\text{HD0} / 32768 = 1$, the LED brightness is 100%.
7. Press shut down button, X1 is ON, HD0 is reset, shut down the PWM trigger condition, LED voltage is 0V.

10-2. Frequency measurement [FRQM]

1. Instruction list

Measure the frequency.

Frequency measurement [FRQM]			
16 bits instruction	-	32 bits instruction	FRQM
execution condition	Normally ON OFF coil	suitable models	XD/XL (except XD1/XL1)

hardware requirement	-	software requirements	-
----------------------	---	-----------------------	---

2. Operand

Operands	Function	Type
S1	Sampling pulse numbers	32 bits, BIN
S2	Frequency division option	32 bits, BIN
D	Measurement result	32 bits, BIN
S3	Pulse input terminal	bit

3. Suitable component

Word

Operand	System									Constant	Module	
	D*	FD	ED	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
S1	●	●		●	●					●		
S2	●	●		●	●					●		


Bit

Operand	System						
	X	Y	M*	S*	T*	C*	Dnm
D		●					

*Note: D includes D HD; TD includes TD HTD; CD includes CD HCD HSCD HSD; DM includes DM DHM; DS includes DS DHS.

M includes M, HM, SM; S includes S, HS; T includes T, HT; C includes C, HC.

Function and Action



- The sampling pulse numbers can be adjusted according to the frequency, the higher the frequency, the bigger the sampling pulse numbers
- Measurement result, the unit is Hz
- Display resolution: only can set to 1, 10, 100, 1000, 10000
- When M0 is ON, FRQM collects 20 pulses from X0, and records the sampling time. The result of sampling numbers dividing by sampling time will be saved in D100. The measurement process will repeat. If the measurement frequency is less than the measurement range, the result is 0
- The measurement precision is 0.001%

The pulse input terminal for FRQM:

Model		X terminal	Max frequency (Hz)
XD2	16 I/O	X0	10K
		X3	
		X6	
	24/32 I/O	X0	80K
		X3	10K


	48/60 I/O	X6	
		X0	80K
		X3	
		X6	10K
XD3	16/24/32 I/O	X0	80K
		X3	10K
		X6	
	48/60 I/O	X0	80K
		X3	
		X6	10K
XD5	16/24/32 I/O	X0	80K
		X3	10K
		X6	
	24T4/32T4/48T4/60T4 I/O	X0	80K
		X3	
		X6	
		X11	
	48/60 I/O	X0	80K
		X3	
		X6	10K
	48T6/60T6/60T10 I/O	X0	80K
		X3	
		X6	
		X11	
XDM	24T4/32T4/60T4 I/O	X0	80K
		X3	
		X6	
		X11	
	60T10 I/O	X0	80K
		X3	
		X6	
		X11	
XDC	24/32/48/60 I/O	X0	80K
		X3	
		X6	
		X11	
XD5E	30T4/60T10 I/O	X0	80K
		X3	
		X6	
		X11	
XL3	16 I/O	X0	80K
		X3	10K
		X6	
XL5	32T4 I/O	X0	80K
		X3	
		X6	
		X11	
XL5E	32T4 I/O	X0	80K
		X3	
		X6	
		X11	
XLME	32T4 I/O	X0	80K

		X3	
		X6	
		X11	

Example

Asynchronous motor drives the conveyor to transfer the work piece. It needs to real-time display the work piece moving speed. The diameter of the transmission shaft is 100mm, the gear numbers on the transmission shaft are 100, the speed unit is m/min.


proximity switch



Component explanation:

PLC component	Control explanation	Mark
X0	Proximity switch, to count the gear numbers	
M0	Start signal	
D16	Speed register (float number)	

Program:



Program explanation:

1. Set ON the start signal M0, to run the frequency measurement program
2. Transform the frequency to float number, then it is divided by 100 (gear numbers per rotation), the result is shaft rotate numbers per second (float number).
3. Calculate the diameter of the transmission shaft and save in register D6 (float number), then calculate the transfer distance per second and save in D10 (float number).
4. the transfer distance per second multiply by 60 is the speed (m/min).

10-3. Precise Timing [STR]

1. Instruction List

Read and stop precise timing when precise timing is executed

Precise timing[STR]			
16 bits instruction	-	32 bits instruction	STR
execution condition	edge activation	suitable models	XD/XL
hardware requirement	-	software requirements	-

2. Operands

Operands	Function	Type
D1	Timer Number	bit
D2	specify timer's value or soft component's ID number	32 bits, BIN

3. Suitable Soft Components


Word	Operands	system								constant	module	
	D*	FD	ED	TD*	CD*	DX	DY	DM*	DS*	K/H	ID	QD
	D2	●	●		●	●					●	

Bit	Operands	system							
	X	Y	M*	S*	T*	C*	Dnm		
	D					●			
	D1					●			

*Note: D includes D HD; TD includes TD HTD; CD includes CD HCD HSCD HSD;
DM includes DM DHM;
DS includes DS DHS.
M includes M HM SM; S includes S HS ; T includes T HT ; C includes C HC.

Function and Action

<Precise timing>, <Precise timing reset>

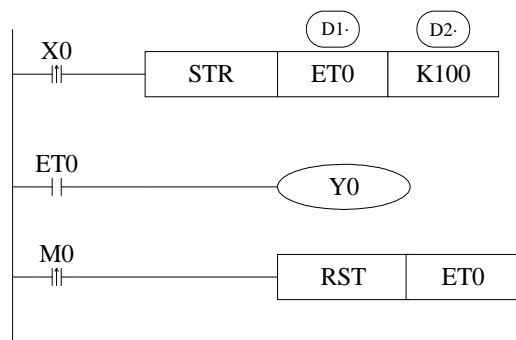

(D1) Timer's number. Range: ET0~ET30 (ET0, ET2, ET4.....all number should be even)


(D2) Timing value

Precise timer works in unit of 1ms.

Precise timer 32 bits, the counting range is 0~+2,147,483,647.


When executing STR, the timer will be reset before start timing.

When X0 turns from OFF to ON, ET0 starts timing. ET0 will be reset and keep its value 100 when accumulation time reaches 100ms; If X0 again turns from OFF to ON, timer ET0 turns from ON to OFF, restart to time, when time accumulation reaches 100ms, ET0 reset again. See graph below:



When the pre-condition of STR is normally open/closed coil, the precise timer will set ON immediately when the timing time arrives and reset the timing, and cycle back and forth.

<read the precise timing>, <stop precise time>




- When X0 changes from OFF to ON, move the current precise timing value into D0 immediately, it will not be affected by the scan cycle;
- When M0 changes from OFF to ON, execute STOP instruction immediately, stop precise timing and refresh the count value in ETD0. It will not be affected by the scan cycle;

Precise Timing Interruption

- When the precise timing reaches the count value, it will generate an interruption tag, interruption subprogram will be executed.
- Can start the precise timing in precise timing interruption;
- Every precise timer has its own interruption tag, as shown below:

Interruption Tag corresponding to the Timer:


Timer's No	Interruption Tag	Timer's No	Interruption Tag
ET0	I3000	ET10	I3005
ET2	I3001	ET12	I3006
ET4	I3002
ET6	I3003	ET22	I3011
ET8	I3004	ET24	I3012

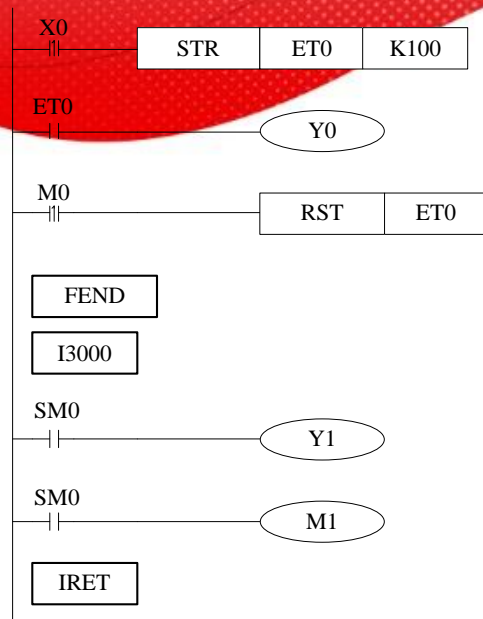

When X0 changes from OFF to ON, ET0 will start timing. And ET0 reset when accumulation time is up to 100ms; meantime generates an interruption, the program jumps to interruption tag I3000 and execute the subprogram.

Example 1

The filling machine controls the filling capacity by controlling the liquid valve open time (it is 3000ms in this application). To improve the filling capacity precision, the liquid valve open time can be controlled by precise timing.




Filling machine

Component explanation:

PLC component	Control explanation	Mark
X0	Start button, X0 is ON when the button is pressed	
ET0	Precise timer	
Y0	Control the liquid valve, Y0 ON when the valve opened, Y0 OFF when the valve closed	

Program:




Program explanation:

1. When X0 is ON, the liquid valve Y0 and precise timer ET0 open at once.
2. Shut down the liquid valve Y0 and precise timer ET0 when the time arrived.

Example 2


The precise timer interruption can produce the following pulse wave. The Y2 ON time is 500ms, the pulse period is 1000ms.



Component explanation:

PLC component	Control explanation	Mark
X0	Start button, X0 is ON when button is pressed	
Y2	Pulse output terminal	
M0	Internal auxiliary coil	
ET0	Precise timer	

Program:

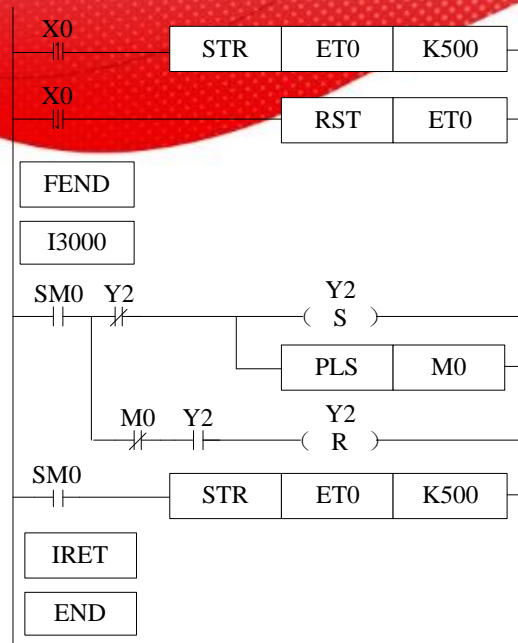


Program explanation:

1. When X0 is ON, the precise timer interruption will work, Y2 will output the pulse wave.
2. When X0 is OFF, shut down the precise timer interruption, Y2 stop outputting.

Example 3


As the FRQM calculating the time for fixed pulse numbers, we will change the way to calculate the pulse numbers in fixed time.



Component explanation:

PLC component	Control explanation	Mark
M0	Start button, X0 is ON when pressed	
ET0	Precise timer	
HD0	Precise timer setting value (unit: ms)	
HSC0	High speed counter	
D10	The measured frequency (unit: s)	

Program:



Program explanation:


1. Set the high speed counter sampling period register HD0, the unit is ms.
2. Set ON M0 to start the precise timer interruption and high speed counter, calculate the frequency
3. The frequency range is 0-80KHz, the precision is 0.005%.

10-4. Interruption [EI], [DI], [IRET]

XD/XL series PLC have interruption function, including external interruption and timing interruption. By interruption function we can deal with some special programs. This function is not affected by the scan cycle.

10-4-1. External Interruption

The input terminals X can be used to input external interruption. Each input terminal corresponds with one external interruption. The input's rising/falling edge can activate the interruption. The interruption subroutine is written behind the main program (behind FEND). After interruption generates, the main program stops running immediately, turn to run the correspond subroutine. After subroutine running ends, continue to execute the main program.



Note: The external interruption of XC series PLC cannot be activated by rising edge and falling edge at the same time; but XD/XL series PLC supports rising edge and falling edge activation meantime.

External Interruption's Port Definition

XD1/XD2/XD3/XD5/XL1/XL3 series 16 I/O

Input terminal	Pointer No.		Disable the interruption instruction
	Rising Interruption	Falling interruption	
X2	I0000	I0001	SM050
X3	I0100	I0101	SM051
X4	I0200	I0201	SM052
X5	I0300	I0301	SM053
X6	I0400	I0401	SM054
X7	I0500	I0501	SM055


XD1 series 32 I/O, XD2/XD3 series 24/32/48/60 I/O, XD5 series, XDM series, XDC series, XD5E series, XDME series, XL5 series, XL5E, XLME series

Input terminal	Pointer No.		Disable the interruption instruction
	Rising Interruption	Falling interruption	
X2	I0000	I0001	SM050
X3	I0100	I0101	SM051
X4	I0200	I0201	SM052
X5	I0300	I0301	SM053
X6	I0400	I0401	SM054
X7	I0500	I0501	SM055
X10	I0600	I0601	SM056
X11	I0700	I0701	SM057
X12	I0800	I0801	SM058

Note: when the interruption ban coil is ON, the external interruption will not execute.

Interruption Instruction


Enable Interruption [EI], Disable Interruption [DI], Interruption Return [IRET]



- If use EI instruction to allow interruption, then when scanning the program, if interruption input changes from OFF to ON, then execute subroutine ①、②. Return to the original main program.
- Interruption pointer (I****) should be behind FEND instruction;
- PLC is usually on the status that allows interruption.


Note: In interrupt subroutine, only simple instructions such as set, reset, transmission and operation can be written, which can be executed in a scanning cycle. Other instructions such as sending pulses, timing (except for precise timing), communication and other instructions that need to be continuously executed are not supported.

Interruption's Range Limitation




- By programming DI instruction, can set interruption disabled area;
- Allow interruption input between EI~DI
- If interruption forbidden is not required, please program only with EI, and program with DI is not required.

Disable the Interruption



- Every input interruption is equipped with special relays (SM50~SM69) to disable interruption.
- In the left program, if use M0 to set SM50 "ON", then disable the interruption 0.

Example 1



The positions of A, B, C are unknown. The speed of the three segments are different. The application can be performed by PLSF instruction and external interruption. We can install three proximity switches at position A, B, C, and connect the signal to PLC input terminal X0, X1, X2. (suppose X0, X1, X2 are external interruption terminal, the related rising edge interruption ID are I0000, I0100, I0200. The PLC external interruption terminal please refer to "external interruption terminal definition"). The pulse terminal is Y0, the direction terminal is Y2. To improve the speed changing precision, the acceleration and deceleration time are 0. The speed will switch by external interruption.


Segment	Frequency setting value (Hz)	Pulse numbers
Origin ---- A	10000	999999999
A---- B	30000	999999999
B ---- C	20000	999999999
Acceleration and deceleration time	0	

Note: as the pulse numbers of each segment is unknown, the pulse numbers should set large enough to ensure the object can move to the proximity switch. The STOP instruction will be run by external interruption when the object gets to position C.

Component explanation

PLC component	Control explanation	Mark
M0	Start button, PLSF will send pulse when the button is pressed	
HD0	the PLSF pulse frequency register	

Program

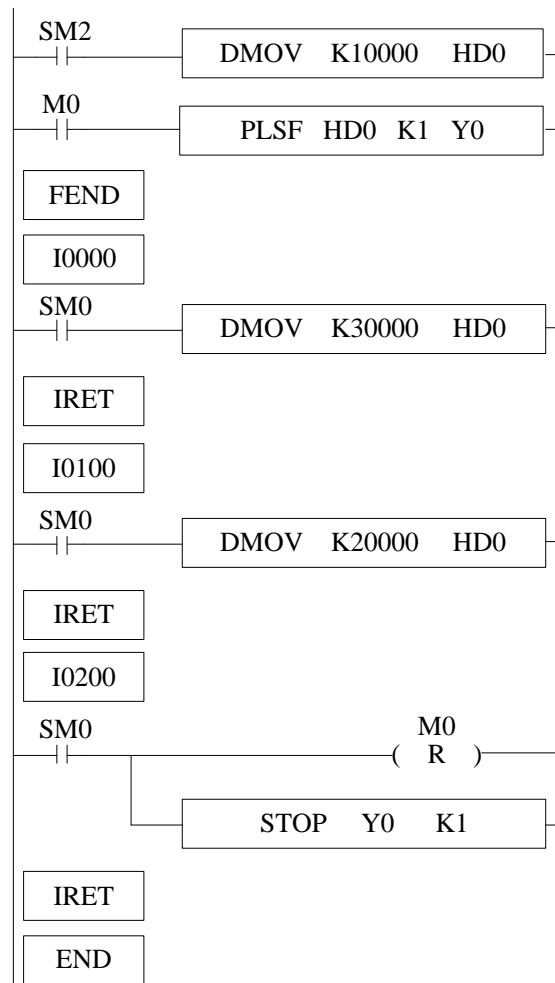


Program explanation

1. SM2 is ON, set HD0 to 10000, set on M0, PLSF instruction will send 10000Hz pulse, the object will move from origin to A.
2. When the object touches A, X0 will be ON at once, the external interruption I0000 will work, HD0 is set to 30000, the object will move from A to B with the speed of 30000Hz.
3. When the object touches B, X1 will be ON at once, the external interruption I0100 will work, HD0 is set to 20000, the object will move from B to C with the speed of 20000Hz.
4. When the object touches C, X2 will be ON at once, the external interruption I0200 will work, M0 is set OFF, the pulse sending will stop at once.

Example 2


The diagram is the product packing machine. The robot will pack the product when 30 products are detected, the robot and counter will be reset after packing completed. To improve the working efficiency, the product sending speed is very fast, the sensor X2 detects the product time is 8ms, PLC input terminal filter time is 10ms, the normal counter cannot detect the products. We can use the external interruption to count the products.



Component explanation:

PLC component	Control explanation	Mark
X2	Product counting photoelectric sensor, X2 is ON when the product is detected	
X1	Robot action complete sensor, X1 is ON when the action is completed	
C0	16-bit counter	
Y0	Robot	

Program:

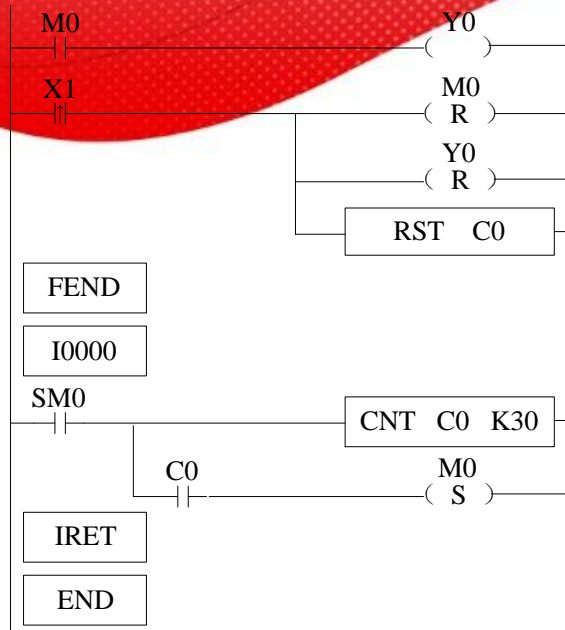


Program explanation:

1. In the external interruption program, count the X2 input, when the X2 is 30, set ON M0
2. In the main program, it controls the Y0 according to the M0 state.
3. When the robot action is completed, X1 changes from OFF to ON once, RST works, Y0 and C0 are reset, M0 is OFF, wait for the next packing process.

10-4-2. Timing Interruption

Function and Action

Under the circumstance that the main program execution cycle is very long, when you have to handle with special program or execute specific program every once in a while when program is scanning in sequence control, the timing interruption is very useful. It is not affected by PLC scan cycle and executes timing interruption subroutine every N ms.



- Timing interrupt is open status in default, just like other interrupt subroutines, it should be written behind the main program, starts with I40xx, ends with IRET.
- There are 20 channels of timing interruptions, representation: I40**~I59**('**' means interrupt time; Unit is ms. E.g: I4010 means executing once the first timing interrupt per 10ms.


Interrupt No

XD, XL series timing interrupt:


Interrupt number	Interrupt ban instruction	Interrupt number	Interrupt ban instruction	Explanation
I40**	SM070	I50**	SM080	** means the timing interrupt time, the range is 1~99, the unit is ms.
I41**	SM071	I51**	SM081	
I42**	SM072	I52**	SM082	
I43**	SM073	I53**	SM083	
I44**	SM074	I54**	SM084	
I45**	SM075	I55**	SM085	
I46**	SM076	I56**	SM086	
I47**	SM077	I57**	SM087	
I48**	SM078	I58**	SM088	
I49**	SM079	I59**	SM089	

Interrupt range's limitation

- Timing interrupt is usually on 'allow' status.
- Can set interrupt allow and forbidden area with EI、DI instructions. As shown in below pictures, all timing interruptions are forbidden between DI and EI, and allowed beyond DI~EI.



Interruption Forbidden

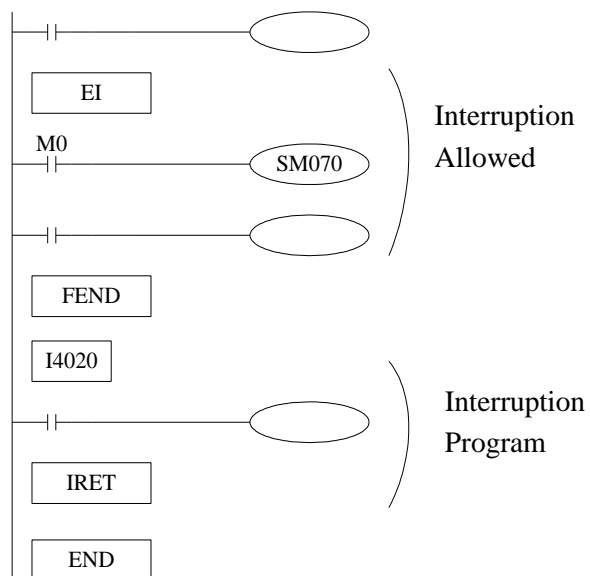


- The first 3CH timing interruptions are equipped with special relays (SM070~SM079).
- In the left example, if use M0 to set SM070 “ON”, then forbid timing interruption forbidden.


11 Common Questions and Answers

This chapter mainly introduces XD/XL series PLC common questions and answers.


Q1: How to connect PLC with PC?

A1:

If your PC is desktop computer, you can use our company special DVP or XVP cables to connect PC and PLC (Usually PORT1) as general commercial desktop computer has 9 needle serial port. After connecting DVP correctly, power on PLC, click 'Config Software'  Port, the following window will jump out:



Choose correct communication serial port according to your PC actual serial port.; baud rate selects 19200BPS, parity check selects even parity, 8 data bits, 1 stop bit; you can also click 'check' button directly in the window, and communication parameters will be selected by PLC itself. 'Connect PLC successfully' will be displayed on the left bottom of window as below:

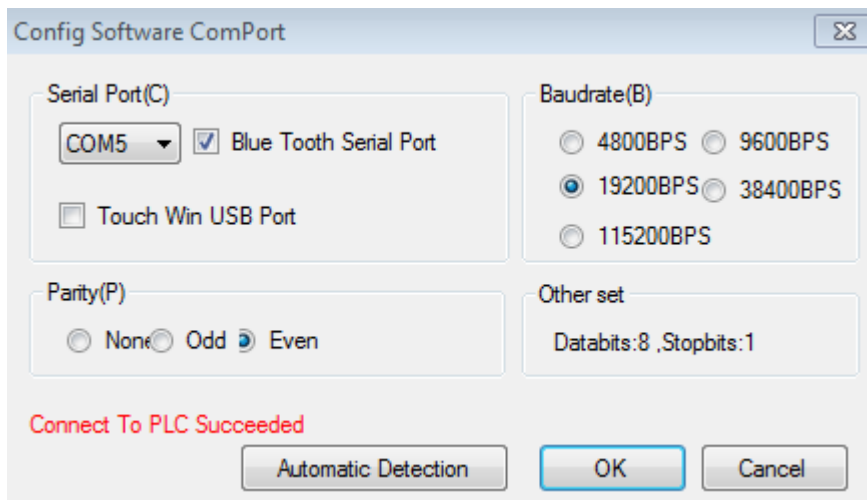

Then it means that PLC has been connected to PC successfully!

Usage method of notebook PC with 9-pin serial port is the same with desktop PC's.

If the notebook does not have 9-pin serial port, users can use USB converter to realize connection between PLC and notebook USB port. Make sure to install USB converter drive software (Xinje special USB converter module COM-USB is recommended, USB converter drive software can be downloaded on Xinje official website)!

Q2: PC cannot connect PLC via RS232 port, it shows offline status?

A2:

Several possible reasons:

Users may changed the communication parameters of PORT1 in PLC (Do not change Port1 communication parameters, or it may lead to connection between PC and PLC failure!)

USB converter driver software was installed incorrectly or USB converter cable is not good

PORT1 communication of PLC is damaged

The download communication cable brand is not Xinje XVP cable.


Solutions:

At first, use Xinje XVP cable to connect PC and PLC;


After confirming the connection cable is the Xinje special XVP cable and USB convertor has been used, you can use it to try to connect desktop PC with 9-needle serial port to PLC. If the desktop PC can be connected correctly, please change the USB converter cable with higher performance or install the USB converter serial driver software again.

If PLC can not connect with desktop computer correctly either, you can use 'stop PLC when reboot' function to stop PLC and recover the PLC to factory setting, operating method is as follow:

Power on PLC and connect PLC by DVP cables, then click 'online' button on PLC editing software menu;




Click 'Stop when PLC reboot' from the drop-down menu;



Following window will jump out;




By this time, cut off PLC power for 2-3s and power on again, then a 'PLC has been stopped successfully' window will normally jump out; if the window do not jump out after power on, try again a few times until the information window of successful stop jump out.




Then click 'configure' button ;




Click 'Reset PLC' in the drop-down menu;



By this time, 'Reset PLC' information window will jump out and it means that all steps of 'Stop when PLC reboot' have been finished.



If initialize PLC unsuccessfully after you trying a few times or the following window jumps out after clicking 'Reset PLC':



In both cases, use PLC system update tool to update PLC system, and PLC and PC will be connected successfully if system is updated (For more steps about system update, please refer to Q3 related content).

If update of the desktop computer with 9-pin serial port fails, it is very likely that PLC communication port is damaged, and please contact manufacturer or agent.

Q3: XD/XL series PLC system upgrade

A3:

When does PLC need update usually?

PLC software is in a continuous upgrade stage; if software and hardware version do not match, PLC will not support those upgraded function. About which PLC version the instruction support, please refer to instruction summary in this manual or appendix 2 'special function version requirement';

When users change the communication parameters, PLC and PC can not connect.

When users use 'program confidential download' function, however, forget the password (Note: PLC program will disappear after system update!).


How to update XD/XL series PLC?

PLC update tool:



'XD series PLC download program tool' and 'system file' (*.sys file)

Close all the programs which may occupy the serial port

Cut off the power of PLC, open the XD series update tool (if user use this tool at the first time, please open the enrollment first)





Click "Open File", choose the PLC model for updating. (Note: XD3_16.sys fit for PLC model XD3-16, XD3_60.sys fit for PLC model XD3-32 and XD3-60):

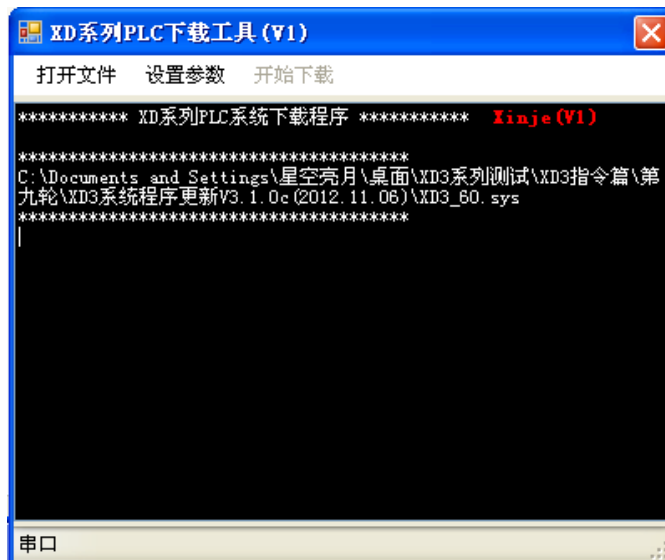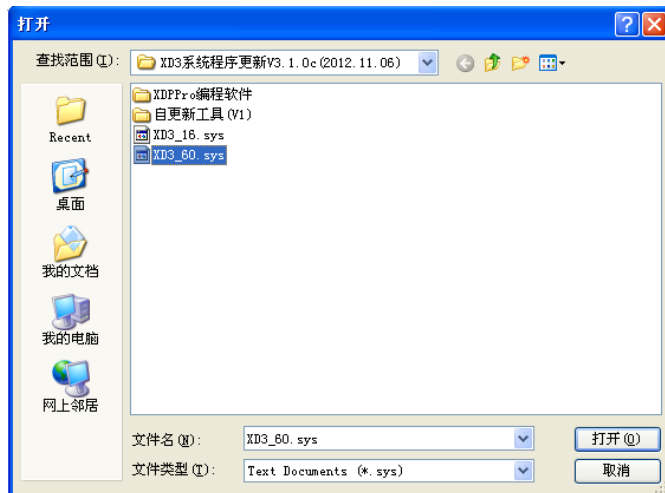


Set the parameters:


Click “set parameter”, it will show the parameter window:

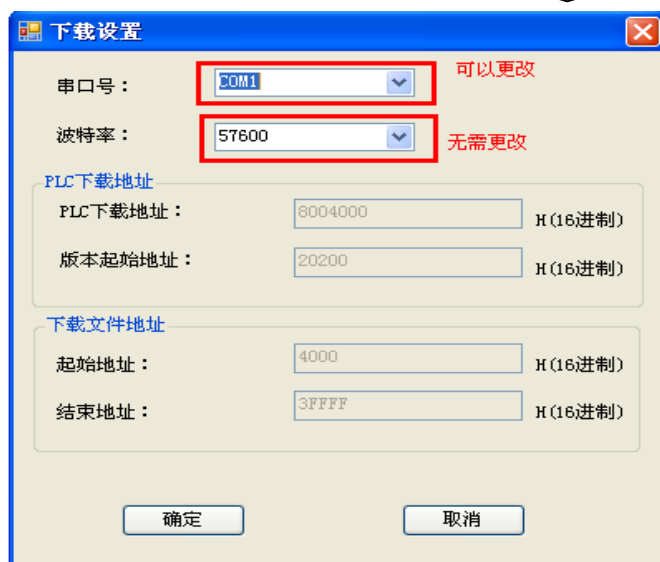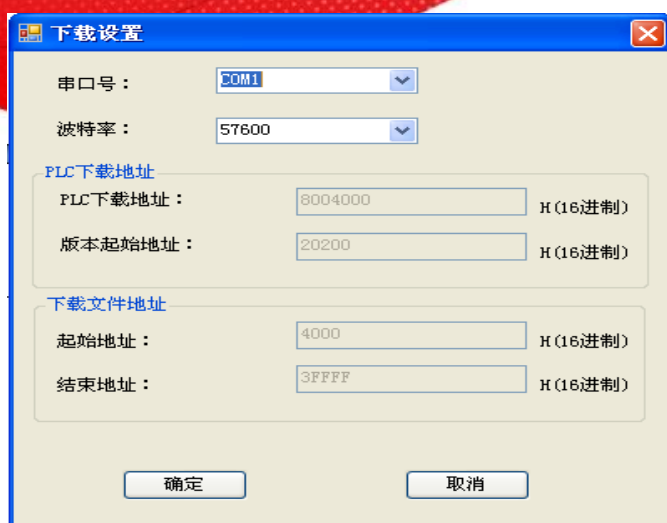


Note: set the com port, the baud rate is default setting, no need to change.
Click “download”, the window will show below words:




Power on the PLC, the update tool will show below words:

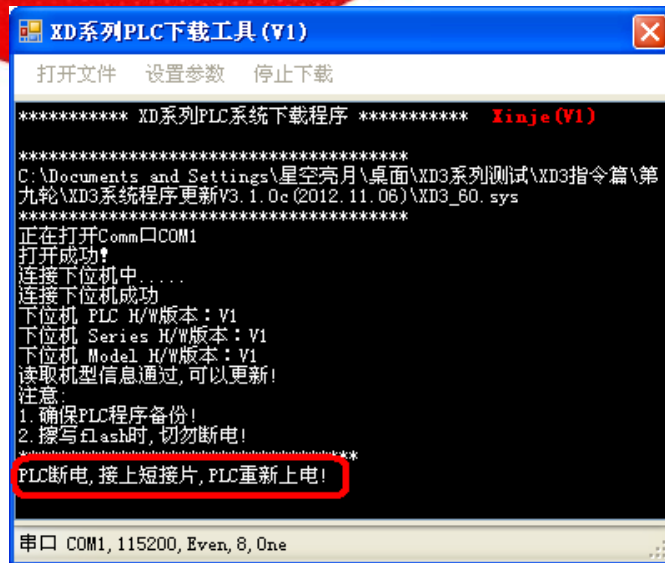

Cut off the power of PLC, connect the short jumper, then power on the PLC again.




PLC start to update, the updating will take few minutes.

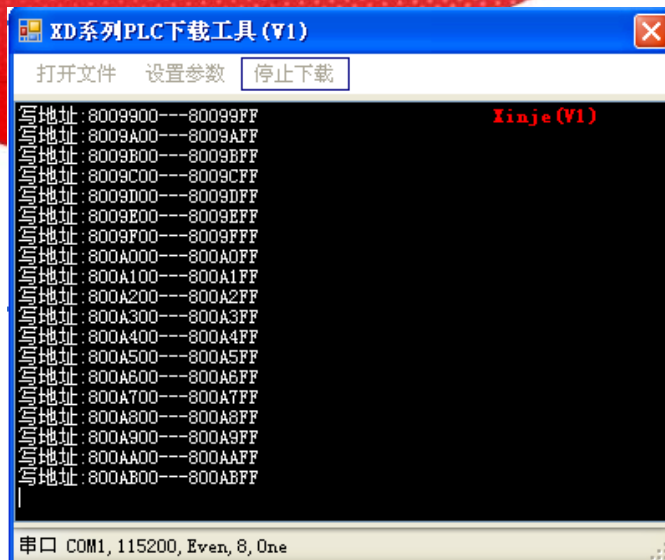


After finishing the update, cut off the PLC power, take off the short jumper, then power on the PLC again.

PLC hardware version

The PLC hardware version can be seen in “CPU detail” on the left window in XDPpro software (PLC online status)





Short jumper

XD, XL series PLC no need to short the jumper when updating.

Note:

Do not cut the power of PLC when it is updating. If it show the error “send data failed, ID not match...” please contact us for help.

The PLC program will be deleted after updating.

Q4: The bit soft component function.

A4:

Continuous 16 coils consist of a word, E.g: DM0 a word consist of 16 coils (bits) M0~M15 is as below:

DM0:

M15	M14	M13	M12	M11	M10	M9	M8	M7	M6	M5	M4	M3	M2	M1	M0
-----	-----	-----	-----	-----	-----	----	----	----	----	----	----	----	----	----	----

We can use bit in the register directly.

Example 1:



When M100 is from OFF to ON,
M0 M1 are ON, M2—M15 are OFF

The other mode is bit operation of fixed register. E.g: D0.0 is the first bit of 16 bits in register D0. Similarly, D0.1 is the second bit and so on, as shown below:

D0:

D0.15	D0.14	D0.13	D0.12	D0.11	D0.10	D0.9	D0.8	D0.7	D0.6	D0.5	D0.4	D0.3	D0.2	D0.1	D0.0
-------	-------	-------	-------	-------	-------	------	------	------	------	------	------	------	------	------	------


Similarly, we can use bit in register D0.

Q5: What's the use of execution instruction LDD/OUTD etc?

A5:

When PLC executes program, state of input point state will map to image register. From then on, PLC will refresh input state at the beginning of every scan cycle; if we use LDD instruction, then the state of input point will not need map to image register; the same with output point (OUTD).

LDD/OUTD instruction usually apply to the occasion that I/O need refresh immediately, which makes the state of input and output avoid the influence of the scan cycle.



Input point X0 sequence chart of LDD and LD

Q6: Why the output LED keeps flashing when using ALT instruction?

A6:

For ALT and many calculation instructions, these instructions will execute every scanning period when the condition is fulfilled (for example, the condition is normal ON coil). We recommend that the condition is rising edge or falling edge.


Q7: Why the M and Y cannot output sometime?

A7:

Output mainly has two ways: 1. OUT instruction; 2. SET instruction. The coil will keep outputting if there is no RST instruction.

Usually in the program, one coil M or Y should use the same output way. Otherwise, the coil cannot output.

For example:



M0 is ON, M1 is OFF, Y0 cannot output

M0 is OFF, M0 is ON, Y0 will output

Reason: two different coils drive the same output coil



Y0 will be ON for one scanning period



M0 is ON, Y will keep outputting
M1 is ON, Y0 is OFF

Q8: Check and change the button battery in the PCB of PLC

A8:

The rated voltage of button battery is 3V. The voltage can be measured by multimeter. If the value of power-loss retentive register is very large, it means the battery is low. Please change the button battery. Users can use SM5 and SD5 to detect the power of button batteries in order to facilitate timely replacement of batteries. See Appendix 1 and Appendix 2 for details.

Q9: Communicate with SCADA software

A9:

If there is no choice for XD/XL series PLC in SCADA software, please choose Modbus-RTU protocol and communicate through RS485 port. Please refer to XD/XL series PLC instruction manual chapter 6.

Q10: MODBUS Communication

A10:

First of all, please ensure that the A and B terminals on the PLC are correctly connected with the RS485 communication terminals of other devices. To modify the parameters of the PORT 2 of the PLC, the following methods are adopted:

Method 1: Configuration by configuration parameter instruction

For specific instructions, please refer to Chapter 6, Communication Functions of this manual.

The communication parameter settings of different devices are generally different, so it is important to choose the correct frequency setting mode of communication devices, make clear the corresponding MODBUS communication address and function code, and some communication devices need a given operation signal before displaying the setting frequency.

Method 2: Configuration through control panel (refer to Chapter 6 Communication Function of this manual for specific configuration method).

Q11: The LED light of XD/XL series PLC (PWR/RUN/ERR)

A11:


LED light	Problem	Solution
PWR shining, other LED off.	1. I/O PCB has short circuit 2. load is too large for 24V 3. not click RUN for program	Check I/O terminal, if there is short circuit. If the load is too large for 24V power supply. Make sure the program is running inside PLC. Contact us for help.

Three LED all OFF	1. PLC input power supply has short circuit 2. PLC power PCB damaged	Check the input power supply of PLC. Contact us for help.
PWR and ERR light	1. PLC input voltage is not stable 2. there is dead loop in the program 3. PLC system has problem	Check the power supply voltage, check if there is dead loop in the program. Update the hardware of PLC. Contact us for help.

Q12: the result is not correct when doing floating operation

A12:

Please transform the integer to floating number. For example: EDIV D0 D2 D10. If the value of D0 and D2 is integer, the result will has error (D10). Please use below instruction to transform the integer to floating number.




Q13: Why the floating numbers become messy code in online ladder monitor window?


A13:

As the floating number cannot be displayed in online ladder monitoring, please monitor the floating number in free monitor function.

Open XDPpro software, click online/free monitor. The following window will pop up:



Click "add" in the window, the following window will pop up. Set the monitor mode to "float". Monitor register set to D10. Then click ok.

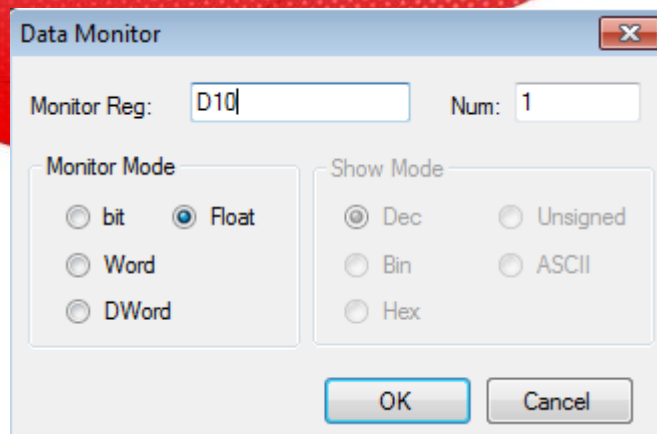

Q14: Why data errors after using DMUL instructions?

A14:

DMUL operation instruction is 32 bit*32 bit=64 bit operation, the result occupies 4 words, such as: EMUL D0 D2 D10, two multiplier both are 32bit (D1,D0) and (D3, D2), the result is 64 bit (D13, D12, D11, D10), so D10~D13 will be occupied. If these data registers are used latter, operation will error.

Q15: Why the output point action errors after PLC running for a while?

A15:

It's possible that output terminal is loose, please check.

Q16: Why expansion module does not work while power indicator is ON?

A16:

It is likely the connection of module strips and PLC pins or CPU is not good. Compare the CPU and expansion in cross contrast way to find the problems.

Q17: Why the signal input but cannot see the high speed counter working?

A17:

If high-speed counting is to be carried out, in addition to connecting high-speed pulse to the input of high-speed counting of PLC, the corresponding high-speed counting program should be written with functional instructions. For details, please refer to the relevant content of Chapter 5 of this manual.

Q18: C language advantages compared to ladder chart?

A18:

- (1) XD/XL series PLC supports almost all C language functions. When it comes to complex mathematical operations, the advantage of C language is more obvious.
- (2) Enhance the confidentiality of the program (when using file-advanced storage mode, C language can not upload);
- (3) C language function block can be called in many places and different files, which greatly improves the efficiency of programmers.

Q19: What's PLC output terminal A, B?


A19:

PLC output terminal A, B are RS485 terminals of PORT2 on PLC.


Q20: What's the difference of sequence function BLOCK trigger condition: rising edge triggered and normally closed conduction?

A20:

Rising edge triggered: when the condition is triggered, block executes in order from top to bottom; Normally closed conduction: when the condition is triggered, Block will execute in order from top to bottom, return to the top and execute again until the normally closed conduction breaks off. The cycle stops when the last one finished.



From up to down, run the instruction one by one



from up to down, cyclic run the instruction

Q21: What are the download modes of XD/XL series PLC and what are their characteristics?

A21:

XD/XL series PLC has three download modes, which are:

Common download mode

In this mode, you can easily download the program from the computer to the PLC or upload the program from the PLC to the computer. It will be very convenient to use this mode when debugging the equipment.

Password Download Mode

You can set a password for the PLC. When you upload the program from the PLC to the computer, you need to enter the correct password. In the advanced password option, you can also check the function of "download the program needs to be decrypted first" (Note: This operation is dangerous, if you forget the password, your PLC will be locked!). This download mode is suitable for users when they need to keep the device program secret and they can call out the device program at any time.

Secret download mode

In this mode, the program on the computer can be downloaded to the PLC, no matter what way the user can upload the program in the PLC to the computer; at the same time, the user program can be downloaded confidentially, which can occupy less internal resources of the PLC, greatly increase the program capacity of the PLC, and

can have a faster download speed; after using this download mode, the program will be completely unable to recover.

Q22: What kinds of confidentiality methods do XD/XL series PLCs have?

A22:

Xinje PLC has three methods of confidentiality: (1) importing and exporting downloaded files; (2) secret downloading; (3) password downloading.

Import and export download files: After saving the PLC program in this way, users can download and use the program, but they can not view and edit the program.

Secret download: After secret downloading to PLC, the program and data in PLC will not be uploaded, indicating that "the program does not exist".


Password download: If you download the program that has set the password to the PLC, you need to input the correct password when uploading the PLC program; if you check "download program needs to be decrypted first", you also need to input the correct password when downloading the new program to the PLC. Under this mode, you can not modify the clock information of the PLC, and the confidentiality is stronger.

Q23: what's the advantage that XD series PLC replaces DVP download cable with Bluetooth?

A23:

XD series PLC Bluetooth function can perform PLC program download and upload, monitor and Twin configuration software online simulation. The Bluetooth can replace the cable to transfer the data.



Note: COM-Bluetooth only fit for XINJE PLC.

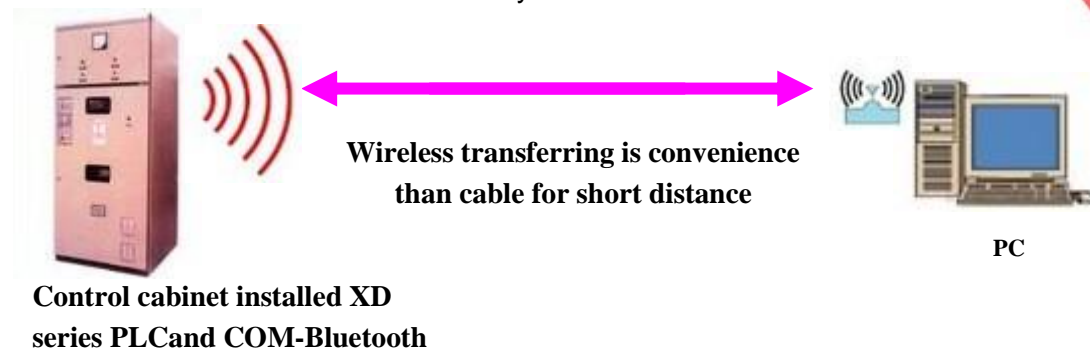

Q24: PLC I/O terminal exchanging

A24:

Sometime the PLC I/O terminals are broken. User don't have to change the program, PLC I/O terminal exchanging function can solve the problem. User can exchange the terminal through XINJE Touchwin HMI. Open Touchwin software, jump to screen no. 60004 (X terminals) or screen no. 60005 (Y terminals) to set the I/O exchanging.



Touchwin HMI I/O terminal exchanging screen

Q25: What's the function of XD/XL series PLC indirect addressing?

A25:

Adding offset suffix after coils and data registers (Such as X3[D100], M10[D100], D0[D100]) can realize indirect addressing function; such as D100=9, X3[D100] represents X14, M10[D100] represents M19, D0[D100] represents D9; It usually applies to large number of bit and register operation and storage.

Q26: How does XD/XL series PLC connect to the network?

A26:

XD/XL series PLC can connect to network by Xinje T-BOX, G-BOX, W-BOX, S-BOX, A-BOX expansion modules or expansion BD boards which have their own


communication characteristics. Details please refer to the user manual of communication module or BD board.

Q27: how to add soft element and line note in XDppro software?


A27:

Soft element note

Open XDPpro software, and move the mouse to the corresponding soft element and right click the mouse, then menu will pop out:





Click "Modify reg comment" to add element notes in below window:



Line note

Line note starts from ";". Double click the line, then input semicolon and the contents.





Q28: do not have clock function? Why is the clock inaccurate?

A28:

XD/XL series PLC clock function is optional, and if you want to buy the PLC with clock function, please confirm when purchasing. Otherwise, the default PLC when it leaves factory does not have clock function.





If you use a PLC with clock function, check whether the value in register SD13-SD19 is decimal. If not, you need to convert it into decimal through BIN or TRD instructions. There are some errors in the clock of XD/XL series PLC. The error is about ± 5 minutes per month. Please calibrate it by HMI or directly in the PLC program.

Appendix Special soft components


Appendix mainly introduces the functions of XD/XL series PLC special soft element, data register, FlashROM and the address distribution of expansions for users to search.




Appendix 1. Special Auxiliary Relay

Initial Status (SM0-SM7)

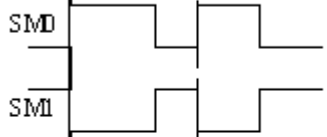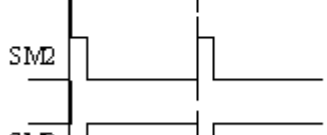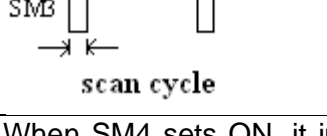ID	Function	Description
SM000	Coil ON when running	 <p>SM000 keeps ON when PLC running</p>
SM001	Coil OFF when running	 <p>SM001 keeps OFF when PLC running</p>
SM002	Initial positive pulse coil	 <p>SM002 is ON in first scan cycle</p>
SM003	Initial negative pulse coil	 <p>SM003 is OFF in first scan cycle</p>
SM004	PLC running error	When SM4 sets ON, it indicates that there is an error in the operation of PLC. (Firmware version V3.4.5 and above supports this function by PLC)
SM005	Battery low alarm coil	When the battery voltage is less than 2.5V, SM5 will put ON (at this time, please replace the battery as soon as possible, otherwise the data will not be maintained)
SM007	Power-off memory data error	

Clock (SM11-SM14)

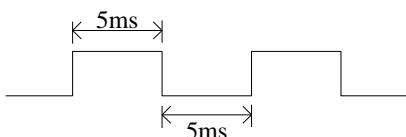ID	Function	Description
SM011	10ms frequency cycle	

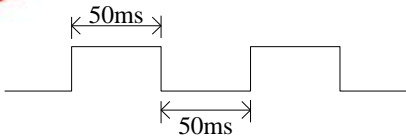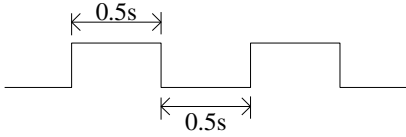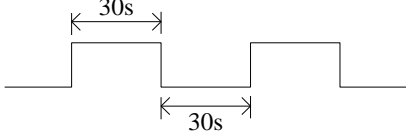SM012	100ms frequency cycle	
SM013	1s frequency cycle	
SM014	1min frequency cycle	

Mark (SM20-SM22)

ID	Function	Description
SM020	Zero bit	SM020 is ON when plus/minus operation result is 0
SM021	Borrow bit	SM021 is ON when minus operation overflows
SM022	Carry bit	SM022 is ON when plus operation overflows

PC Mode (SM32-SM34)

ID	Function	Description
SM032	Retentive register reset	When SM032 is ON, ON/OFF mapping memory of HM、HS and current values of HT、HC、HD will be reset.
SM033	Clear user's program	When SM033 is ON, all PLC user's program will be cleared.
SM034	All output forbidden	When SM034 is ON, all PLC external contacts will be set OFF.

Stepping Ladder

ID	Function	Description
SM040	The process is running	Set ON when the process is running

Interruption ban (SM50-SM90)

ID	Address	Function	Description
SM050	I0000/I0001	Forbid input interruption 0	After executing EI instruction, the input interruption couldn't act independently when M acts, even if the interruption is allowed. E.g.: when SM050 is ON, I0000/I0001 is forbidden.
SM051	I0100/I0101	Forbid input interruption 1	
SM052	I0200/I0201	Forbid input interruption 2	
SM053	I0300/I0301	Forbid input interruption 3	
SM054	I0400/I0401	Forbid input interruption 4	
.....	After executing EI instruction, the timing interruption couldn't act independently when M acts, even if the interruption is allowed.
SM069	I1900/I1901	Forbid input interruption 19	
SM070	I40**	Forbid timing interruption 0	
SM071	I41**	Forbid timing interruption 1	
SM072	I42**	Forbid timing interruption 2	
SM073	I43**	Forbid timing interruption 3	
SM074	I44**	Forbid timing interruption 4	
.....	
SM089	I59**	Forbid timing interruption 19	Forbid all interruptions
SM090		Forbid all interruptions	

High Speed Ring Counter (SM99)

address	Function	Note
SM099	High Speed Ring Counting enable	SM99 set ON, SD99 add one per 0.1ms, cycle between 0 and 32767

High speed count complete (SM100-SM109)

Address	Function	Note
SM100	HSC0 count complete flag (100 segments)	
SM101	HSC2 count complete flag (100 segments)	
SM102	HSC4 count complete flag (100 segments)	
SM103	HSC6 count complete flag (100 segments)	

SM104	HSC8 count complete flag (100 segments)	
SM105	HSC10 count complete flag (100 segments)	
SM106	HSC12 count complete flag (100 segments)	
SM107	HSC14 count complete flag (100 segments)	
SM108	HSC16 count complete flag (100 segments)	
SM109	HSC18 count complete flag (100 segments)	

High speed counter direction (SM110-SM119)

Address	Function	Note
SM110	HSC0 direction flag	
SM111	HSC2 direction flag	
SM112	HSC4 direction flag	
SM113	HSC6 direction flag	
SM114	HSC8 direction flag	
SM115	HSC10 direction flag	
SM116	HSC12 direction flag	
SM117	HSC14 direction flag	
SM118	HSC16 direction flag	
SM119	HSC18 direction flag	

High speed counter error (SM120-SM129)

address	Function	Note
SM120	HSC0 error flag	
SM121	HSC2 error flag	
SM122	HSC4 error flag	
SM123	HSC6 error flag	
SM124	HSC8 error flag	
SM125	HSC10 error flag	
SM126	HSC12 error flag	
SM127	HSC14 error flag	
SM128	HSC16 error flag	
SM129	HSC18 error flag	

Communication (SM140-SM193)

	Address	Function	Note
--	---------	----------	------

Serial port 0	SM140	Modbus instruction execution flag	When the instruction starts to execute, set ON When execution is complete, set OFF
	SM141	X-NET instruction execution flag	When the instruction starts to execute, set ON When execution is complete, set OFF
	SM142	Free format communication sending flag	When the instruction starts to execute, set ON When execution is complete, set OFF
	SM143	Free format communication receive complete flag	When receiving a frame of data or receiving data timeout, set ON. Require user program to set OFF
Serial port 1	SM150	Modbus instruction execution flag	Same to SM140
	SM151	X-NET instruction execution flag	Same to SM141
	SM152	Free format communication sending flag	Same to SM142
	SM153	Free format communication receive complete flag	Same to SM143
Serial port 2	SM160	Modbus instruction execution flag	Same to SM140
	SM161	X-NET instruction execution flag	Same to SM141
	SM162	Free format communication sending flag	Same to SM142
	SM163	Free format communication receive complete flag	Same to SM143
Serial port 3	SM170	Modbus instruction execution flag	Same to SM140
	SM171	X-NET instruction execution flag	Same to SM141
	SM172	Free format communication sending flag	Same to SM142
	SM173	Free format communication receive complete flag	Same to SM143
Serial port 4	SM180	Modbus instruction execution flag	Same to SM140
	SM181	X-NET instruction execution flag	Same to SM141
	SM182	Free format communication sending flag	Same to SM142
	SM183	Free format communication receive complete flag	Same to SM143
Serial port 5	SM190	Modbus instruction execution flag	Same to SM140
	SM191	X-NET instruction execution flag	Same to SM141

	SM192	Free format communication sending flag	Same to SM142
	SM193	Free format communication receive complete flag	Same to SM143

Sequence Function BLOCK (SM240-SM399)

ID	Function	Description
SM300	BLOCK1 running flag	SM300 will be ON when block1 is running
SM301	BLOCK2 running flag	SM301 will be ON when block2 is running
SM302	BLOCK3 running flag	SM302 will be ON when block3 is running
SM303	BLOCK4 running flag	SM303 will be ON when block4 is running
SM304	BLOCK5 running flag	SM304 will be ON when block5 is running
SM305	BLOCK6 running flag	SM305 will be ON when block6 is running
.....	
SM396	BLOCK97 running flag	SM396 will be ON when block97 is running
SM397	BLOCK98 running flag	SM397 will be ON when block98 is running
SM398	BLOCK99 running flag	SM398 will be ON when block99 is running
SM399	BLOCK100 running flag	SM399 will be ON when block100 is running

Error check (SM400-SM412)

ID	Function	Description
SM400	I/O error	ERR LED keeps ON, PLC don not run and output, check when power on
SM401	Expansion module communication error	
SM402	BD communication error	
.....		
SM405	No user program	Internal code check wrong
SM406	User program error	Implement code or configuration table check wrong
SM407	SSFD check error	ERR LED keeps ON, PLC don not run and output, check when power on

SM408	Memory error	Can not erase or write Flash
SM409	Calculation error	
SM410	Offset overflow	Offset exceeds soft element range
SM411	FOR-NEXT overflow	Reset when power on or users can also reset by hand.
SM412	Invalid data fill	When offset of register overflows, the return value will be SM372 value

Error Message (SM450-SM463)

ID	Function	Description
SM450	System error check	
SM451	Hardfault interrupt flag	
SM452		
SM453	SD card error	
SM454	Power supply is cut off	
.....		
SM460	Extension module ID not match	
SM461	BD/ED module ID not match	
SM462	Extension module communication overtime	
SM463	BD/ED module communication overtime	

Expansion Modules, BD Status (SM500)

ID	Function	Description
SM500	Module status read is finished	

Appendix 2. Special Data Register

Battery (SD5~SD7)

ID	Function	Description
SD005	Battery register	It will display 100 when the battery voltage is 3V, if the battery voltage is lower than 2.5V, it will display 0, it means please change new battery at once, otherwise the data will lose when PLC power off.
SD007	Power-off memory data error type	

Clock (SD10-SD019)

ID	Function	Description
SD010	Current scan cycle	100us, us is the unit
SD011	Min scan time	100us, us is the unit
SD012	Max scan time	100us, us is the unit
SD013	Second (clock)	0~59 (BCD code)
SD014	Minute (clock)	0~59 (BCD code)
SD015	Hour (clock)	0~23 (BCD code)
SD016	Day (clock)	0~31 (BCD code)
SD017	Month (clock)	0~12 (BCD code)
SD018	Year (clock)	2000~2099 (BCD code)
SD019	Week (clock)	0(Sunday)~6(Saturday)(BCD code)

Flag (SD020-SD031)

ID	Function	Note
SD020	Model type	
SD021	model (low-8) series (high-8)	
SD022	Compatiable system version (low) system version (high)	
SD023	Compatiable model version (low) model version (high)	
SD024	Model info	
SD025	Model info	
SD026	Model info	
SD027	Model info	
SD028	Suitable software version	
SD029	Suitable software version	
SD030	Suitable software version	
SD031	Suitable software version	

Step ladder (SD040)

ID	Function	Description
SD40	Flag of the executing process S	

High Speed Counting (SD100-SD109)

ID	Function	Description	
SD100	Current segment (No. n segment)		HSC00
SD101	Current segment (No. n segment)		HSC02
SD102	Current segment (No. n segment)		HSC04

SD103	Current segment (No. n segment)		HSC06
SD104	Current segment (No. n segment)		HSC08
SD105	Current segment (No. n segment)		HSC10
SD106	Current segment (No. n segment)		HSC12
SD107	Current segment (No. n segment)		HSC14
SD108	Current segment (No. n segment)		HSC16
SD109	Current segment (No. n segment)		HSC18

High speed counter error (SD120-SD129)

ID	Function	Note
SD120	HSC0 error info	
SD121	HSC2 error info	
SD122	HSC4 error info	
SD123	HSC6 error info	
SD124	HSC8 error info	
SD125	HSC10 error info	
SD126	HSC12 error info	
SD127	HSC14 error info	
SD128	HSC16 error info	
SD129	HSC18 error info	

communication (SD140~SD199)

	ID	Function	Note
Serial port 0	SD140	Modbus read write instruction execution result	0: correct 100: receive error 101: receive overtime 180: CRC error 181: LRC error 182: station error 183: send buffer overflow 400: function code error 401: address error 402: length error 403: data error 404: slave station busy 405: memory error (erase FLASH)
	SD141	X-Net communication result	0: correct 1: communication overtime 2: memory error 3: receive CRC error

Serial port 1	SD142	Free communication result	format send	0: correct 410: free format send buffer overflow
	SD143	Free communication result	format receive	0: correct 410: send data length overflow 411: receive data short 412: receive data long 413: receive error 414: receive overtime 415: no start character 416: no end character
	SD144	Free communication data numbers	format receive	In bytes, there are no start and stop characters
			
	SD149			
	SD150	Modbus read write instruction execution result		0: correct 100: receive error 101: receive overtime 180: CRC error 181: LRC error 182: station error 183: send buffer overflow 400: function code error 401: address error 402: length error 403: data error 404: slave station busy 405: memory error (erase FLASH)
	SD151	X-Net communication result		0: correct 1: communication overtime 2: memory error 3: receive CRC error
	SD152	Free communication result	format send	0: correct 410: free format send buffer overflow
	SD153	Free communication result	format receive	0: correct 410: send data length overflow 411: receive data short 412: receive data long 413: receive error 414: receive overtime 415: no start character 416: no end character
	SD154	Free communication data numbers	format receive	In bytes, there are no start and stop characters
			
	SD159			
	SD160	Modbus read write instruction execution result		0: correct 100: receive error 101: receive overtime 180: CRC error

Serial port 2			181: LRC error 182: station error 183: send buffer overflow 400: function code error 401: address error 402: length error 403: data error 404: slave station busy 405: memory error (erase FLASH)
	SD161	X-Net communication result	0: correct 1: communication overtime 2: memory error 3: receive CRC error
	SD162	Free communication send result	0: correct 410: free format send buffer overflow
	SD163	Free communication receive result	0: correct 410: send data length overflow 411: receive data short 412: receive data long 413: receive error 414: receive overtime 415: no start character 416: no end character
	SD164	Free communication receive data numbers	In bytes, there are no start and stop characters
 SD169		
Serial port 3	SD170~SD179		
Serial port 4	SD180~SD189		
Serial port 5	SD190~SD199		

Sequence Function Block (SD300-SD399)

ID	Function	Description
SD300	Executing instruction of BLOCK1	The value will be used when BLOCK monitors
SD301	Executing instruction of BLOCK2	The value will be used when BLOCK monitors
SD302	Executing instruction of BLOCK3	The value will be used when BLOCK monitors
SD303	Executing instruction of BLOCK4	The value will be used when BLOCK monitors
SD304	Executing instruction of BLOCK5	The value will be used when BLOCK monitors

SD305	Executing instruction of BLOCK6	The value will be used when BLOCK monitors
.....
SD396	Executing instruction of BLOCK97	The value will be used when BLOCK monitors
SD397	Executing instruction of BLOCK98	The value will be used when BLOCK monitors
SD398	Executing instruction of BLOCK99	The value will be used when BLOCK monitors
SD399	Executing instruction of BLOCK100	The value will be used when BLOCK monitors

Error Check (SD400-SD413)

ID	Function	Note
SD400		
SD401	Extension module no. of communication error	Means module no.n is error
SD402	BD/ED module no. of communication error	
SD403	FROM/TO error type	
SD404	PID error type	
.....		
SD409	Calculation error code	1: divide by 0 error 2: MRST, MSET front operand address less than back operand 3: ENCO, DECO data bits of encoding and decoding instructions exceed the limit. 4: BDC code error 7: Radical sign error
SD410	The number of offset register D when offset crosses the boundary	
SD411		
SD412	Invalid data fill value (low 16 bits)	
SD413	Invalid data fill value (high 16 bits)	

Error Check (SD450-SD452)

ID	Function	Description
SD450	1: Watchdog act (Default 200ms) 2: Control block application fail 3: Visit illegal address	
SD451	Hardware error type: 1: Register error	

	2: Bus error 3: Usage error	
SD452	Hardware error	
SD453	SD card error	
SD454	Power-off time	
SD460	Extension module ID not match	
SD461	BD/ED module ID not match	
SD462	Extension module communication overtime	
SD463	BD/ED module communication overtime	

Expansion Modules, BD Status (SD500-SD516)

ID	Function	Description	
SD500	Module number Expansion modules : #10000~10015 BD: #20000~20001 ED: #30000		
SD501~516	Expansion module, BD /ED status		16 registers

Module info (SD520-SD823)

ID	Function	Explanation	Note
SD520~SD535	Extension module info	Extension module 1	Each extension module, BD, ED occupies 16 registers
.....	
SD760~SD775	Extension module info	Extension module 16	
SD776~SD791	BD module info	BD module 1	
SD792~SD807	BD module info	BD module 2	
SD808~SD823	ED module info	ED module 1	

Expansion Module Error Information

ID	Function	Description	
SD860	Error times of module read		Expansion module 1
SD861	Error types of module read	Module address error. Module accepted data length error. Module CRC parity error when PLC is accepting data. Module ID error. Module overtime error.	
SD862	Error times of module write		

SD863	Error types of module write		
SD864	Error times of module read		Expansion module 2
SD865	Error types of module read	Module address error. Module accepted data length error. Module CRC parity error when PLC is accepting data. Module ID error. Module overtime error.	
SD866	Error times of module write		
SD867	Error types of module write		
.....			
SD920	Error times of module read		Expansion module 16
SD921	Error types of module read	Module address error. Module accepted data length error. Module CRC parity error when PLC is accepting data. Module ID error. Module overtime error.	
SD922	Error times of module write		
SD923	Error types of module write		
SD924	Error times of module read		BD module 1
SD925	Error types of module read		
SD926	Error times of module write		
SD927	Error types of module write		
SD928	Error times of module read		BD module 2
SD929	Error types of module read		
SD930	Error times of module write		
SD931	Error types of module write		
SD932	Error times of module read		ED module 1
SD933	Error types of module read		
SD934	Error times of module write		
SD935	Error types of module write		

Version info (SD990~SD993)

ID	Function	Explanation	Note
SD990	Firmware version date	Low 16-bit	
SD991	Firmware version compilation date	High 16-bit	
SD992	FPGA version compilation date	Low 16-bit	
SD993	FPGA version compilation date	High 16-bit	

Appendix 3. Special Flash Register

Special FLASH data register SFD

* means it works only after repower on the PLC

I filtering

ID	Function	Description
SFD0*	Input filter time	
SFD2*	Watchdog run-up time, default value is 200ms	

I Mapping

ID	Function	Description	
SFD10*	I00 corresponds to X**	Input terminal 0 corresponds to X** number	0xFF means terminal bad , 0xFE means terminal idle
SFD11*	I01 corresponds to X**		
SFD12*	I02 corresponds to X**		
.....		
SFD73*	I77 corresponds to X**	Default value is 77 (Octonary)	

O Mapping

ID	Function	Description	
SFD74*	O00 corresponds to Y**	Output terminal 0 correspond to Y** number	0xFF means terminal bad , 0xFE means terminal idle
		Default value is 0	
.....		
SFD134*	O77 corresponds to Y**	Default value is 77 (Octonary)	

I Attribute

ID	Function	Description	
SFD138*	I00 attribute	Attribute of input terminal 0	0: positive logic others : negative logic
SFD139*	I01 attribute		
.....		
SFD201*	I77 attribute		

High Speed Counting

ID	Function	Description
SFD320	HSC0 frequency times	2 : 2 times frequency ; 4: 4 times frequency(effective at AB phase counting mode)
SFD321	HSC2 frequency times	Ditto
SFD322	HSC4 frequency times	Ditto
SFD323	HSC6 frequency times	Ditto
SFD324	HSC8 frequency times	Ditto
SFD325	HSC10 frequency times	Ditto
SFD326	HSC12 frequency times	Ditto
SFD327	HSC14 frequency times	Ditto
SFD328	HSC16 frequency times	Ditto
SFD329	HSC18 frequency times	Ditto
SFD330	Bit selection of HSC absolute and relative (24 segment)	bit0 corresponds to HSC0 , bit1corresponds to HSC2, and so on, bit9 corresponds to HSC18 0: relative 1: absolute
SFD331	Interrupt circulating of 24 segments high speed counting	bit0 corresponds to HSC0 , bit1corresponds to HSC2, and so on, bit9 corresponds to HSC18 0: single 1: loop
SFD332	CAM function	bit0 corresponds to HSC0 , bit1corresponds to HSC2, and so on, bit9 corresponds to HSC18 0: do not support CAM function 1: support CAM function

Expansion Module Configuration

ID	Function	Explanation
SFD340	Extension module configuration status (#1#2)	Configuration Status of Extension Modules 1 and 2
SFD341	Extension module configuration status (#3#4)	Configuration Status of Extension Modules 3 and 4
.....
SFD347	Extension module configuration status (#15#16)	Configuration Status of Extension Modules 15 and 16
SFD348	BD module configuration status (#1#2)	Configuration Status of BD Modules 1 and 2
SFD349	ED module configuration status (#1)	Configuration Status of ED Module 1
SFD350	Extension module configuration	Configuration of Extension Module 1
:		
SFD359		
SFD360	Extension module configuration	Configuration of Extension Module 2
:		
SFD369		
:	:	
SFD500	Extension module configuration	Configuration of Extension Module 16
:		
SFD509		
SFD510	BD module configuration	Configuration of BD Module 1
:		
SFD519		
SFD520	BD module configuration	Configuration of BD Module 2
:		
SFD529		
SFD530	ED module configuration	Configuration of ED Module 1
:		
SFD539		

Communication

ID	Function	Note
SFD600	COM1 free format communication buffer bit numbers	0: 8-bit 1: 16-bit
SFD610	COM2 free format communication buffer bit numbers	0: 8-bit 1: 16-bit
SFD620	COM3 free format communication buffer bit numbers	0: 8-bit 1: 16-bit
SFD630	COM4 free format communication buffer bit numbers	0: 8-bit 1: 16-bit
SFD640	COM5 free format communication buffer bit numbers	0: 8-bit 1: 16-bit

Appendix 4. PLC resource conflict table

When PLC is used in practice, conflicts may arise because some resources are used at the same time. This section will list the resources that may cause conflicts in each PLC model. This part mainly refers to high-speed counting, accurate timing and pulse output.

Output:

	Accurate timing	High speed counting				Pulse output	
XD2-16, XD3-16, XD5-16, XL3-16							
	ET0	-	-	-	-	-	-
	ET2						
	ET4						
	ET6						
	ET8	HSC0					
	ET10		HSC2				
	ET12			HSC4			
	ET14					Y0	
	ET16					Y0	
	ET18					Y1	
	ET20					Y1	
	ET22						
	ET24						
XD3-24/32/48/60, ZG3-30							
	ET0						
	ET2						
	ET4						
	ET6						
	ET8						
	ET10						
	ET12	HSC0					
	ET14		HSC2				
	ET16			HSC4			
	ET18					Y0	
	ET20					Y0	
	ET22					Y1	
	ET24					Y1	
XD5-24/32/48/60, XDM-24/32/48/60, XD5E-30/60, XDME-60, XL5-32, XL5E-32							
	ET0	-	-	-	-	-	-
	ET2				HSC6		
	ET4			HSC4			
	ET6		HSC2				
	ET8	HSC0					

	ET10					Y3	
	ET12					Y3	
	ET14					Y2	
	ET16					Y2	
	ET18					Y1	
	ET20					Y1	
	ET22					Y0	
	ET24					Y0	
XDC-24/32/48/60							
	ET0	-	-	-	HSC6	-	-
	ET2			HSC4			
	ET4		HSC2				
	ET6	HSC0					
	ET8					Y3	
	ET10					Y3	
	ET12					Y2	
	ET14					Y2	
	ET16					Y1	
	ET18					Y1	
	ET20					Y0	
	ET22					Y0	
	ET24						

※1: This form should be read horizontally. Any two resources in each row cannot be used at the same time. Otherwise, it will cause conflict.

Appendix 5. PLC function configuration list

This part is used to check each model's configurations. Via this table, we can judge products type easily.

○ Selectable × Not support √ Support

series	USB port	232 port	485 port	RJ 45	Ex module	BD	High speed counter		Pulse output Channel(T /RT)	External interruption
							Incremental mode	AB phase		
XD1										
XD1-16	×	2	×	×	×	×	×	×	×	6
XD1-32	×	2	√	×	×	×	×	×	×	10
XD2										
XD2-16	×	2	√	×	×	×	3	3	2	6
XD2-24	×	2	√	×	×	1	3	3	2	10
XD2-32	×	2	√	×	×	1	3	3	2	10
XD2-48	×	2	√	×	×	2	3	3	2	10
XD2-60	×	2	√	×	×	2	3	3	2	10

XD3										
XD3-16	1	1	√	×	10	×	3	3	2	6
XD3-24	1	1	√	×	10	1	3	3	2	10
XD3-32	1	1	√	×	10	1	3	3	2	10
XD3-48	1	1	√	×	10	2	3	3	2	10
XD3-60	1	1	√	×	10	2	3	3	2	10
XD5										
XD5-16	1	1	√	×	16	×	3	3	2	10
XD5-24	1	1	√	×	16	1	3	3	2	10
XD5-32	1	1	√	×	16	1	3	3	2	10
XD5-48	1	1	√	×	16	2	3	3	2	10
XD5-60	1	1	√	×	16	2	3	3	2	10
XD5-24T4	1	1	√	×	16	1	4	4	4	10
XD5-32T4	1	1	√	×	16	1	4	4	4	10
XD5-48T4	1	1	√	×	16	2	4	4	4	10
XD5-48T6	1	1	√	×	16	2	6	6	6	10
XD5-60T4	1	1	√	×	16	2	4	4	4	10
XD5-60T6	1	1	√	×	16	2	6	6	6	10
XD5-60T10	1	1	√	×	16	2	10	10	10	10
XDM										
XDM-24T4	1	1	√	×	16	1	4	4	4	10
XDM-32T4	1	1	√	×	16	1	4	4	4	10
XDM-60T4	1	1	√	×	16	2	4	4	4	10
XDM-60T4L	1	1	√	×	16	2	4	4	4	10

series	USB port	232 port	485 port	RJ 45	Ex module	BD	High speed counter		Pulse output Channel(T /RT)	External interruption
							Incremental	AB phase		
XDM										
XDM-60T10	1	1	√	×	16	2	10	10	10	10
XDC										
XDC-24	×	2	√	×	16	1	4	4	2	10
XDC-32	×	2	√	×	16	1	4	4	2	10
XDC-48	×	2	√	×	16	2	4	4	2	10
XDC-60	×	2	√	×	16	2	4	4	2	10
XD5E										
XD5E-30T4	1	1	√	1	16	1	4	4	4	10
XD5E-60T10	×	1	√	2	16	2	10	10	10	10
XDME										
XDME-60T10	×	1	√	2	16	2	10	10	10	10
XL1										
XL1-16	×	1	√	×	×	×	×	×	×	6
XL3										
XL3-16	1	1	√	×	10	×	3	3	2	6

XL5										
XL5-32T4	1	1	√	×	16	1	4	4	4	10
XL5E										
XL5E-32T4	×	1	√		2	16	1	4	4	10
XLME										
XLME-32T4	×	1	√		2	16	1	4	4	10



Que esse conteúdo tenha agregado valor e conhecimento pra você!

Seu contato é importante para nós!

- www.kalatec.com.br
- Instagram - @kalateceautomação
- Facebook - kalatecautomação

NOSSAS FILIAIS

Matriz Campinas – SP
Rua Salto, 99
Jd. do Trevo
(19) 3045-4900

Filial São Paulo – SP
Av. das Nações Unidas,
18.801 – 11o Andar
(11) 5514-7680

Filial Joinville – SC
R. Almirante Jaceguay, 3659
Bairro Costa e Silva
(47) 3425-0042